



WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Area  
**LARRY DRUMMOND**  
Machine Id  
[LARRY DRUMMOND] 008 518412-8  
Component  
Starboard Genset  
Fluid  
CHEVRON DELO 400 LE 15W40 (10 GAL)

**RECOMMENDATION**

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>MW0073175</b>	MW0064369	MW0068772
Sample Date		Client Info		<b>02 Jul 2024</b>	01 Jun 2024	02 Apr 2024
Machine Age	hrs	Client Info		<b>36337</b>	35323	35254
Oil Age	hrs	Client Info		<b>379</b>	400	400
Filter Age	hrs	Client Info		<b>0</b>	400	400
Oil Changed		Client Info		<b>N/A</b>	Changed	Changed
Filter Changed		Client Info		<b>N/A</b>	Changed	Changed
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

**WEAR**

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	<b>6</b>	3	3
Chromium	ppm	ASTM D5185m	>4	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>2	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m		<b>4</b>	4	5
Silver	ppm	ASTM D5185m	>5	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>12	<b>3</b>	2	3
Lead	ppm	ASTM D5185m	>17	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>70	<b>0</b>	<1	0
Tin	ppm	ASTM D5185m	>15	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE

**CONTAMINATION**

There is no indication of any contamination in the oil.


Silicon	ppm	ASTM D5185m	>25	<b>6</b>	4	4
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	2
Fuel		WC Method	>4.0	<b>&lt;1.0</b>	<1.0	<1.0
Water		WC Method	>0.1	<b>NEG</b>	NEG	NEG
Glycol		WC Method		<b>NEG</b>	NEG	NEG
Soot %	%	*ASTM D7844		<b>0.1</b>	0.1	0.1
Nitration	Abs/cm	*ASTM D7624	>20	<b>7.3</b>	6.1	6.7
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>21.9</b>	21.2	21.1
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	NEG

**FLUID CONDITION**


The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		<b>2</b>	<1	2
Boron	ppm	ASTM D5185m		<b>265</b>	285	287
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>104</b>	105	93
Manganese	ppm	ASTM D5185m		<b>5</b>	1	<1
Magnesium	ppm	ASTM D5185m		<b>670</b>	689	665
Calcium	ppm	ASTM D5185m		<b>1587</b>	1703	1594
Phosphorus	ppm	ASTM D5185m	1200	<b>767</b>	786	743
Zinc	ppm	ASTM D5185m	1300	<b>897</b>	940	904
Sulfur	ppm	ASTM D5185m	3200	<b>3242</b>	3351	3365
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>16.0</b>	14.9	15.2
Base Number (BN)	mg KOH/g	ASTM D2896	9.6	<b>8.7</b>	9.0	8.9
Visc @ 100°C	cSt	ASTM D445	15.7	<b>13.1</b>	13.4	13.2


**FT-IR (Direct Trend)**

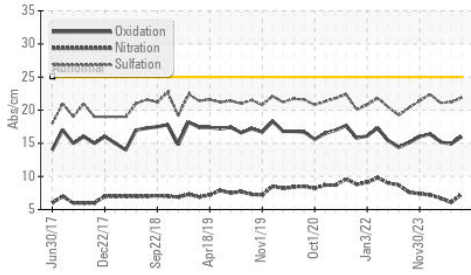


**Base Number**

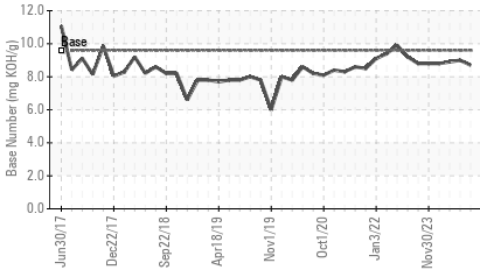


**Viscosity @ 100°C**

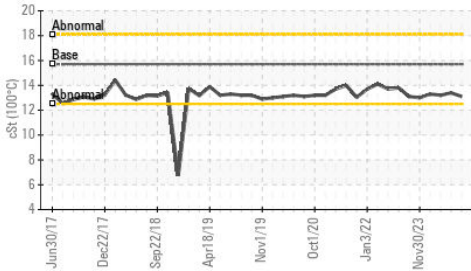


**Ferrous Alloys**

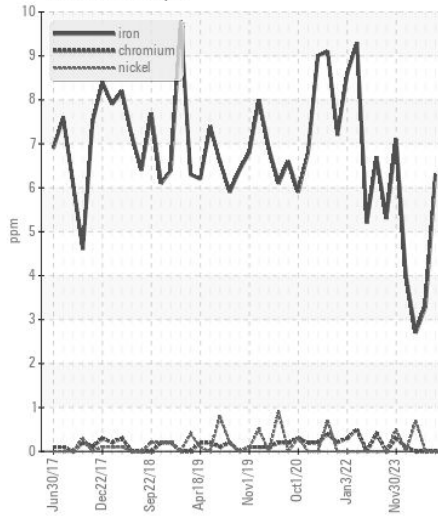


**Non-ferrous Metals**

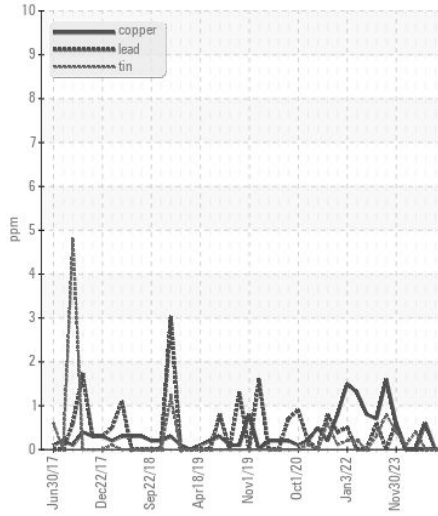

**Viscosity @ 100°C**

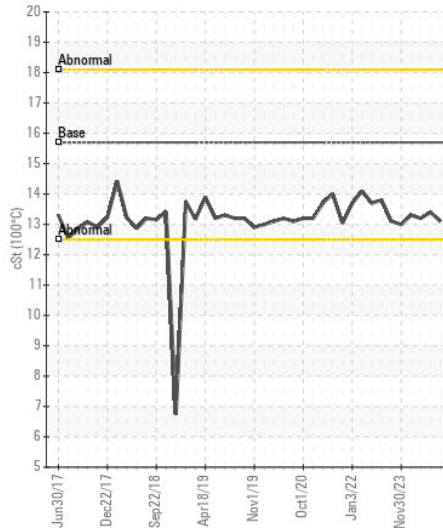

**Base Number**

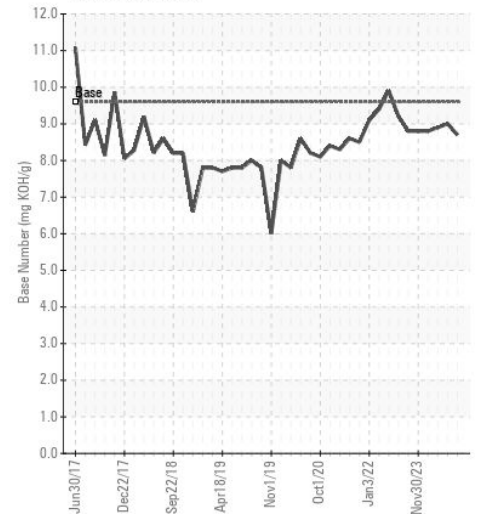

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513

**Sample No.** : MW0073175

**Lab Number** : 06237239

**Unique Number** : 11126073

**Test Package** : MAR 2

**Received** : 15 Jul 2024

**Tested** : 17 Jul 2024

**Diagnosed** : 17 Jul 2024 - Wes Davis

**INGRAM BARGE**

900 S 3RD ST

PADUCAH, KY

US 42003

Contact: JEFF BISHOP

jeff.bishop@ingrambarga.com

T:

F: (615)695-3697

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)