



FUEL REPORT

CORROSION	NORMAL
CONTAMINANTS	ABNORMAL
FUEL CONDITION	NORMAL

Machine Id

AJINOMOTO

Component

Diesel Fuel

Fluid

No.2 DIESEL FUEL (LOW-SULPHUR) (--- QTS)

RECOMMENDATION

We advise that you filter this fluid before use. All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel.

CORROSION

All metal levels are normal indicating no corrosion in the system.









CONTAMINANTS

There is a moderate amount of particulates present in the fuel. The water content is negligible. There is no bacteria or fungus (yeast and/or mold) indicated in the sample.

FUEL CONDITION

Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC06237470	---	---
Sample Date		Client Info		15 Jul 2024	---	---
Machine Age	hrs	Client Info		0	---	---
Sample Status				ABNORMAL	---	---
Aluminum	ppm	ASTM D5185m	<0.1	0	---	---
Nickel	ppm	ASTM D5185m	<0.1	0	---	---
Lead	ppm	ASTM D5185m	<0.1	0	---	---
Vanadium	ppm	ASTM D5185m	<0.1	0	---	---
Iron	ppm	ASTM D5185m	<0.1	0	---	---
Silicon	ppm	ASTM D5185m	<1.0	<1	---	---
Sodium	ppm	ASTM D5185m	<0.1	2	---	---
Potassium	ppm	ASTM D5185m	<0.1	0	---	---
Water	%	ASTM D6304	<0.05	0.002	---	---
ppm Water	ppm	ASTM D6304	<500	21	---	---
Particles >4µm		ASTM D7647	>2500	▲ 4180	---	---
Particles >6µm		ASTM D7647	>640	▲ 1265	---	---
Particles >14µm		ASTM D7647	>80	53	---	---
Particles >21µm		ASTM D7647	>20	10	---	---
Particles >38µm		ASTM D7647	>4	1	---	---
Particles >71µm		ASTM D7647	>3	0	---	---
Oil Cleanliness		ISO 4406 (c)	>18/16/13	▲ 19/17/13	---	---
% Gasoline	%	*In-House	<0.50	0.0	---	---
% Biodiesel	%	*In-House	<20.0	1.1	---	---
Calcium	ppm	ASTM D5185m	<0.1	0	---	---
Magnesium	ppm	ASTM D5185m	<0.1	0	---	---
Phosphorus	ppm	ASTM D5185m	<0.1	0	---	---
Zinc	ppm	ASTM D5185m	<0.1	0	---	---
Fuel Color	text	*Visual Screen	Yllow	Red	---	---
ASTM Color	scalar	*ASTM D1500		L4.5	---	---
Visc @ 40°C	cSt	ASTM D445	3.0	2.39	---	---
Pensky-Martens Flash Point	°C	*PMCC Calculated	52	60.8	---	---
Sulfur	ppm	ASTM D5185m	250	0	---	---
Sulfur (UVF)	ppm	ASTM D5453		9	---	---
Initial Boiling Point	°C	ASTM D86	165	171	---	---
10% Distill Point	°C	ASTM D86	201	202	---	---
20% Distill Point	°C	ASTM D86	216	217	---	---
30% Distill Point	°C	ASTM D86	230	232	---	---
40% Distill Point	°C	ASTM D86	243	246	---	---
50% Distill Point	°C	ASTM D86	255	259	---	---
60% Distill Point	°C	ASTM D86	267	274	---	---
70% Distill Point	°C	ASTM D86	280	288	---	---
80% Distill Point	°C	ASTM D86	295	305	---	---
90% Distill Point	°C	ASTM D86	310	327	---	---
Final Boiling Point	°C	ASTM D86	341	358	---	---
API Gravity		ASTM D7777	37.7	37	---	---
Cetane Index		ASTM D4737	<40.0	48	---	---

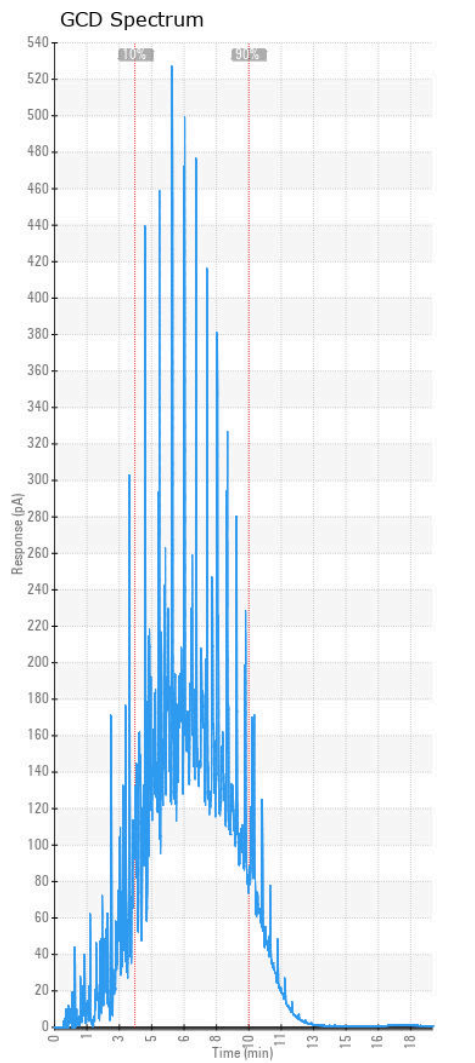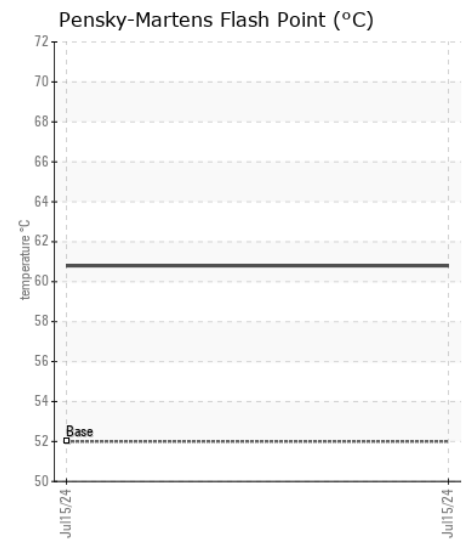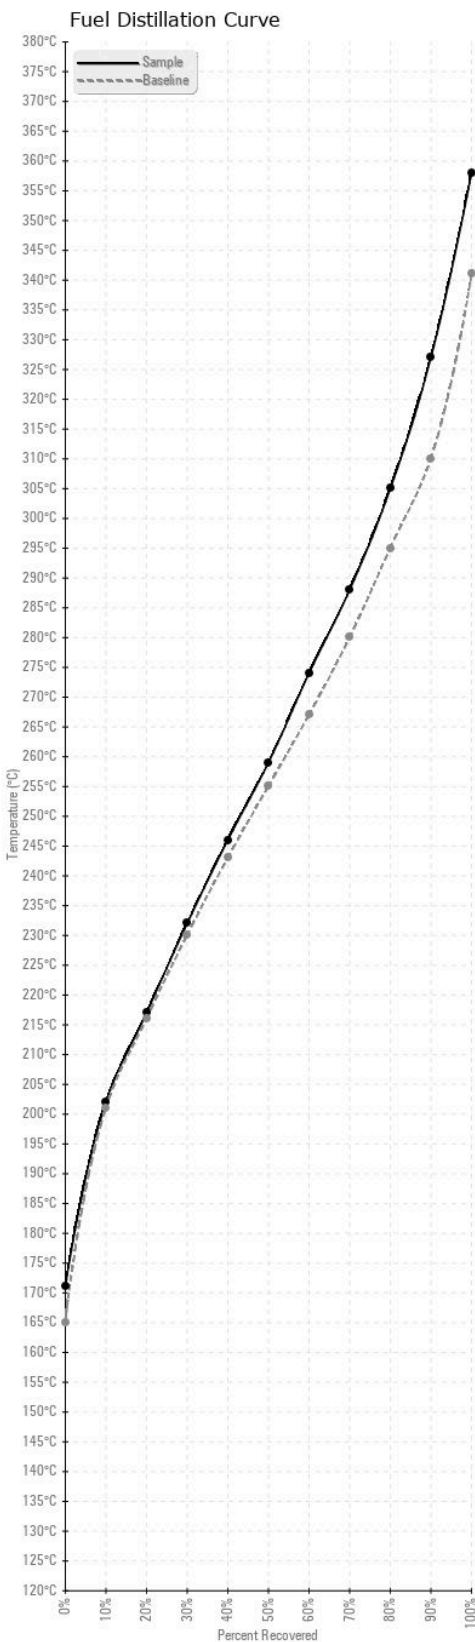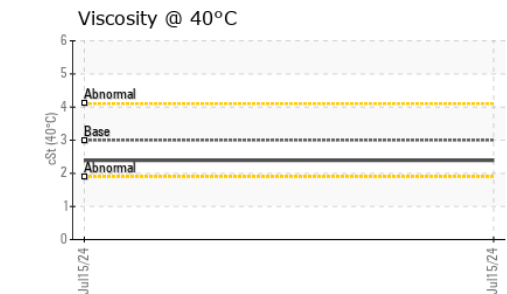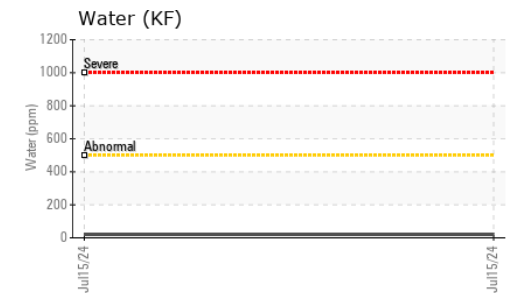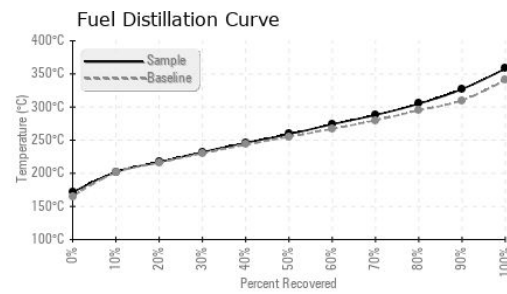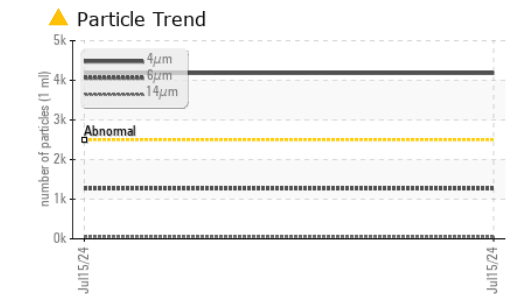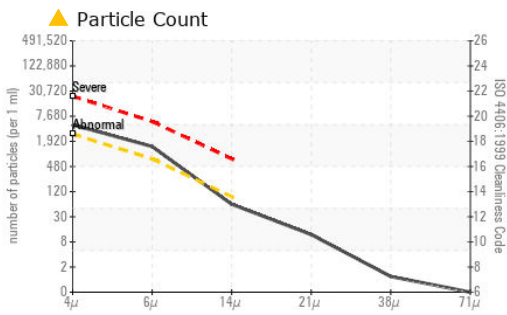

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC06237470
Lab Number : 06237470
Unique Number : 11126304
Test Package : DF-2 (Additional Tests: Fuel, Screen)

Received : 15 Jul 2024
Tested : 18 Jul 2024
Diagnosed : 18 Jul 2024 - Elizabeth Valachovic

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

COUCH OIL COMPANY
 2907 HILLSBOROUGH RD
 DURHAM, NC
 US 27705

Contact: JESSE BROWN
 jesse@couchoilcompany.com

T: (919)285-5408

F: