



|                 |               |
|-----------------|---------------|
| WEAR            | <b>NORMAL</b> |
| CONTAMINATION   | <b>NORMAL</b> |
| FLUID CONDITION | <b>NORMAL</b> |

Machine Id  
**RAIN MAN**  
Component  
**Port Genset**  
Fluid  
**CHEVRON DELO 400 MULTIGRADE 15W40 (3 GAL)**

**RECOMMENDATION**

Resample at the next service interval to monitor. Please specify the component make and model with your next sample.

| Test           | UOM | Method      | Limit/Abn | Current            | History1    | History2    |
|----------------|-----|-------------|-----------|--------------------|-------------|-------------|
| Sample Number  |     | Client Info |           | <b>MW06237520</b>  | MW0059310   | MW0059278   |
| Sample Date    |     | Client Info |           | <b>03 Jul 2024</b> | 07 Apr 2024 | 05 Dec 2023 |
| Machine Age    | hrs | Client Info |           | <b>0</b>           | 0           | 0           |
| Oil Age        | hrs | Client Info |           | <b>0</b>           | 0           | 0           |
| Filter Age     | hrs | Client Info |           | <b>0</b>           | 0           | 0           |
| Oil Changed    |     | Client Info |           | <b>N/A</b>         | Changed     | Changed     |
| Filter Changed |     | Client Info |           | <b>N/A</b>         | Changed     | Changed     |
| Sample Status  |     |             |           | <b>NORMAL</b>      | NORMAL      | NORMAL      |

**WEAR**

All component wear rates are normal.

|              |        |             |      |              |      |      |
|--------------|--------|-------------|------|--------------|------|------|
| Iron         | ppm    | ASTM D5185m | >50  | <b>10</b>    | 13   | 6    |
| Chromium     | ppm    | ASTM D5185m | >4   | <b>0</b>     | <1   | <1   |
| Nickel       | ppm    | ASTM D5185m | >2   | <b>0</b>     | <1   | <1   |
| Titanium     | ppm    | ASTM D5185m |      | <b>12</b>    | 13   | 13   |
| Silver       | ppm    | ASTM D5185m | >5   | <b>0</b>     | <1   | 0    |
| Aluminum     | ppm    | ASTM D5185m | >12  | <b>2</b>     | 3    | 2    |
| Lead         | ppm    | ASTM D5185m | >17  | <b>2</b>     | 2    | <1   |
| Copper       | ppm    | ASTM D5185m | >70  | <b>&lt;1</b> | 2    | <1   |
| Tin          | ppm    | ASTM D5185m | >15  | <b>0</b>     | <1   | <1   |
| Vanadium     | ppm    | ASTM D5185m |      | <b>0</b>     | <1   | <1   |
| White Metal  | scalar | *Visual     | NONE | <b>NONE</b>  | NONE | NONE |
| Yellow Metal | scalar | *Visual     | NONE | <b>NONE</b>  | NONE | NONE |

**CONTAMINATION**

There is no indication of any contamination in the oil.


|                  |          |             |       |                |       |       |
|------------------|----------|-------------|-------|----------------|-------|-------|
| Silicon          | ppm      | ASTM D5185m | >25   | <b>6</b>       | 6     | 6     |
| Potassium        | ppm      | ASTM D5185m | >20   | <b>2</b>       | 4     | 3     |
| Fuel             |          | WC Method   | >4.0  | <b>&lt;1.0</b> | <1.0  | <1.0  |
| Water            |          | WC Method   | >0.1  | <b>NEG</b>     | NEG   | NEG   |
| Glycol           |          | WC Method   |       | <b>NEG</b>     | NEG   | NEG   |
| Soot %           | %        | *ASTM D7844 |       | <b>0.1</b>     | 0.1   | 0.1   |
| Nitration        | Abs/cm   | *ASTM D7624 | >20   | <b>10.4</b>    | 9.6   | 8.6   |
| Sulfation        | Abs/.1mm | *ASTM D7415 | >30   | <b>21.8</b>    | 21.3  | 19.2  |
| Silt             | scalar   | *Visual     | NONE  | <b>NONE</b>    | NONE  | NONE  |
| Debris           | scalar   | *Visual     | NONE  | <b>NONE</b>    | NONE  | NONE  |
| Sand/Dirt        | scalar   | *Visual     | NONE  | <b>NONE</b>    | NONE  | NONE  |
| Appearance       | scalar   | *Visual     | NORML | <b>NORML</b>   | NORML | NORML |
| Odor             | scalar   | *Visual     | NORML | <b>NORML</b>   | NORML | NORML |
| Emulsified Water | scalar   | *Visual     | >0.1  | <b>NEG</b>     | NEG   | NEG   |

**FLUID CONDITION**


The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

|                  |          |             |      |             |      |      |
|------------------|----------|-------------|------|-------------|------|------|
| Sodium           | ppm      | ASTM D5185m |      | <b>4</b>    | 3    | <1   |
| Boron            | ppm      | ASTM D5185m |      | <b>71</b>   | 89   | 127  |
| Barium           | ppm      | ASTM D5185m |      | <b>0</b>    | 0    | 11   |
| Molybdenum       | ppm      | ASTM D5185m |      | <b>47</b>   | 44   | 49   |
| Manganese        | ppm      | ASTM D5185m |      | <b>1</b>    | <1   | <1   |
| Magnesium        | ppm      | ASTM D5185m |      | <b>699</b>  | 660  | 650  |
| Calcium          | ppm      | ASTM D5185m |      | <b>1855</b> | 1730 | 1679 |
| Phosphorus       | ppm      | ASTM D5185m | 1360 | <b>723</b>  | 714  | 650  |
| Zinc             | ppm      | ASTM D5185m | 1480 | <b>838</b>  | 827  | 771  |
| Sulfur           | ppm      | ASTM D5185m |      | <b>3379</b> | 3153 | 2909 |
| Oxidation        | Abs/.1mm | *ASTM D7414 | >25  | <b>19.6</b> | 18.4 | 15.1 |
| Base Number (BN) | mg KOH/g | ASTM D2896  | 12.2 | <b>7.2</b>  | 7.5  | 7.5  |
| Visc @ 100°C     | cSt      | ASTM D445   | 15.1 | <b>14.7</b> | 14.8 | 14.2 |


**FT-IR (Direct Trend)**

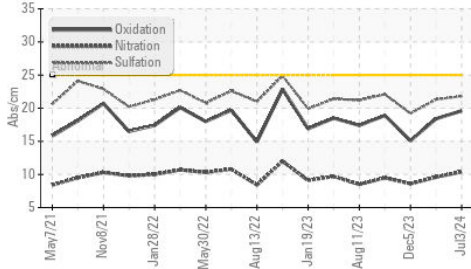


**Base Number**

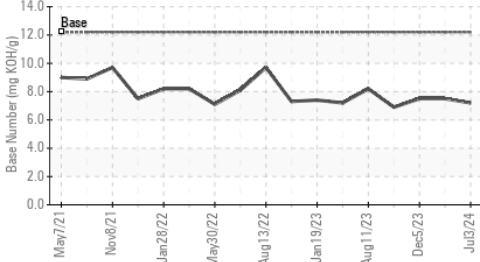


**Viscosity @ 100°C**

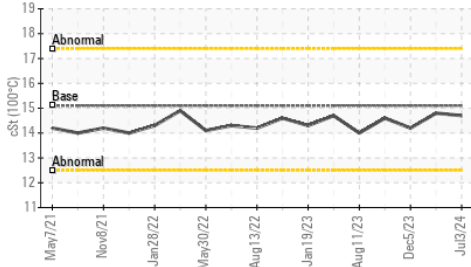


**Ferrous Alloys**

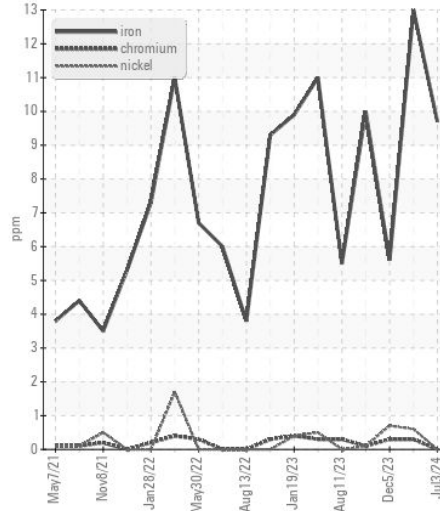


**Non-ferrous Metals**

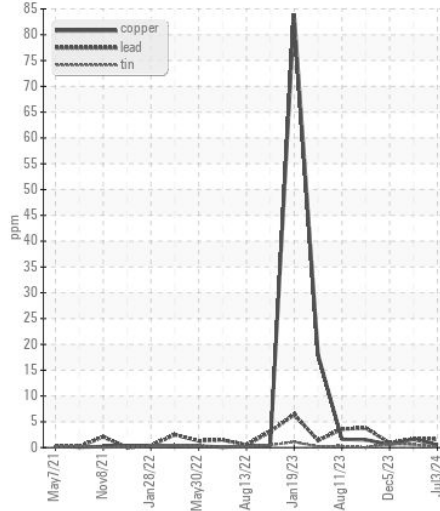

**Viscosity @ 100°C**

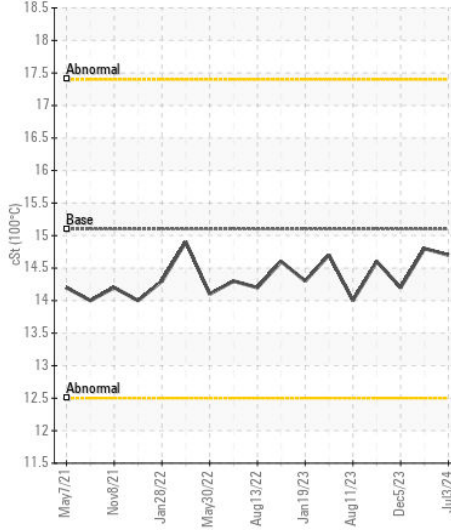

**Base Number**

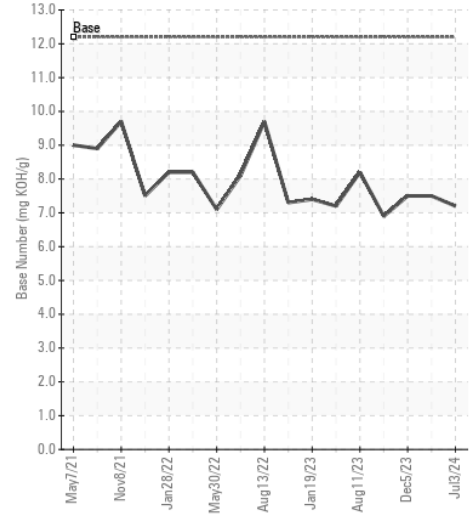

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : MW06237520 **Received** : 16 Jul 2024  
**Lab Number** : 06237520 **Tested** : 17 Jul 2024  
**Unique Number** : 11126354 **Diagnosed** : 17 Jul 2024 - Wes Davis  
**Test Package** : MAR 2

**OSAGE MARINE**  
 750 E DAVIS ST  
 ST LOUIS, MO  
 US 63111

Contact: MIKE KESSLER  
 mike.kessler@osagemarine.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
 F: