

Machine Id  
**Lick Creek 3**  
Component  
**Natural Gas Engine**  
Fluid  
**PETRO CANADA SENTRON LD 3000 (--- GAL)**

**RECOMMENDATION**

No corrective action is recommended at this time. Resample at the next service interval to monitor. Please specify the component make and model with your next sample.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>PCA0117090</b>	PCA0117200	---
Sample Date		Client Info		<b>09 Jul 2024</b>	29 May 2024	---
Machine Age	hrs	Client Info		<b>141141</b>	140164	---
Oil Age	hrs	Client Info		<b>141141</b>	4648	---
Filter Age	hrs	Client Info		<b>0</b>	4648	---
Oil Changed		Client Info		<b>Not Changd</b>	Not Changd	---
Filter Changed		Client Info		<b>Not Changd</b>	Not Changd	---
Sample Status				<b>NORMAL</b>	NORMAL	---

**WEAR**

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	<b>&lt;1</b>	4	---
Chromium	ppm	ASTM D5185m	>4	<b>0</b>	<1	---
Nickel	ppm	ASTM D5185m	>2	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m		<b>0</b>	0	---
Silver	ppm	ASTM D5185m	>3	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>9	<b>1</b>	2	---
Lead	ppm	ASTM D5185m	>30	<b>0</b>	3	---
Copper	ppm	ASTM D5185m	>35	<b>0</b>	4	---
Tin	ppm	ASTM D5185m	>4	<b>0</b>	1	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	---
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	---

**CONTAMINATION**













Fuel content negligible. There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>+100	<b>3</b>	4	---
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	7	---
Fuel	%	ASTM D3524	>4.0	<b>0.0</b>	0.1	---
Water		WC Method	>0.1	<b>NEG</b>	NEG	---
Soot %	%	*ASTM D7844		<b>0</b>	0	---
Nitration	Abs/cm	*ASTM D7624	>20	<b>4.0</b>	4.0	---
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>14.3</b>	14.3	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	---

**FLUID CONDITION**

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		<b>2</b>	3	---
Boron	ppm	ASTM D5185m	5	<b>1</b>	0	---
Barium	ppm	ASTM D5185m	1	<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m	2	<b>127</b>	14	---
Manganese	ppm	ASTM D5185m	1	<b>&lt;1</b>	2	---
Magnesium	ppm	ASTM D5185m	5	<b>7</b>	6	---
Calcium	ppm	ASTM D5185m	1220	<b>1472</b>	1397	---
Phosphorus	ppm	ASTM D5185m	298	<b>286</b>	305	---
Zinc	ppm	ASTM D5185m	350	<b>335</b>	354	---
Sulfur	ppm	ASTM D5185m	1995	<b>2865</b>	4260	---
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>8.3</b>	7.4	---
Acid Number (AN)	mg KOH/g	ASTM D8045	0.86	<b>0.39</b>	0.16	---
Base Number (BN)	mg KOH/g	ASTM D2896	3.9	<b>4.35</b>	3.80	---
Visc @ 100°C	cSt	ASTM D445	13.7	<b>13.2</b>	13.2	---

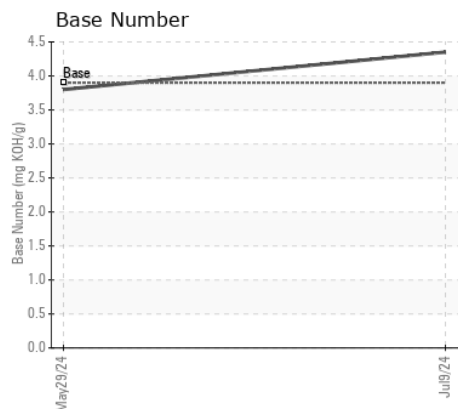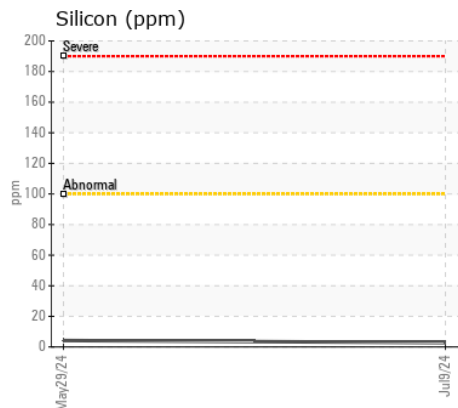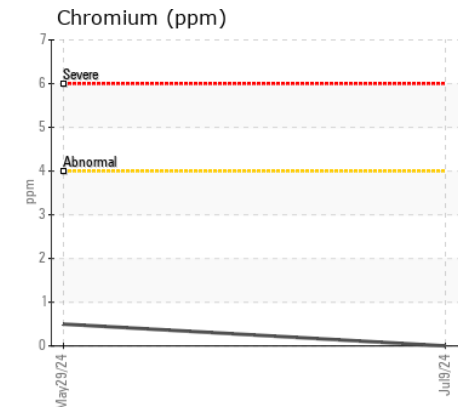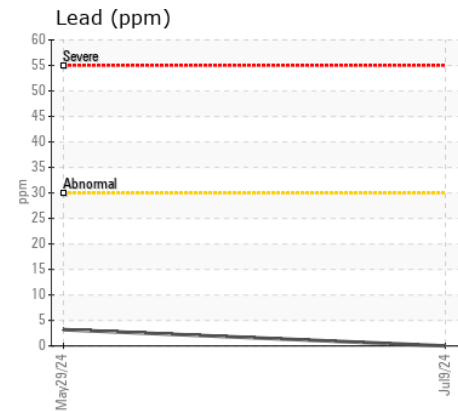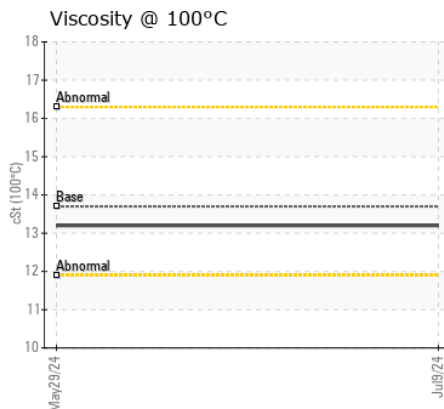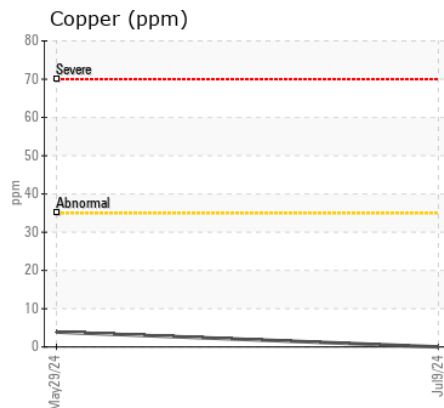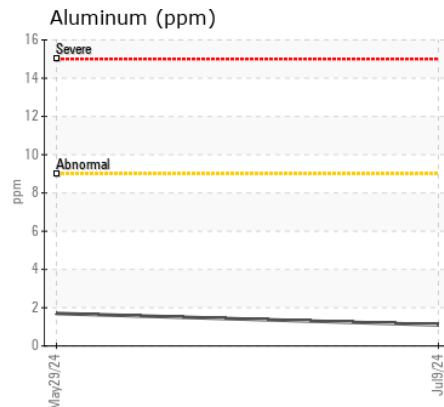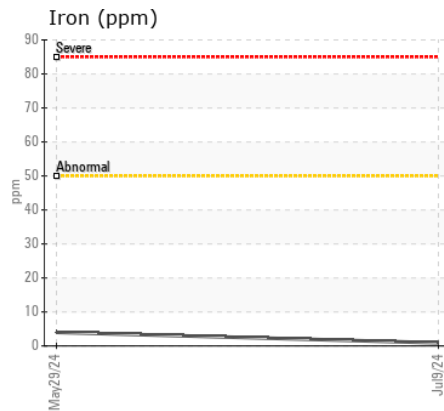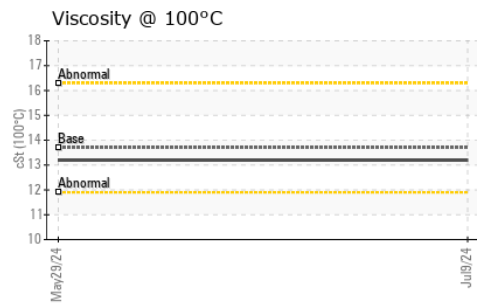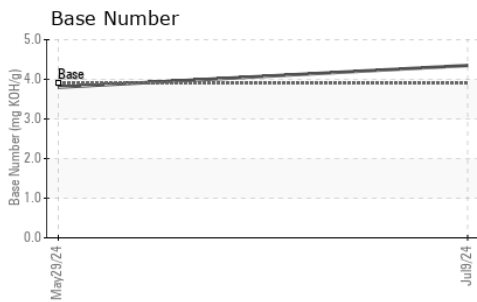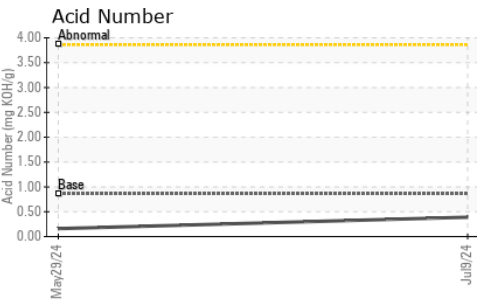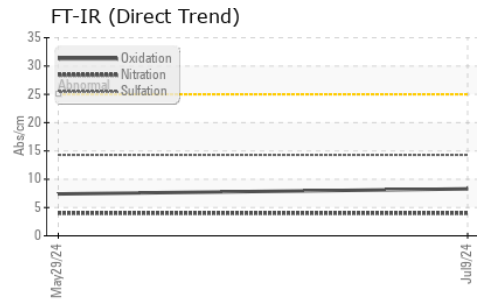

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA0117090 **Received** : 16 Jul 2024  
**Lab Number** : 06237977 **Tested** : 17 Jul 2024  
**Unique Number** : 11126811 **Diagnosed** : 18 Jul 2024 - Sean Felton  
**Test Package** : MOB 2 ( Additional Tests: FuelDilution, PercentFuel )

**ENERVEST OPERATING - LICK CREEK**  
 1645 COMPRESSOR STATION ROAD  
 DANTE, VA  
 US 24237  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: