

Machine Id **Copperhead Gap 2** Compressor PETRO CANADA TURBOFLO R&O 150 (57 GAL)

RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
Resample at the next service interval to monitor. (Customer Sample Comment: Top Up Amount: 75 GAL Top Up Amount: 75 GAL)	Sample Number		Client Info		PCA0117245	PCA0117237	PCA0117231
	Sample Date		Client Info		08 Jul 2024	03 Jun 2024	01 May 2024
	Machine Age	hrs	Client Info		118751	117938	117338
	Oil Age	hrs	Client Info		118751	117938	117338
	Filter Age	hrs	Client Info		118751	117938	117338
	Oil Changed		Client Info		Oil Added	N/A	N/A
	Filter Changed		Client Info		N/A	N/A	N/A
	Sample Status				NORMAL	NORMAL	NORMAL
WEAR	Iron	ppm	ASTM D5185m	>50	<1	2	2
All component wear rates are normal.	Chromium	ppm	ASTM D5185m	>10	0	<1	<1
	Nickel	ppm	ASTM D5185m		<1	0	0
	Titanium	ppm	ASTM D5185m		0	0	0
	Silver	ppm	ASTM D5185m		0	0	0
	Aluminum	ppm	ASTM D5185m	>25	<1	<1	<1
	Lead	ppm	ASTM D5185m		0	3	3
	Copper	ppm	ASTM D5185m	>50	6	4	4
	Tin	ppm	ASTM D5185m	>15	0	1	1
	Vanadium	ppm	ASTM D5185m		0	0	0
	White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
	Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
CONTAMINATION There is no indication of any contamination in the component.	Silicon	ppm	ASTM D5185m	>25	<1	1	2
	Potassium	ppm	ASTM D5185m		2	5	4
	Water		WC Method		NEG	NEG	NEG
	Silt	scalar	*Visual	NONE	NONE	NONE	NONE
	Debris	scalar	*Visual	NONE	NONE	NONE	NONE
	Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
	Appearance	scalar	*Visual	NORML	NORML	NORML	NORM
	Odor	scalar	*Visual	NORML	NORML	NORML	NORM
	Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG
FLUID CONDITION	Sodium	ppm	ASTM D5185m		3	2	2
	Boron	ppm	ASTM D5185m		0	0	0
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.	Barium	ppm	ASTM D5185m		0	0	0
	Molybdenum	ppm	ASTM D5185m		0	2	2
	Manganese	ppm	ASTM D5185m		1	2	2
	Magnesium	ppm	ASTM D5185m		2	0	0
	Calcium	ppm	ASTM D5185m	0	- 1	<1	<1
	Phosphorus	ppm	ASTM D5185m		11	3	1
	Zinc	ppm	ASTM D5185m		0	0	0
		le le		-	-	-	-

Sulfur

Acid Number (AN)

cSt

Visc @ 40°C

ppm ASTM D5185m

mg KOH/g ASTM D8045 0.18

ASTM D445 137.1

140 142 142 Submitted By: RANDY SMITH

794


0.11


781

0.12

737

0.11

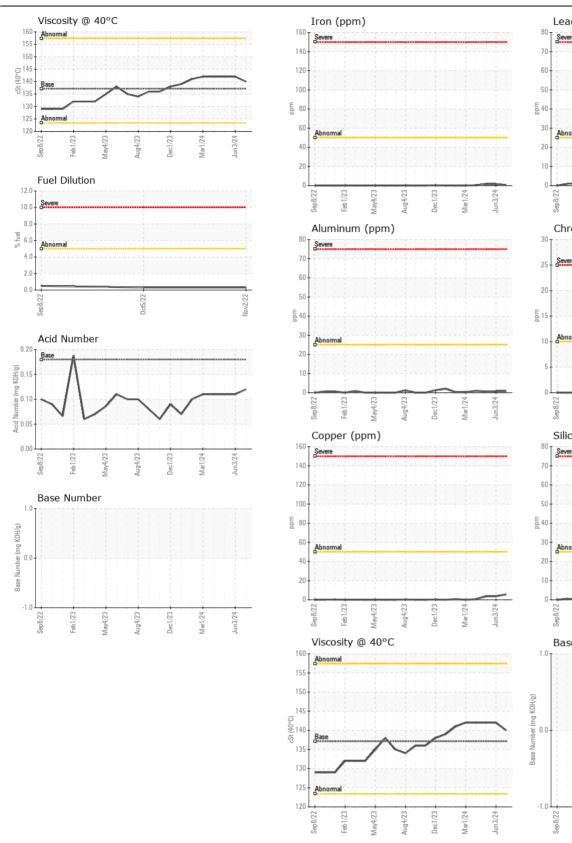

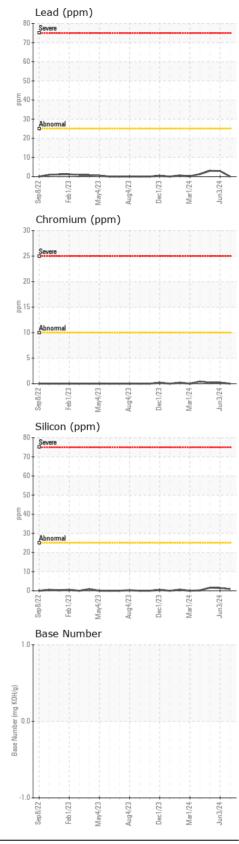

ENERVEST OPERATING - COPPERHEAD GAP Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513 Sample No. : PCA0117245 Received 3681 RABBIT RIDGE : 16 Jul 2024 : 06238499 Lab Number CLEVELAND, VA Tested : 18 Jul 2024 US 24225 Unique Number : 11127333 Diagnosed : 18 Jul 2024 - Doug Bogart Test Package : MOB 2 (Additional Tests: FuelDilution, PercentFuel, TBN) Contact: Service Manager Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. T: F: Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: ENECLECG [WUSCAR] 06238499 (Generated: 07/18/2024 14:20:53) Rev: 1

Submitted By: RANDY SMITH Page 2 of 2