



OIL ANALYSIS REPORT

| | |
|-----------------|---------------|
| WEAR | NORMAL |
| CONTAMINATION | NORMAL |
| FLUID CONDITION | NORMAL |

Machine Id
Liberty 1
 Component
Natural Gas Engine
 Fluid
PETRO CANADA SENTRON LD 3000 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

| Test | UOM | Method | Limit/Abn | Current | History1 | History2 |
|----------------|-----|-------------|-----------|--------------------|-------------|-------------|
| Sample Number | | Client Info | | PCA0117257 | PCA0112023 | PCA0112019 |
| Sample Date | | Client Info | | 10 Jul 2024 | 03 Jun 2024 | 01 May 2024 |
| Machine Age | hrs | Client Info | | 73287 | 72428 | 71644 |
| Oil Age | hrs | Client Info | | 15077 | 14218 | 13434 |
| Filter Age | hrs | Client Info | | 15077 | 14218 | 13434 |
| Oil Changed | | Client Info | | Not Chngd | N/A | N/A |
| Filter Changed | | Client Info | | Not Chngd | N/A | N/A |
| Sample Status | | | | NORMAL | NORMAL | NORMAL |

WEAR

All component wear rates are normal.

| | | | | | | |
|--------------|--------|-------------|------|--------------|------|------|
| Iron | ppm | ASTM D5185m | >50 | 2 | 3 | 2 |
| Chromium | ppm | ASTM D5185m | >4 | <1 | <1 | <1 |
| Nickel | ppm | ASTM D5185m | >2 | 0 | 0 | <1 |
| Titanium | ppm | ASTM D5185m | | <1 | 0 | <1 |
| Silver | ppm | ASTM D5185m | >3 | 0 | 0 | 0 |
| Aluminum | ppm | ASTM D5185m | >9 | 2 | 3 | <1 |
| Lead | ppm | ASTM D5185m | >30 | 0 | 4 | 1 |
| Copper | ppm | ASTM D5185m | >35 | <1 | 4 | <1 |
| Tin | ppm | ASTM D5185m | >4 | 0 | 1 | 1 |
| Vanadium | ppm | ASTM D5185m | | 0 | 0 | <1 |
| White Metal | scalar | *Visual | NONE | NONE | NONE | NONE |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE | NONE |

CONTAMINATION













Tests indicate that there is no fuel present in the oil. There is no indication of any contamination in the oil.

| | | | | | | |
|------------------|----------|-------------|-------|--------------|-------|-------|
| Silicon | ppm | ASTM D5185m | >+100 | 2 | 3 | 2 |
| Potassium | ppm | ASTM D5185m | >20 | 5 | 4 | 3 |
| Fuel | % | ASTM D3524 | >4.0 | 0.0 | 0.5 | 0.0 |
| Water | | WC Method | >0.1 | NEG | NEG | NEG |
| Soot % | % | *ASTM D7844 | | 0 | 0 | 0 |
| Nitration | Abs/cm | *ASTM D7624 | >20 | 3.8 | 3.6 | 3.5 |
| Sulfation | Abs/.1mm | *ASTM D7415 | >30 | 14.0 | 13.6 | 13.6 |
| Silt | scalar | *Visual | NONE | NONE | NONE | NONE |
| Debris | scalar | *Visual | NONE | NONE | NONE | NONE |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | NORML | NORML |
| Odor | scalar | *Visual | NORML | NORML | NORML | NORML |
| Emulsified Water | scalar | *Visual | >0.1 | NEG | NEG | NEG |

FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| | | | | | | |
|------------------|----------|-------------|------|--------------|------|-------|
| Sodium | ppm | ASTM D5185m | | 0 | 2 | 0 |
| Boron | ppm | ASTM D5185m | 5 | <1 | 0 | 0 |
| Barium | ppm | ASTM D5185m | 1 | 0 | 0 | 0 |
| Molybdenum | ppm | ASTM D5185m | 2 | 1 | 4 | 2 |
| Manganese | ppm | ASTM D5185m | 1 | 0 | 2 | <1 |
| Magnesium | ppm | ASTM D5185m | 5 | 7 | 8 | 8 |
| Calcium | ppm | ASTM D5185m | 1220 | 1251 | 1355 | 1241 |
| Phosphorus | ppm | ASTM D5185m | 298 | 276 | 300 | 288 |
| Zinc | ppm | ASTM D5185m | 350 | 344 | 367 | 343 |
| Sulfur | ppm | ASTM D5185m | 1995 | 2221 | 2848 | 2616 |
| Oxidation | Abs/.1mm | *ASTM D7414 | >25 | 7.6 | 7.4 | 7.5 |
| Acid Number (AN) | mg KOH/g | ASTM D8045 | 0.86 | 0.14 | 0.35 | 0.815 |
| Base Number (BN) | mg KOH/g | ASTM D2896 | 3.9 | 4.85 | 3.98 | 3.73 |
| Visc @ 100°C | cSt | ASTM D445 | 13.7 | 13.0 | 12.9 | 13.0 |

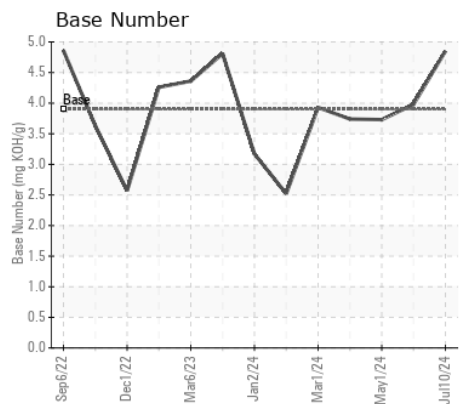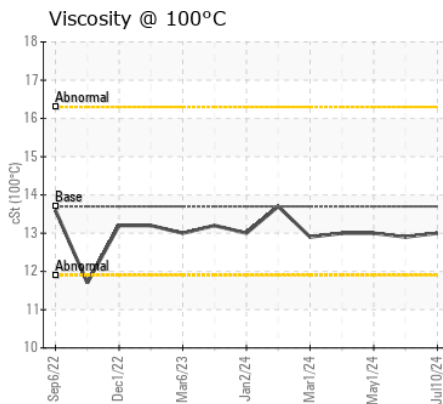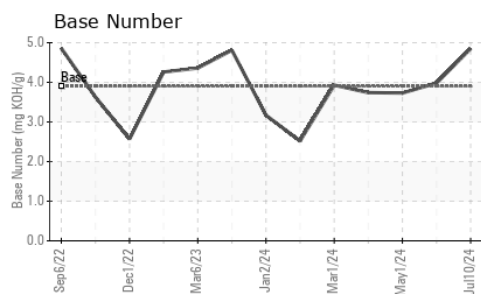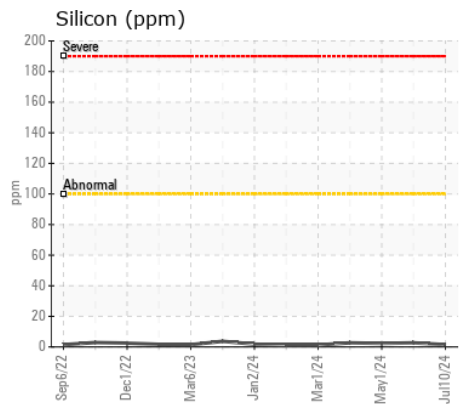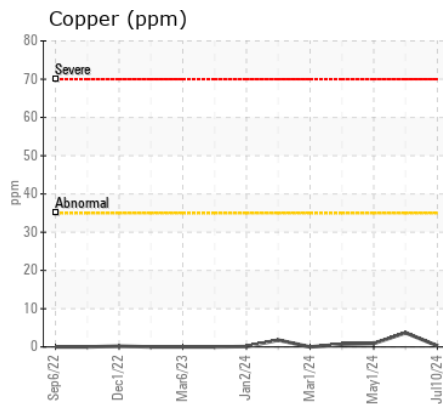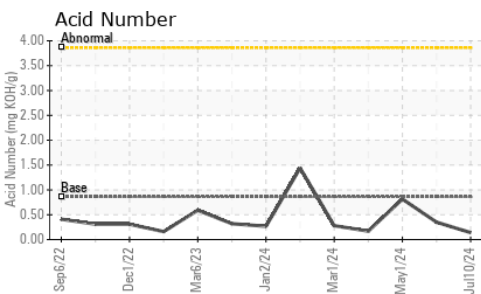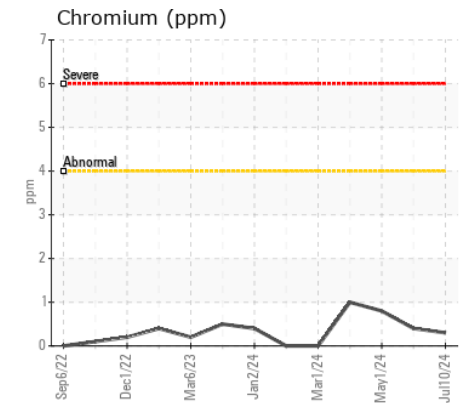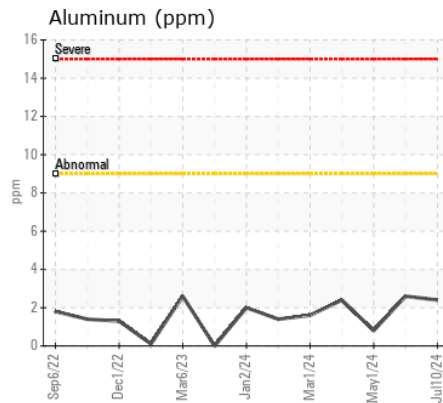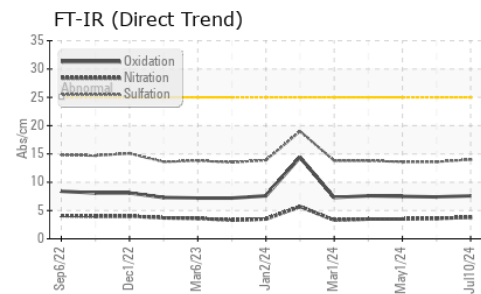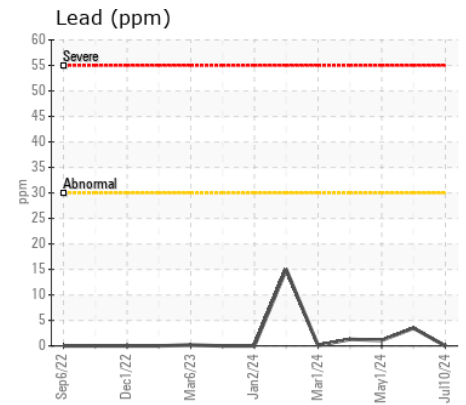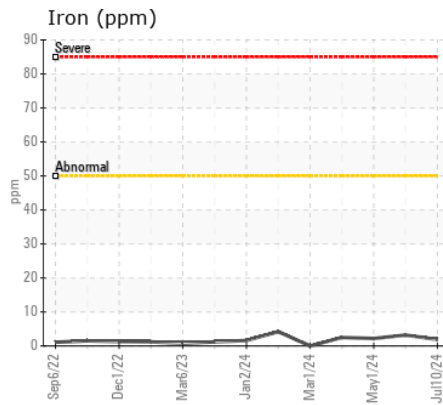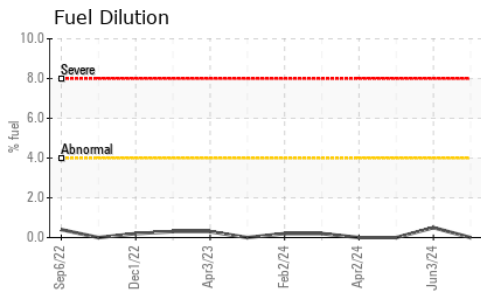

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0117257 **Received** : 16 Jul 2024
Lab Number : 06238561 **Tested** : 17 Jul 2024
Unique Number : 11127395 **Diagnosed** : 17 Jul 2024 - Wes Davis
Test Package : MOB 2 (Additional Tests: FuelDilution, PercentFuel)

ENERVEST OPERATING - LIBERTY
 318 SINGLETON ROAD
 NORA, VA
 US 24272
 Contact: Service Manager

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: