

## Machine Id DFGS 061022 Component Diesel Engine Filuid DIESEL ENGINE OIL SAE 40 (--- GAL)

## RECOMMENDATION

Resample at the next service interval to monitor. The fluid was not specified, however, a fluid match indicates that this fluid is (GENERIC) DIESEL ENGINE OIL SAE 40. Please confirm. Please specify the component make and model with your next sample.

WEAR

All component wear rates are normal.


## CONTAMINATION

There is no indication of any contamination in the oil.

## **FLUID CONDITION**

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0911161	WC0731344	WC0590424
Sample Date		Client Info		19 May 2024	23 Aug 2022	28 Jun 2021
Machine Age	hrs	Client Info		16041	15346	14040
Oil Age	hrs	Client Info		0	0	0
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	Changed	N/A
Filter Changed		Client Info		N/A	Changed	N/A
Sample Status				NORMAL	NORMAL	NORMAL
Iron	ppm	ASTM D5185m	>100	8	8	12
Chromium	ppm	ASTM D5185m	>20	0	<1	<1
Nickel	ppm	ASTM D5185m	>4	0	0	0
Titanium	ppm	ASTM D5185m		0	<1	0
Silver	ppm	ASTM D5185m	>3	0	0	<1
Aluminum	ppm	ASTM D5185m	>20	3	3	2
Lead	ppm	ASTM D5185m	>40	0	0	0
Copper	ppm	ASTM D5185m	>330	<1	<1	<1
Tin	ppm	ASTM D5185m	>15	<1	<1	<1
Vanadium	ppm	ASTM D5185m		0	0	0
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Silicon	ppm	ASTM D5185m	>25	4	4	4
Potassium	ppm	ASTM D5185m	>20	2	2	0
Fuel		WC Method	>5	<1.0	<1.0	<1.0
Water		WC Method	>0.2	NEG	NEG	NEG
Glycol		WC Method	0	NEG	NEG	NEG
Soot %	%	*ASTM D7844	>3	0.1	0.2	0.2
Nitration	Abs/cm	*ASTM D7624	>20	8.7	8.6	9.4
Sulfation	Abs/.1mm	*ASTM D7415	>30	22.1	23.0	21.4
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG	NEG
Sodium	ppm	ASTM D5185m	>216	8	0	4
Boron	ppm	ASTM D5185m	250	323	398	353
Barium	ppm	ASTM D5185m	10	0	0	0
Molybdenum	ppm	ASTM D5185m	100	93	91	121
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m	450	477	379	550
Calcium	ppm	ASTM D5185m	3000	1595	1669	1527
Phosphorus	ppm	ASTM D5185m	1150	1004	1077	718
Zinc	ppm	ASTM D5185m	1350	1274	1339	894
Sulfur	ppm	ASTM D5185m	4250	3700	4302	2379
Oxidation	Abs/.1mm	*ASTM D7414	>25	18.1	18.9	19.8
Base Number (BN)	mg KOH/g	ASTM D2896	8.5	8.0	8.7	8
Visc @ 100°C	cSt	ASTM D2000	14.4	13.8	14.2	14.2
	001	A0 HW D440	14.4	13.0	17.4	1-1.2

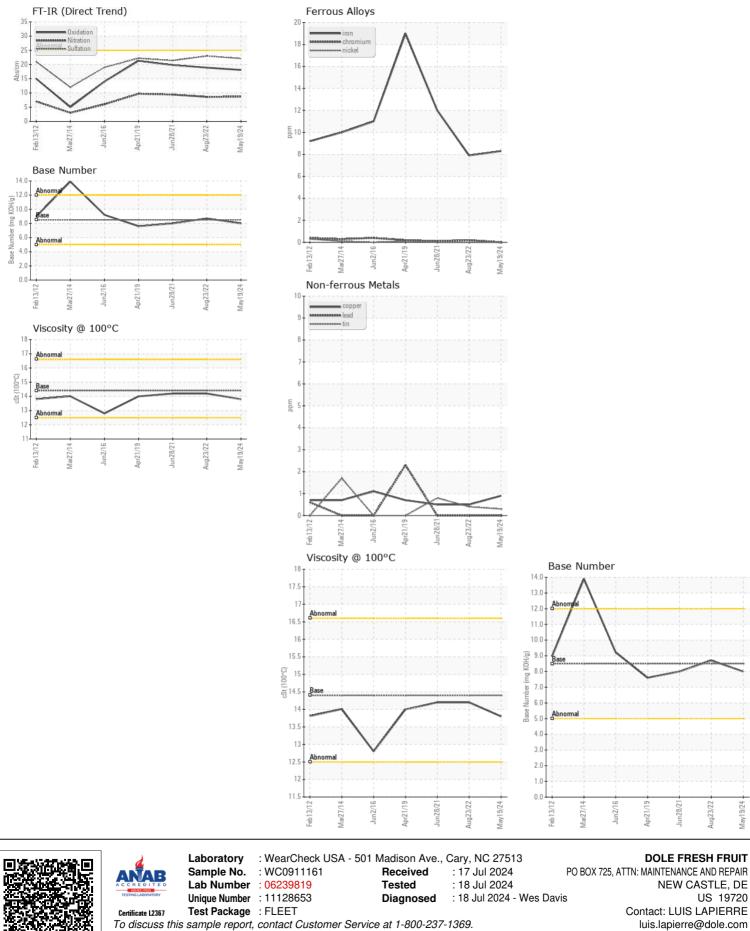

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: LUIS LAPIERRE - DOLWIL Page 2 of 2

T: (302)652-6344

F: (302)652-6061