

Machine Id DFGS272804 Component Diesel Engine Fluid DIESEL ENGINE OIL SAE 15W40 (--- QTS)

Resample at the next service interval to monitor. Please specify the
component make and model with your next sample. Please specify the
brand, type, and viscosity of the oil on your next sample.

.....

W	ΈA	R

All component wear rates are normal.

RECOMMENDATION

CONTAMINATION


There is no indication of any contamination in the oil.

FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0911226	WC0814621	WC0688937
Sample Date		Client Info		20 May 2024	21 May 2023	05 May 2022
Machine Age	hrs	Client Info		18734	0	0
Oil Age	hrs	Client Info		0	0	0
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	Changed	Changed
Filter Changed		Client Info		N/A	Changed	Changed
Sample Status				NORMAL	NORMAL	NORMAL
			100	40	32	10
Iron	ppm	ASTM D5185m ASTM D5185m	>100	12		10
Chromium	ppm		>20	<1	0	<1
Nickel	ppm	ASTM D5185m	>4	0	0	0
Titanium	ppm	ASTM D5185m	0	0	0	<1
Silver	ppm	ASTM D5185m	>3	0	0	0
Aluminum	ppm	ASTM D5185m	>20	7	15	6
Lead	ppm	ASTM D5185m	>40	0	0	0
Copper	ppm	ASTM D5185m	>330	<1	<1	<1
Tin	ppm	ASTM D5185m	>15	<1	0	<1
Vanadium	ppm	ASTM D5185m	NIGNE	0	0	<1
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Silicon	ppm	ASTM D5185m	>25	7	14	6
Potassium	ppm	ASTM D5185m	>20	2	1	1
Fuel	PP	WC Method	>5	- <1.0	<1.0	<1.0
Water		WC Method	>0.2	NEG	NEG	NEG
Glycol		WC Method	/ 012	NEG	NEG	NEG
Soot %	%	*ASTM D7844	>3	0.2	0.1	0.2
Nitration	Abs/cm	*ASTM D7624	>20	8.8	9.1	8.3
Sulfation	Abs/.1mm	*ASTM D7415	>30	22.0	21.9	22.2
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG	NEG
Sodium	ppm	ASTM D5185m	>158	7	37	5
Boron	ppm	ASTM D5185m	250	310	375	436
Barium	ppm	ASTM D5185m	10	0	0	0
Molybdenum	ppm	ASTM D5185m	100	85	87	97
Manganese	ppm	ASTM D5185m		0	0	<1
Magnesium	ppm		450	352	446	423
Calcium	ppm	ASTM D5185m	3000	1628	1674	1482
Phosphorus	ppm	ASTM D5185m	1150	939	1060	1030
Zinc	ppm	ASTM D5185m	1350	1198	1405	1297
Sulfur	ppm	ASTM D5185m	4250	2867	4104	3384
Oxidation	Abs/.1mm	*ASTM D7414	>25	18.4	18.8	18.5
Base Number (BN)	mg KOH/g	ASTM D2896	8.5	7.6	7.7	7.9
Visc @ 100°C	cSt	ASTM D445	14.4	13.7	13.5	14.1

-----,

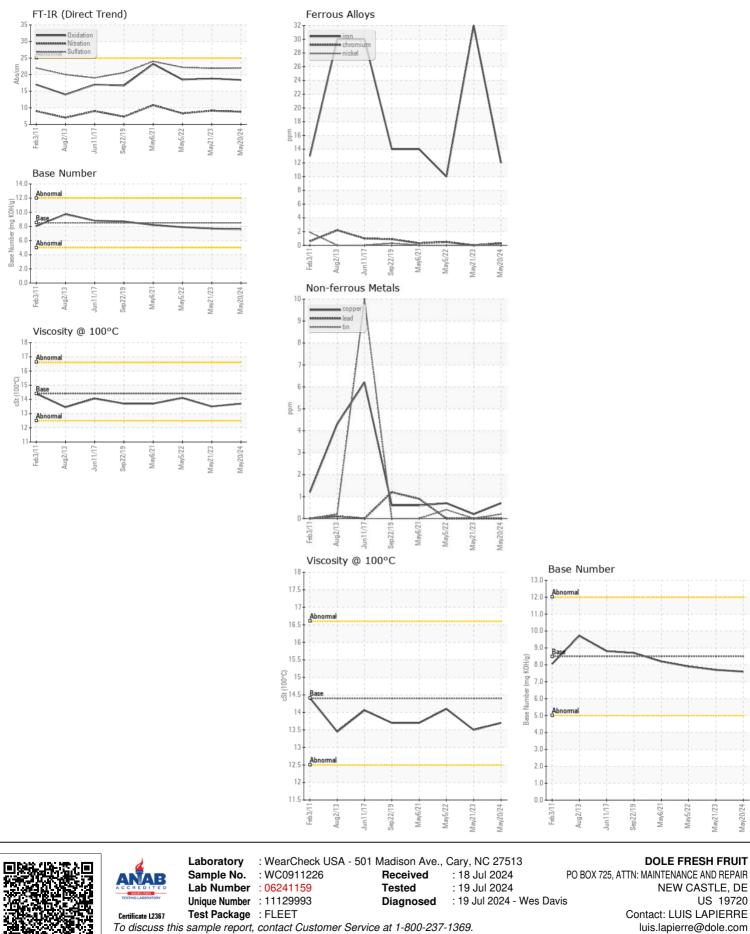

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: LUIS LAPIERRE - DOLWIL Page 2 of 2

T: (302)652-6344

F: (302)652-6061