



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
LIGHT PLANT 1028
 Component
Diesel Engine
 Fluid
DIESEL ENGINE OIL SAE 15W40 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0949294	WC0906148	---
Sample Date		Client Info		01 Jul 2024	06 Mar 2024	---
Machine Age	hrs	Client Info		4883	4882	---
Oil Age	hrs	Client Info		0	0	---
Filter Age	hrs	Client Info		0	0	---
Oil Changed		Client Info		Changed	Changed	---
Filter Changed		Client Info		Changed	Changed	---
Sample Status				NORMAL	ABNORMAL	---

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>100	2	0	---
Chromium	ppm	ASTM D5185m	>20	<1	0	---
Nickel	ppm	ASTM D5185m	>4	0	0	---
Titanium	ppm	ASTM D5185m		0	0	---
Silver	ppm	ASTM D5185m	>3	0	0	---
Aluminum	ppm	ASTM D5185m	>20	2	<1	---
Lead	ppm	ASTM D5185m	>40	0	0	---
Copper	ppm	ASTM D5185m	>330	0	0	---
Tin	ppm	ASTM D5185m	>15	0	0	---
Vanadium	ppm	ASTM D5185m		0	<1	---
White Metal	scalar	*Visual	NONE	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	---

CONTAMINATION












There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	7	14	---
Potassium	ppm	ASTM D5185m	>20	<1	0	---
Fuel		WC Method	>5	<1.0	<1.0	---
Water		WC Method	>0.2	NEG	NEG	---
Glycol		WC Method		NEG	NEG	---
Soot %	%	*ASTM D7844	>3	0.1	0.2	---
Nitration	Abs/cm	*ASTM D7624	>20	4.2	5.4	---
Sulfation	Abs/.1mm	*ASTM D7415	>30	16.9	17.5	---
Silt	scalar	*Visual	NONE	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG	---

FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m	>158	2	0	---
Boron	ppm	ASTM D5185m	250	5	24	---
Barium	ppm	ASTM D5185m	10	0	0	---
Molybdenum	ppm	ASTM D5185m	100	53	42	---
Manganese	ppm	ASTM D5185m		0	0	---
Magnesium	ppm	ASTM D5185m	450	854	605	---
Calcium	ppm	ASTM D5185m	3000	970	974	---
Phosphorus	ppm	ASTM D5185m	1150	906	699	---
Zinc	ppm	ASTM D5185m	1350	1110	841	---
Sulfur	ppm	ASTM D5185m	4250	2744	3072	---
Oxidation	Abs/.1mm	*ASTM D7414	>25	12.6	13.1	---
Base Number (BN)	mg KOH/g	ASTM D2896	8.5	9.2	8.9	---
Visc @ 100°C	cSt	ASTM D445	14.4	15.3	▲ 24.11	---

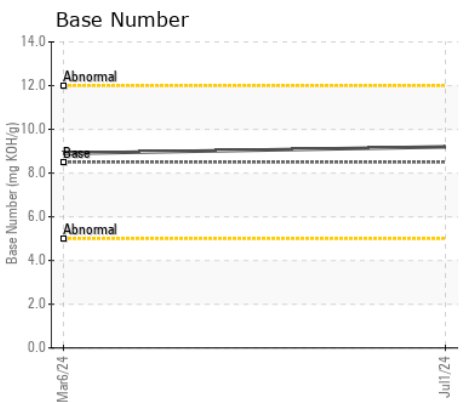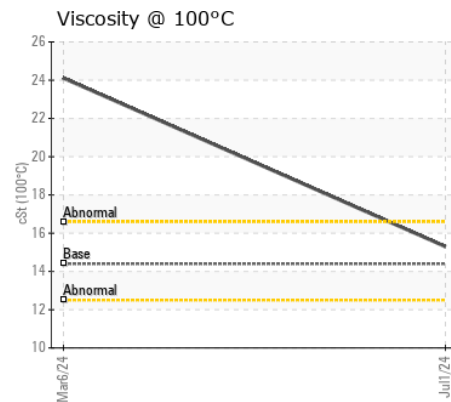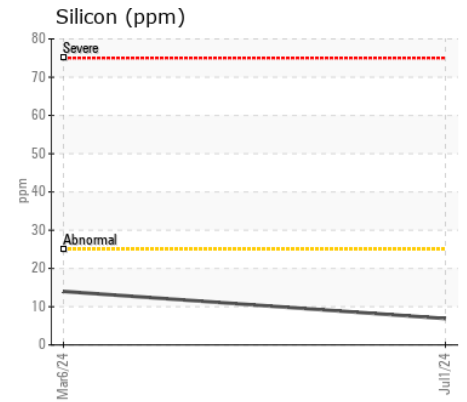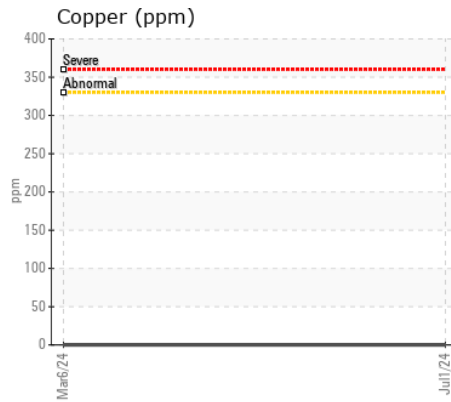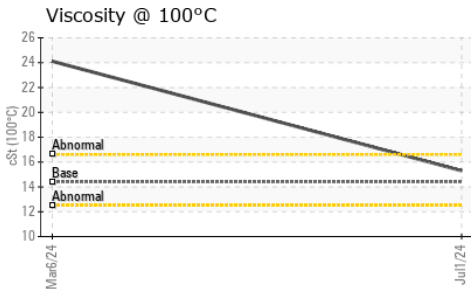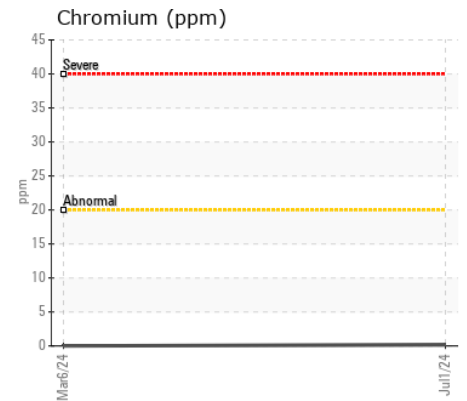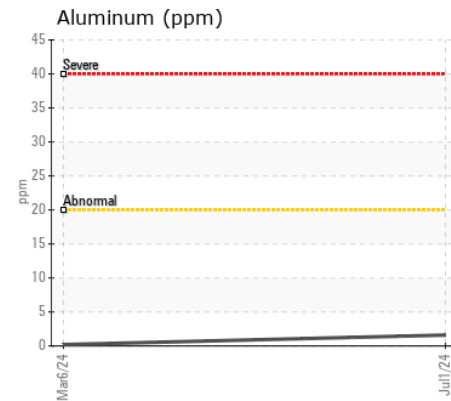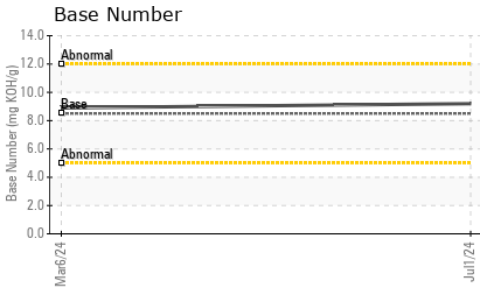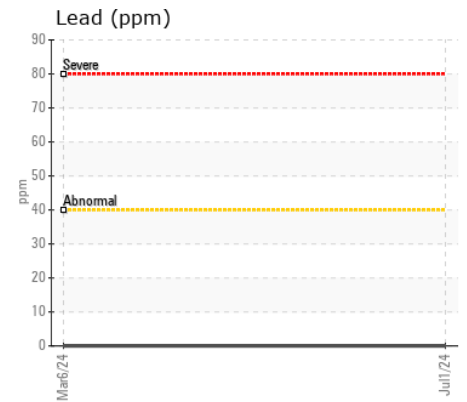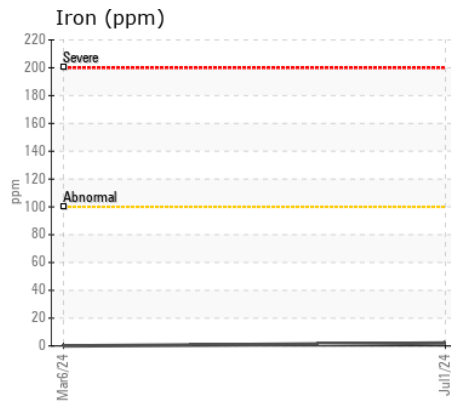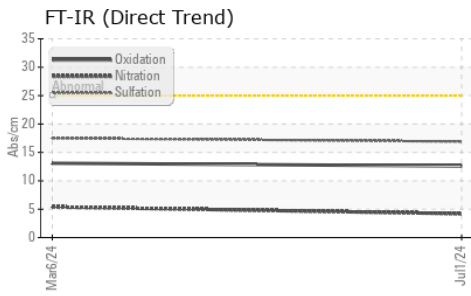

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0949294
Lab Number : 06241391
Unique Number : 11130225
Test Package : MOB 1 (Additional Tests: TBN)

Received : 19 Jul 2024
Tested : 20 Jul 2024
Diagnosed : 20 Jul 2024 - Wes Davis

CONCRETE SERVICE CO - FAY BLOCK
 161 BUILDERS BLVD
 FAYETTEVILLE, NC
 US 28301

Contact: BRYAN VANNIMAN
 bryanvanniman@fayblock.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (800)326-9198

F: