



ANORMAL

NORMAL

ANORMAL

Secteur

[49236]

Identité de la machine

349198-1-1-0712

Composant

Liquide de refroidissement

Fluide

NOT GIVEN (--- GAL)

RECOMMENDATION

We recommend drain system, and refill with 50/50 antifreeze water mixture. We advise that you replenish the supplemental coolant additives (SCAs) and add per manufacturer's specifications. We recommend an early resample to monitor this condition.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Numéro d'échant.		Client Info		CU0021640	---	---
Date d'échant.		Client Info		13 Nov 2023	---	---
Âge d la Machine	hrs	Client Info		0	---	---
Âge de l'huile	hrs	Client Info		0	---	---
Huile changée		Client Info		N/A	---	---
Statut de l'échant.				ABNORMAL	---	---

CORROSION

Copper ppm levels are abnormal. The high metal levels indicate corrosion in the system.

Fer	ppm	ASTM D5185(m)	>15	0	---	---
Aluminium	ppm	ASTM D5185(m)	>10	0	---	---
Cuivre	ppm	ASTM D5185(m)	>10	▲ 45	---	---
Plomb	ppm	ASTM D5185(m)	>10	0	---	---
Étain	ppm	ASTM D5185(m)	>10	0	---	---
Argent	ppm	ASTM D5185(m)	>10	<1	---	---
Zinc	ppm	ASTM D5185(m)	>10	<1	---	---

CONTAMINANTS










There is no indication of any contamination in the coolant.

Calcium	ppm	ASTM D5185(m)	>100	2	---	---
Magnésium	ppm	ASTM D5185(m)	>40	<1	---	---
Apparence	scalar	Visual*	NORML	NORML	---	---
Odeur	scalar	Visual*	NORML	NORML	---	---
Apparence du liquide de refroidissement		Visual*	Clear	Clear	---	---

ÉTAT DU LIQUIDE REFROIDISSEMENT

The nitrite level is acceptable. The pH is low which causes rust formation.

Densité		ASTM D1298*		1.070	---	---
pH	Scale 0-14	ASTM D1287*		▲ 6.73	---	---
Nitrites	ppm	Alcan Test Kit*		1200	---	---
Réserve d'alcalinité	Scale 0-20	ASTM D1121*		2.6	---	---
Pourcentage de glycol	%	ASTM D3321*		52.6	---	---
Point de congélation	°C	ASTM D3321*		-40	---	---
Carboxylate				---	---	---
Silicium	ppm	ASTM D5185(m)		31	---	---
Phosphore	ppm	ASTM D5185(m)		21	---	---
Bore	ppm	ASTM D5185(m)		637	---	---
Molybdène	ppm	ASTM D5185(m)		25	---	---
Sodium	ppm	ASTM D5185(m)		10027	---	---
Potassium	ppm	ASTM D5185(m)		206	---	---
Couleur du liquide de refroidissement		Visual*		Green	---	---

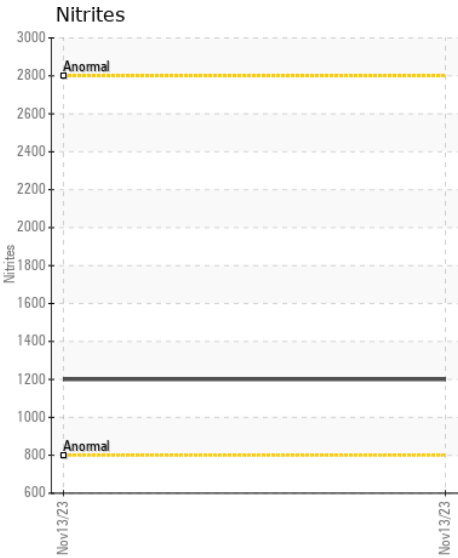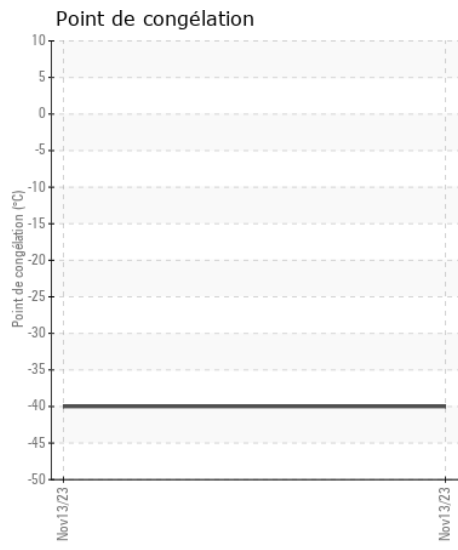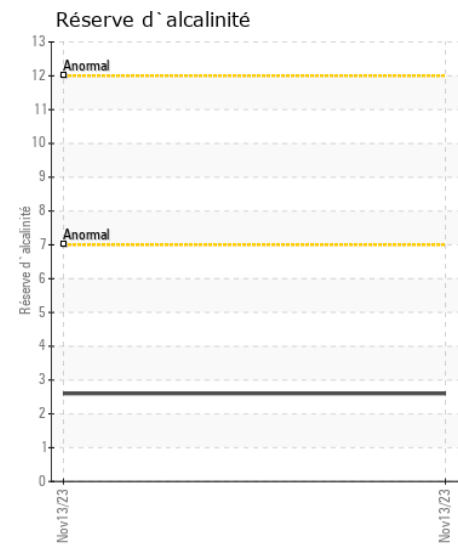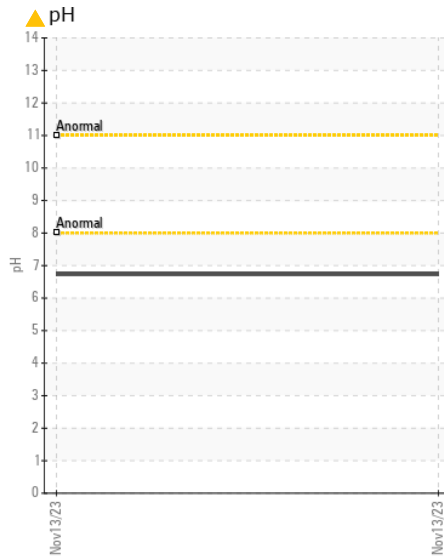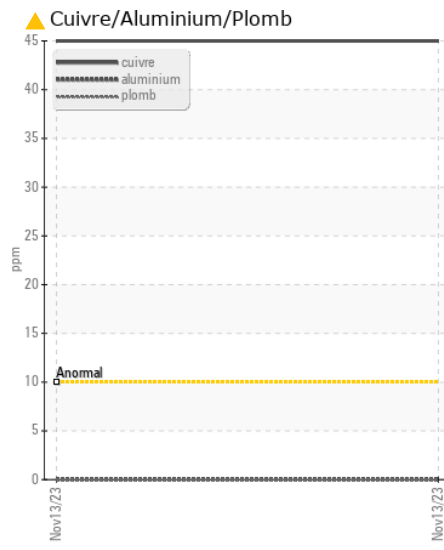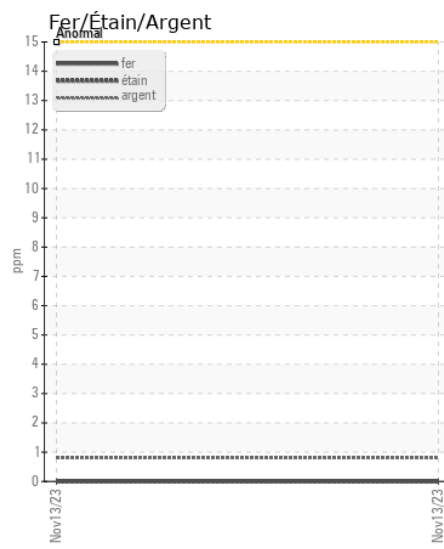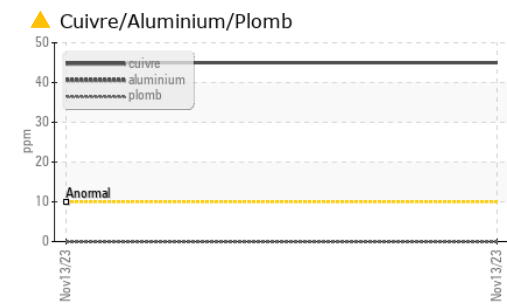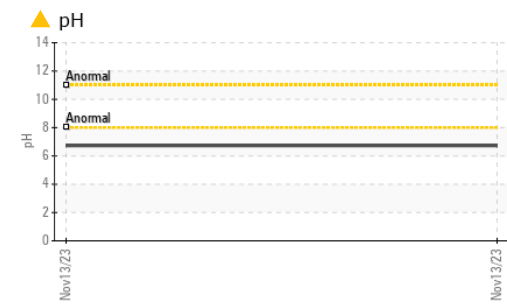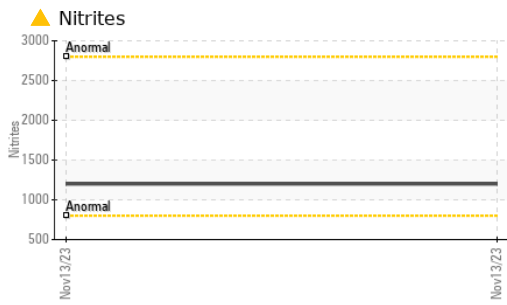

Laboratoire : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
N° d'échantillon : CU0021640
N° de laboratoire : 02596419
Numéro unique : 5681499
Analyse : COOL
Reçu : 14 Nov 2023
Diagnostiqué : 15 Nov 2023
Diagnostiqueur : Kevin Marson

CUMMINS EASTERN CANADA INC.
 122 CLYDE AVENUE
 MOUNT PEARL, NL
 CA A1N 4S3
 Contact: DARRYL CAREY
 DARRYL.CAREY@CUMMINS.COM
 T: (709)747-1135
 F: (709)747-1084

Pour discuter ce rapport, contacter le service à la clientèle au 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 La validez de los resultados y la interpretación se basan en la muestra y la información proporcionada.