



RAPPORT D'ANALYSE D'HUILE

USURE	NORMAL
CONTAMINATION	NORMAL
ÉTAT DU FLUIDE	NORMAL

Secteur

HEXO [101785]

Identité de la machine

80101463 - G5

Composant

Moteur diesel

Fluide

VALVOLINE 15W40 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Numéro d'échant.		Client Info		CU0021048	CU0019787	CU0018067
Date d'échant.		Client Info		20 Nov 2023	08 Dec 2022	07 Dec 2021
Âge d la Machine	hrs	Client Info		335	534	0
Âge de l'huile	hrs	Client Info		0	0	0
Âge du filtre	hrs	Client Info		0	0	0
Huile changée		Client Info		N/A	Changed	Changed
Filtre changé		Client Info		N/A	Changed	Changed
Statut de l'échant.				NORMAL	NORMAL	ABNORMAL

USURE

Metal levels are typical for a new component breaking in.

Fer	ppm	ASTM D5185(m)	>90	2	2	4
Chrome	ppm	ASTM D5185(m)	>20	0	0	<1
Nickel	ppm	ASTM D5185(m)	>2	0	0	<1
Titane	ppm	ASTM D5185(m)	>2	0	<1	0
Argent	ppm	ASTM D5185(m)	>2	<1	0	0
Aluminium	ppm	ASTM D5185(m)	>20	1	1	1
Plomb	ppm	ASTM D5185(m)	>40	<1	0	<1
Cuivre	ppm	ASTM D5185(m)	>330	<1	<1	2
Étain	ppm	ASTM D5185(m)	>15	0	0	<1
Vanadium	ppm	ASTM D5185(m)		0	0	0

CONTAMINATION










There is no indication of any contamination in the oil.

Silicium	ppm	ASTM D5185(m)	>25	7	7	14
Potassium	ppm	ASTM D5185(m)	>20	0	0	1
Essence		WC Method	>3.0	<1.0	<1.0	0.7
L'eau		WC Method	>0.2	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
% de suie	%	ASTM D7844*	>6	0	0	0
Nitration	Abs/cm	ASTM D7624*	>20	6.3	6.7	5.6
Sulfatation	Abs/.1mm	ASTM D7415*	>30	20.5	21.7	20.4
Eau émulsifiée	scalar	Visual*	>0.2	NEG	NEG	NEG

ÉTAT DU FLUIDE

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)		3	3	2
Bore	ppm	ASTM D5185(m)	39	39	50	111
Baryum	ppm	ASTM D5185(m)	1	0	0	<1
Molybdène	ppm	ASTM D5185(m)	49	45	46	60
Manganèse	ppm	ASTM D5185(m)	1	0	<1	<1
Magnésium	ppm	ASTM D5185(m)	616	784	808	1105
Calcium	ppm	ASTM D5185(m)	1554	1122	1139	973
Phosphore	ppm	ASTM D5185(m)	899	678	774	1079
Zinc	ppm	ASTM D5185(m)	1069	804	804	1210
Soufre	ppm	ASTM D5185(m)	2624	1889	2035	2904
Oxydation	Abs/.1mm	ASTM D7414*	>25	16.8	17.5	14.8
Visc 100°C	cSt	ASTM D7279(m)	13.6	15.0	13.8	▲ 11.6

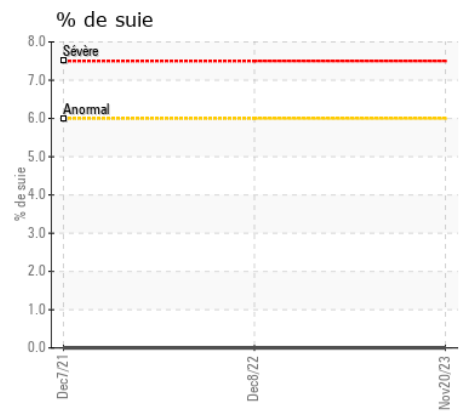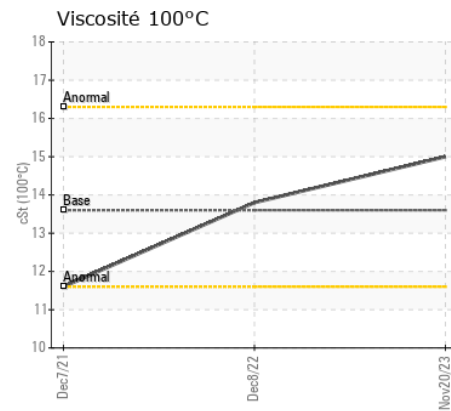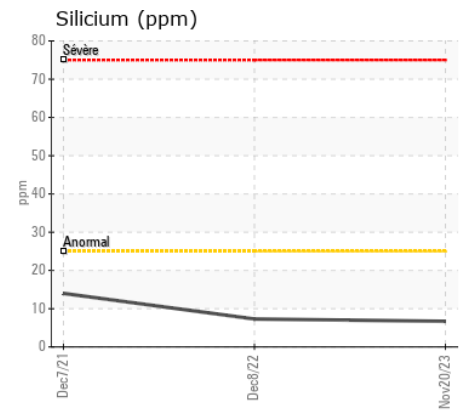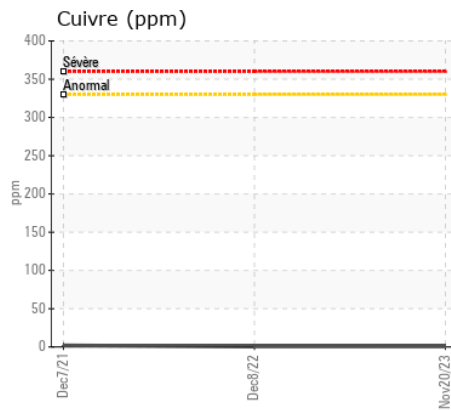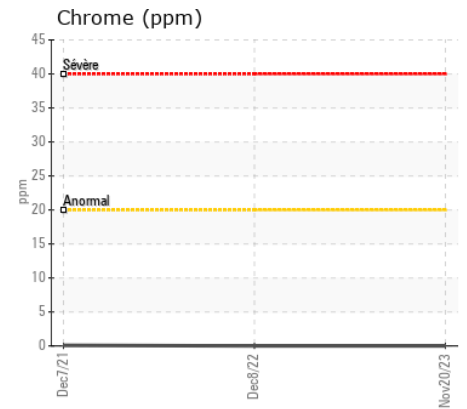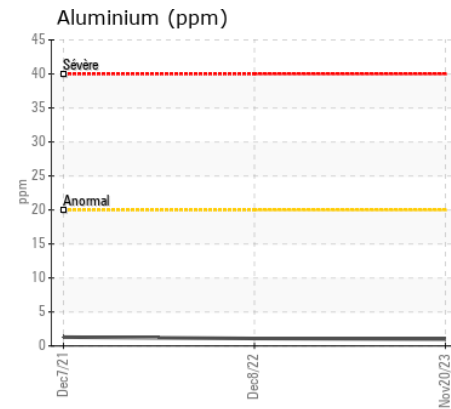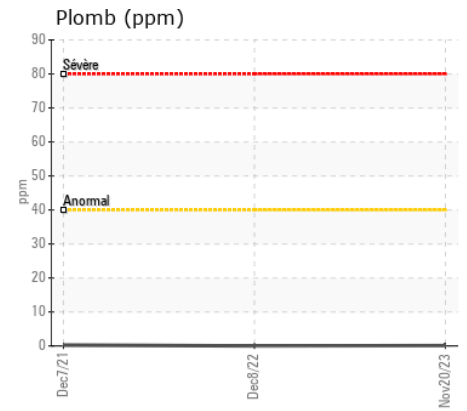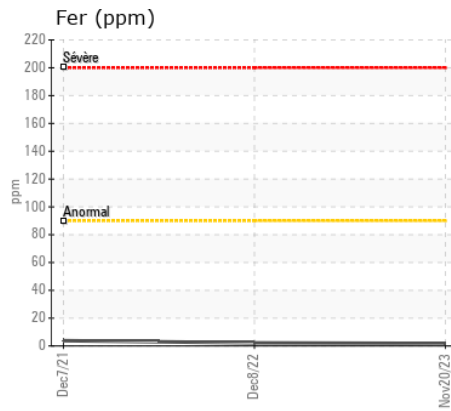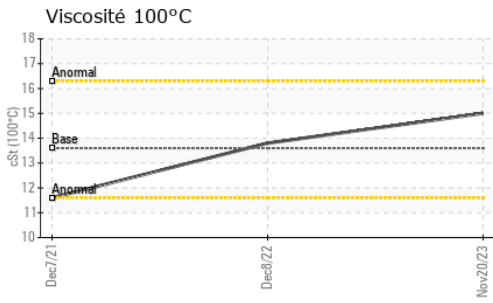

Laboratoire : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
N° d'échantillon : CU0021048
N° de laboratoire : 02598716
Numéro unique : 5683796
Analyse : MOB 1

CUMMINS EASTERN CANADA LP
 3189 SWANSEA CRESCENT
 OTTAWA, ON
 CA K1G 3W5
 Contact: Cindy Harrison
 cindy.harrison@cummins.com
 T: (613)736-1146
 F: x:

Pour discuter ce rapport, contacter le service à la clientèle au 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 La validez de los resultados y la interpretación se basan en la muestra y la información proporcionada.