




[KEYERA BRAZEAU RIVER GAS PLANT / 3-12-46-14W5] PLANT 1


Customer: PTRHTF30084	System Information	Sample Information
Keyera Partnership Brazeau River Ga... Box 7318 Drayton Valley, AB T7A 1S5 Canada Attn: Ken Bouchard Tel: (780)894-3601 E-Mail: ken_bouchard@keyera.com	System Volume: 14000 ltr Bulk Operating Temp: 446F / 230C Heating Source: Blanket: Fluid: PETRO CANADA PETRO-THERM Make: IAP HEATER	Lab No: 02165140 Analyst: Kevin McDermott Sample Date: 08/10/17 Received Date: 08/22/17 Completed: 08/25/17 Kevin McDermott kevin.mcdermott@hollyfrontier.com

Recommendation: Fluid remains in very good condition. Very little change from the June 2015 sample. Suggest annual sample submission to proactively monitor fluid condition.

Comments:

Sample Date	Received Date	Fluid Age	Sample Location	Flash Point (COC)	Water (KF)	Viscosity (40°C)	Acid Number	Solids	GCD 10%	GCD 50%	GCD 90%	GCD % < 335°C
	mm/dd/yy			°F/°C	ppm	cSt	mg/KOH/g	%wt	°F/°C	°F/°C	°F/°C	%
08/10/17	08/22/17	2.0m	AT THE PUMP	403 / 206	4.2	30.3	0.013	0.021	687 / 364	801 / 427	904 / 485	4.56
06/30/15	07/07/15	4.0m	AFT SLIPSTREAM FILTR	392 / 200	50.6	34.8	0.06	0.029	698 / 370	812 / 433	903 / 484	3.48
Baseline Data				433 / 223		34.2	0.03		720 / 382	817 / 436	900 / 482	1.00

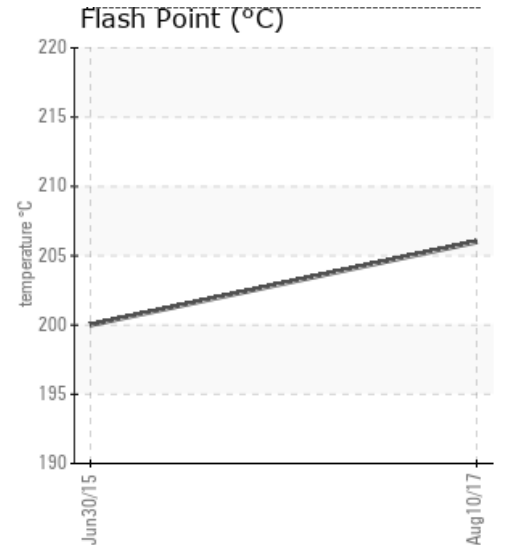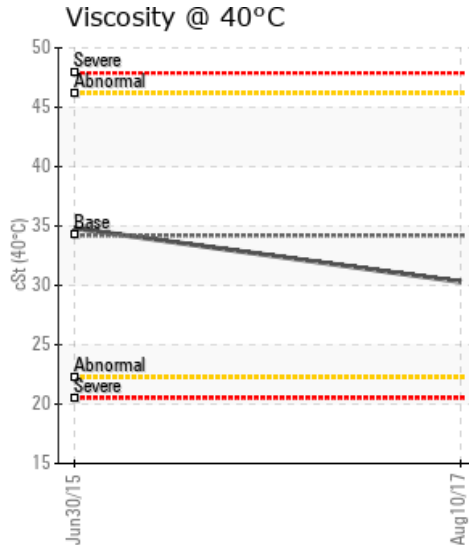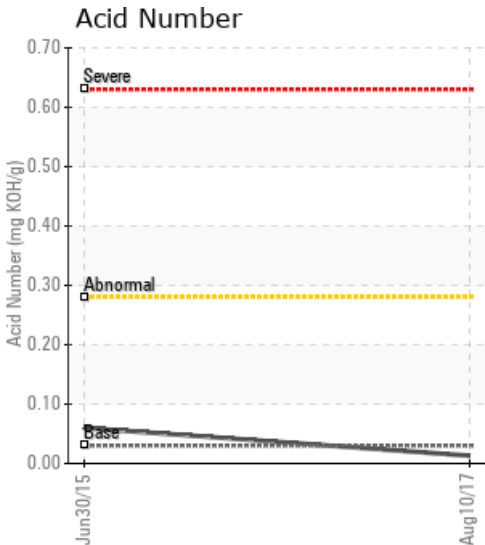


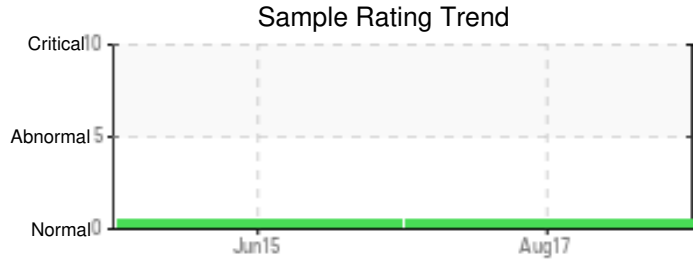


Sample Date	Iron	Chromium	Nickel	Aluminum	Copper	Lead	Tin	Cadmium	Silver	Vanadium	Silicon	Sodium	Potassium	Titanium	Molybdenum	Antimony	Manganese	Lithium	Boron	Magnesium	Calcium	Barium	Phosphorus	Zinc
08/10/17	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
06/30/15	2	0	0	0	0	0	0	0	0	0	0	4	0	0	0	0	0	0	0	0	0	0	0	0
Baseline Data			0	0						0			0	0					0				0	

Elemental analysis results (above) in parts per million (ppm). [10,000 ppm = 1.0%]


GCD Spectrum

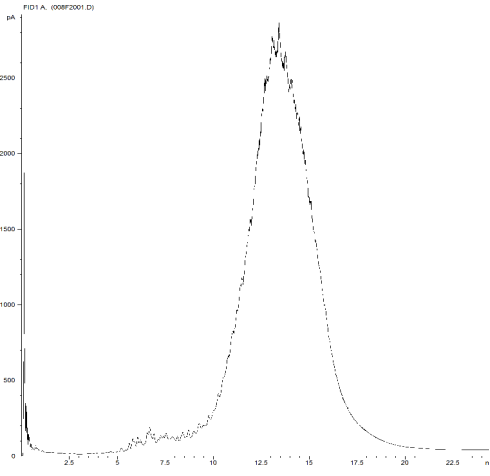

Gas Chromatography Distillation

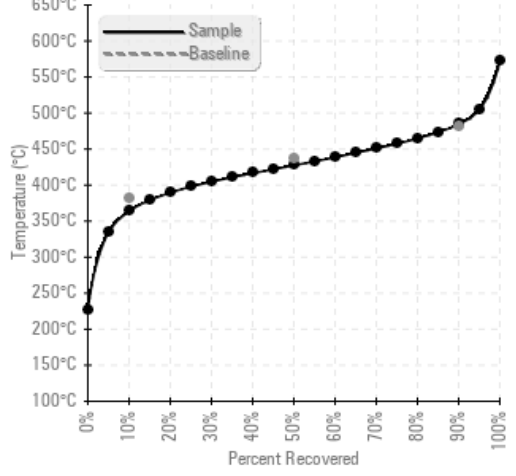

% Boiling < 335°C

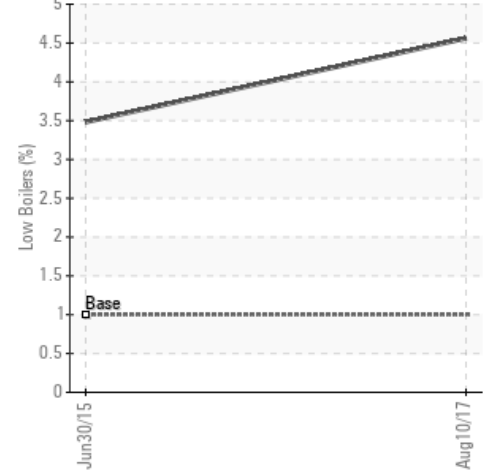

Historical Comments	
06/30/15	Fluid is in excellent condition. Resample in 6 months to begin developing a fluid condition trend. Be sure to use Customer Number PTRHTF30084 on the sample submission form to ensure future samples can be linked up to previous sample history.

Petro-Canada makes no representation or warranty of any kind, either express or implied, as to the accuracy or completeness of the analysis and assumes no responsibility and shall have no liability whatsoever with respect to such analysis, or a party's use of it. Petro-Canada is a division of HollyFrontier Corporation.