




VTA HOT OIL PUMP



Customer: PTRHTF10004	System Information	Sample Information
ADM VITAMIN E PLANT 3700 EAST DIVISION STREET DECATUR, IL 62526 USA Attn: Rick Cluck Tel: (217)451-7770 E-Mail: ricky.cluck@adm.com	System Volume: 1800 gal Bulk Operating Temp: 650F / 343C Heating Source: Blanket: Fluid: PETRO CANADA PURITY FG HEAT TRANSFER FLUID Make: AMERICAN HEATING	Lab No: 02189492 Analyst: Joe Goecke Sample Date: 12/14/17 Received Date: 12/21/17 Completed: 01/19/18 To discuss this report contact Joe Goecke at (859)543-0092

Recommendation: This system should be changed as soon as possible. Low boilers are high flash point and viscosity are very low. The sample rating should be a 10 but cannot be changed by my system.

Comments: (GCD) 10% Distillation Point is severely low. COC Flash Point is severely low. Visc @ 40°C is severely low. (GCD) % < 335°C is abnormally high.



Sample Date	Received Date	Fluid Age	Sample Location	Flash Point (COC)	Water (KF)	Viscosity (40°C)	Acid Number	Solids	GCD 10%	GCD 50%	GCD 90%	GCD % < 335°C
	mm/dd/yy			°F/°C	ppm	cSt	mg/KOH/g	%wt	°F/°C	°F/°C	°F/°C	%
12/14/17	12/21/17	0m		252 / 122	0.00	17.2	0.067	0.024	539 / 282	782 / 417	893 / 478	16.12
09/14/17	09/21/17	0m	B4 HOT OIL PUMP	270 / 132	4.7	21.1	0.01	0.030	547 / 286	781 / 416	890 / 477	15.19
06/13/17	06/19/17	18m	VTA EAST HOT OIL PMP	349 / 176	5.4	26.3	0.285	0.015	657 / 347	797 / 425	899 / 482	7.88
05/22/17	05/26/17	0m	VTA EAST PUMP	352 / 178	0.00	26.0	0.279	0.032	656 / 347	800 / 427	900 / 482	7.90
03/13/17	03/16/17	0m	B4 HOT OIL PUMP	327 / 164	9.8	22.6	0.237	0.029	699 / 370	802 / 428	900 / 482	3.24
12/13/16	12/19/16	1m	B4 HOT OIL PUMP	270 / 132	0.00	20.3	0.067	0.049	537 / 281	778 / 415	910 / 488	16.79
Baseline Data				459 / 237		37.12	0.90		721 / 383	807 / 431	892 / 478	1.5

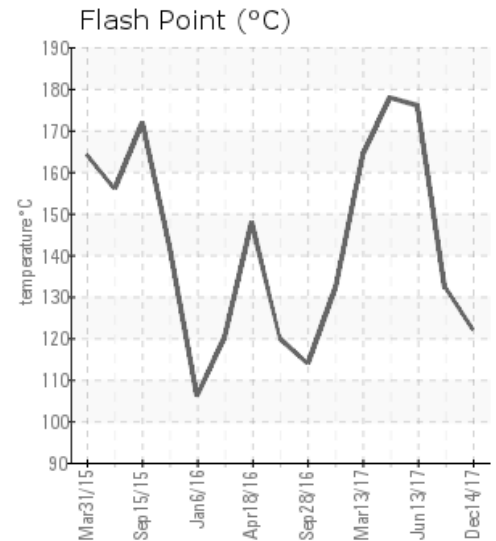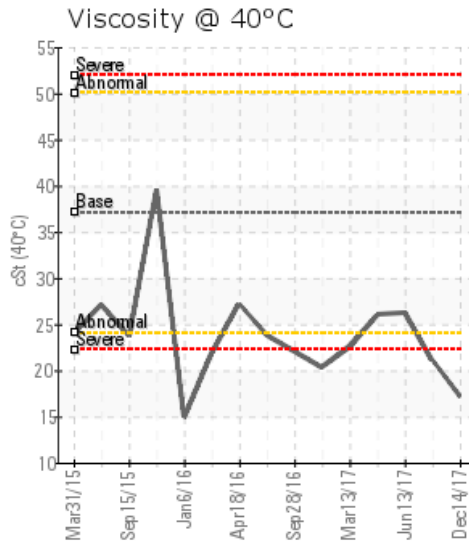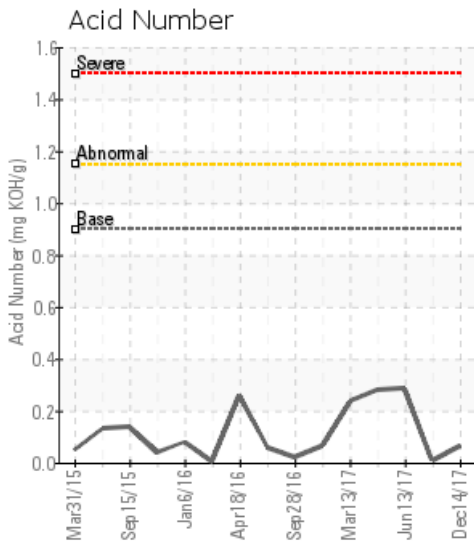

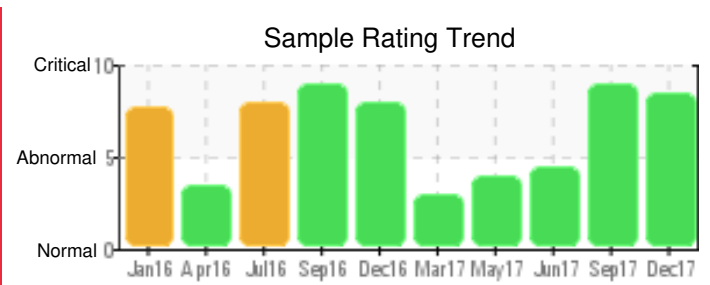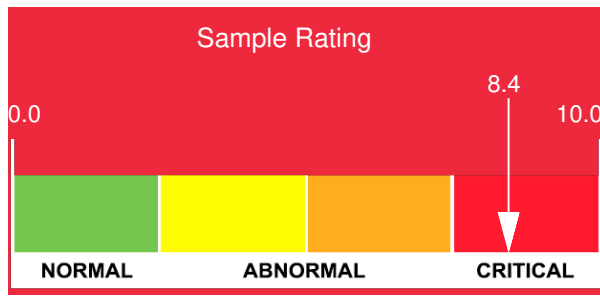

Sample Date	Iron	Chromium	Nickel	Aluminum	Copper	Lead	Tin	Cadmium	Silver	Vanadium	Silicon	Sodium	Potassium	Titanium	Molybdenum	Antimony	Manganese	Lithium	Boron	Magnesium	Calcium	Barium	Phosphorus	Zinc
12/14/17	0	0	0	0	0	0	1	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	56	0
09/14/17	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	52	1
06/13/17	1	0	0	0	0	0	1	0	0	0	1	0	0	0	0	0	0	0	2	0	0	0	54	0
05/22/17	1	0	0	0	0	0	1	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	51	0
03/13/17	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	36	0
12/13/16	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	27	0
Baseline Data			0	0						0			0	0					0				230	

Elemental analysis results (above) in parts per million (ppm). [10,000 ppm = 1.0%]

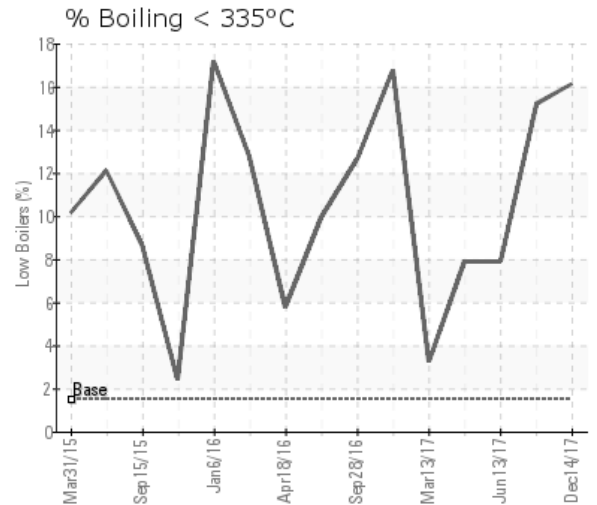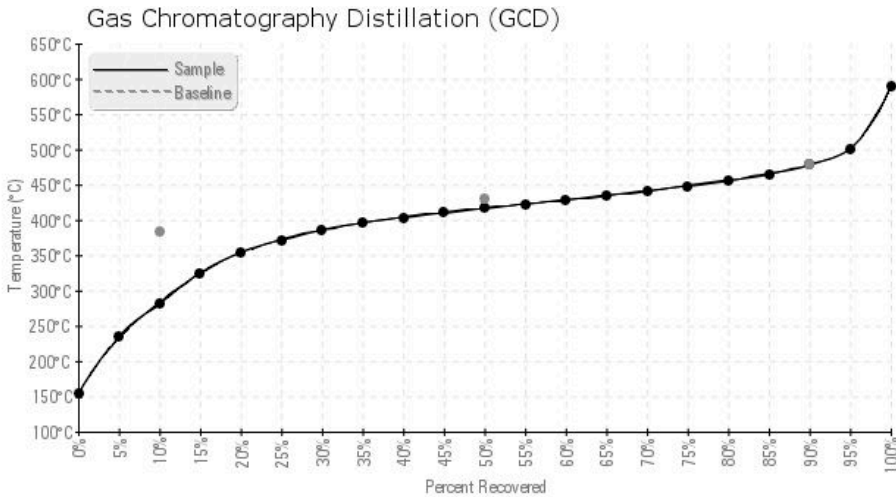

Historical Comments	
09/14/17	System needs to be scheduled to be changed. Viscosity @ 40 C is below 22, Flash point dropped 40 degrees C from 3 months ago and Low boilers have increased to 15%. Since these cannot be vented the system need to be changed to improve heat transfer and safe operating properties. (GCD) 10% Distillation Point is severely low. COC Flash Point is severely low. Visc @ 40°C is severely low. (GCD) % < 335°C is abnormally high.
06/13/17	Sample results very similar to last sample. Flash point marginally lower. Light ends unchanged. Viscosity slightly higher Suggest resample in about 45-60 days COC Flash Point is severely low. (GCD) % < 335°C is marginally high. (GCD) 10% Distillation Point is marginally low.
05/22/17	Viscosity is low but higher than last sample, COC flash is also slightly higher than last sample, Acid number increased slightly, low boilers have doubled and passed the 7% threshold, and the GCD 10% distillation is dropping. We recommend resampling in 3 months and prepare for change later this year based on low boiler rise. COC Flash Point is abnormally low. (GCD) % < 335°C is marginally high. (GCD) 10% Distillation Point is marginally low.
03/13/17	Viscosity at 40 is low, but low boilers is also low at 3.24% and flash point although low is higher than the past 5 samples. Everything else looks normal. Resample at next quarter or 60 days due to the low viscosity. COC Flash Point is severely low. Visc @ 40°C is abnormally low.
12/13/16	Viscosity is very low due to low boilers, and has dropped flash point to 132 C. GCD% <335 is high at 16.79 and suggest changing fluid within the next month as venting is not possible. This sample should also be reported on the VTA H.O. PUMP sheet I believe. COC Flash Point is severely high. (GCD) 50% Distillation Point and (gcd) initial boiling point are abnormal.

Petro-Canada makes no representation or warranty of any kind, either express or implied, as to the accuracy or completeness of the analysis and assumes no responsibility and shall have no liability whatsoever with respect to such analysis, or a party's use of it. Petro-Canada is a division of HollyFrontier Corporation.