

MAIN BOILER - SYSTEM

Customer: PTRHTF30025

MANCUSO CHEMICALS 5725 PROGRESS STREET NIAGARA FALLS, ON L2E 6X8 CANADA

Attn: BOB PATEL Tel: (905)357-3626

E-Mail: bpatel@mancusochemicals.com

System Information

System Volume: 3280 ltr

Bulk Operating Temp: 500F / 260C

Heating Source:

Blanket:

Fluid: PETRO CANADA CALFLO AF

Make: ARIZONA BOILER CO

Sample Information


Lab No: 02189826 Analyst: Adam Koscielak Sample Date: 09/15/17 Received Date: 12/22/17 Completed: 01/04/18


To discuss this report contact Adam

Koscielak at 905-331-1323

Recommendation: This system sample taken on September 15th is suitable for continued service. While there is insoluble present in the sample, this sample indicates the solids level is still acceptable for continued use. Gas Chromatographic data indicates the Calflo AF is in good condition with no indication of light boilers present. Wear metals are low in concentration. Physical properties of the Calflo heat transfer oil are suitable for continued service.

Comments:

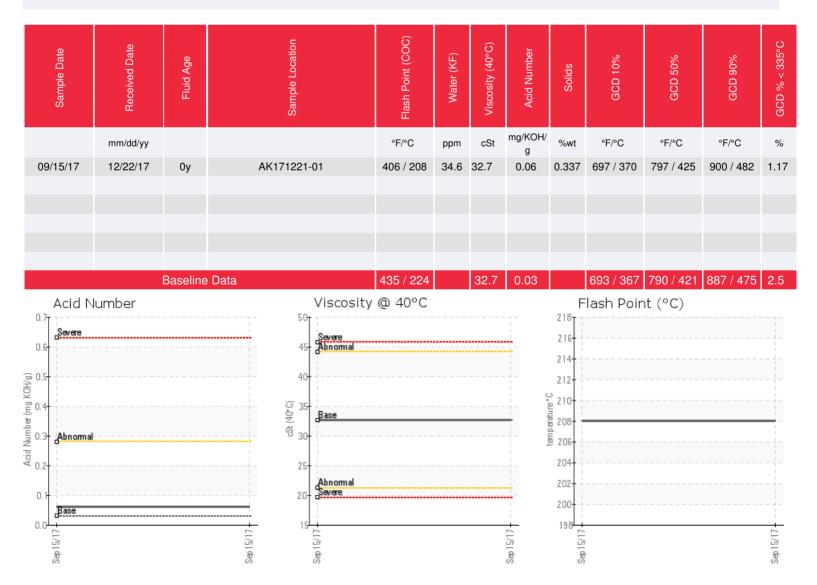

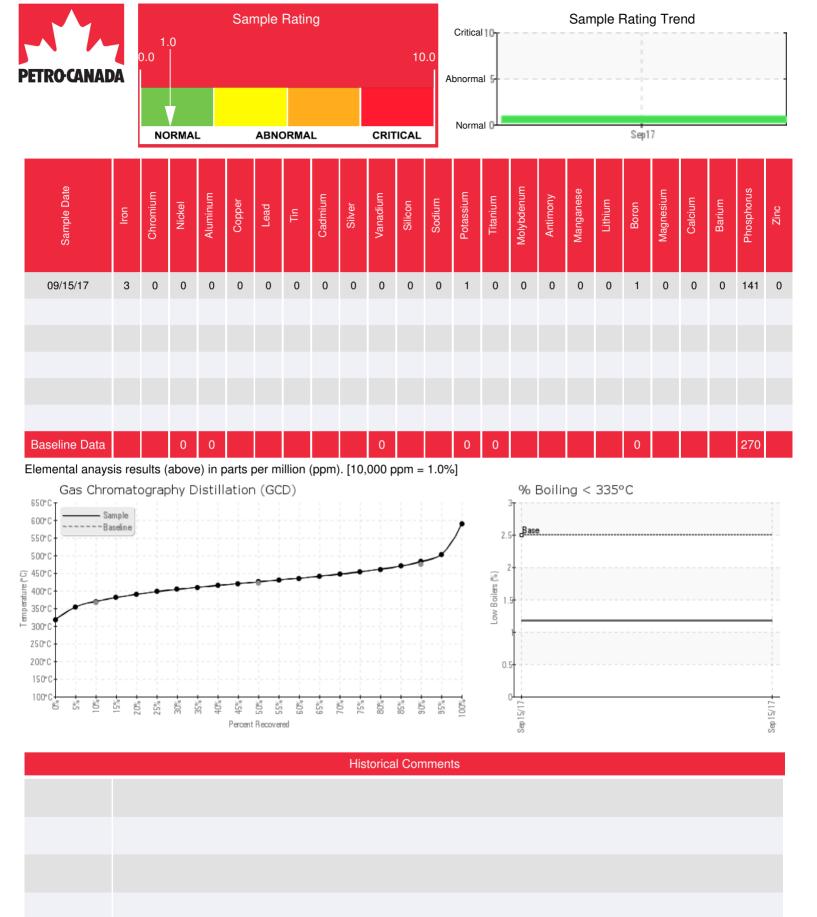

Petro-Canada makes no representation or warranty of any kind, either express or implied, as to the accuracy or completeness of the analysis and assumes no responsibility and shall have no liability whatsoever with respect to such analysis, or a party's use of it. Petro-Canada is a division of HollyFrontier Corporation.