




PM #1 STACK HOT OIL SYSTEM



Customer: PTRHTF30073	System Information	Sample Information
IRVING PAPER LTD 435 BAYSIDE DRIVE SAINT JOHN, NB E2L 4K9 Canada Attn: Terry Tomney Tel: (506)650-8435 E-Mail: tomney.terry@irvingpaper.com	System Volume: 3500 ltr Bulk Operating Temp: 536F / 280C Heating Source: Blanket: Fluid: PETRO CANADA PETRO-THERM Make: METSO	Lab No: 02233913 Analyst: Claude Bureau Sample Date: 08/09/18 Received Date: 08/15/18 Completed: 09/12/18 To discuss this report contact Claude Bureau at (438)863-7577

Recommendation: Small amount of water detected. All distillation variances comes from the presence of residual Therminol 66 in the system. A complete drain of the load is required to eliminate residual Therminol 66 affects. The COC Flash Point is marginally low but not alarming. This results is clearly a sign of a presence of light ends in the oil. The oil must be vented in order to remove these light ends. As reported before, this system previously had Therminol 66 and is still present in the system, which has affected some of the distillation results. Compared to the previous samples, this oil is in good condition and suitable for further service. In order to follow the venting process please submit another sample after the venting cycle to re-evaluate the condition of the oil.

Comments: No wear metals detected. Small amount of water detected at 49.7PPM. (GCD) 50% Distillation Point is severely low. (GCD) 90% Distillation Point is severely low. (GCD) 10% Distillation Point is abnormally low. (GCD) % < 335°C is marginally high. COC Flash Point is marginally low (185°C). All distillation variances comes from the presence of residual Therminol 66 in the system.

Sample Date	Received Date	Fluid Age	Sample Location	Flash Point (COC)	Water (KF)	Viscosity (40°C)	Acid Number	Solids	GCD 10%	GCD 50%	GCD 90%	GCD % < 335°C
	mm/dd/yy			°F/°C	ppm	cSt	mg/KOH/g	%wt	°F/°C	°F/°C	°F/°C	%
08/09/18	08/15/18	5y	MANIFOLD FROM SYS	365 / 185	49.7	26.3	0.020	0.009	634 / 334	662 / 350	830 / 443	10.49
11/29/17	12/05/17	584y		381 / 194	56.4	26.5	0.008	0.035	634 / 334	667 / 353	869 / 465	10.47
04/19/17	04/21/17	4y	MANIFOLD FROM SYSTEM	378 / 192	45.2	26.6	0.024	0.071	633 / 334	668 / 354	831 / 444	10.70
02/09/17	02/16/17	4y	MANIFOLD FROM SYSTEM	374 / 190	40.4	26.5	0.01	0.061	633 / 334	665 / 352	838 / 448	10.84
08/17/16	08/22/16	3y	MANIFOLD FROM SYSTEM	369 / 187	74.4	25.3	0.02	0.043	632 / 334	663 / 350	816 / 435	11.36
04/08/16	04/15/16	3y	MANIFOLD FROM SYSTEM	392 / 200	47.4	26.5	0.07	0.033	632 / 333	664 / 351	839 / 449	12.25
Baseline Data				433 / 223		34.2	0.03		720 / 382	817 / 436	900 / 482	1.00

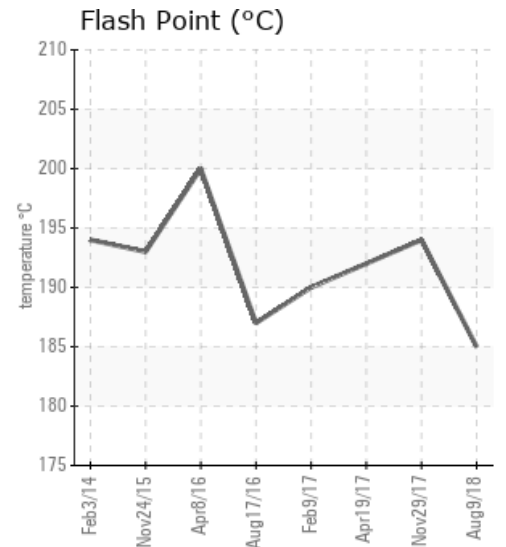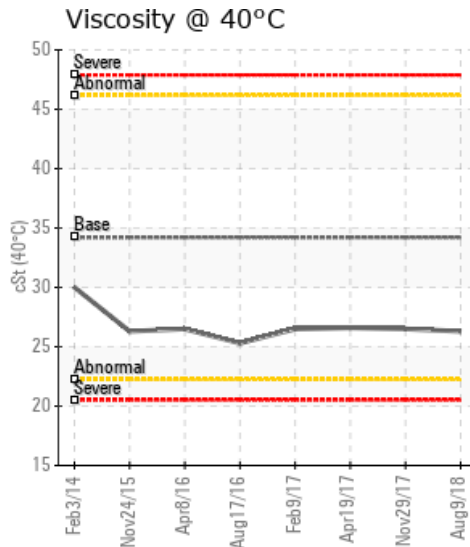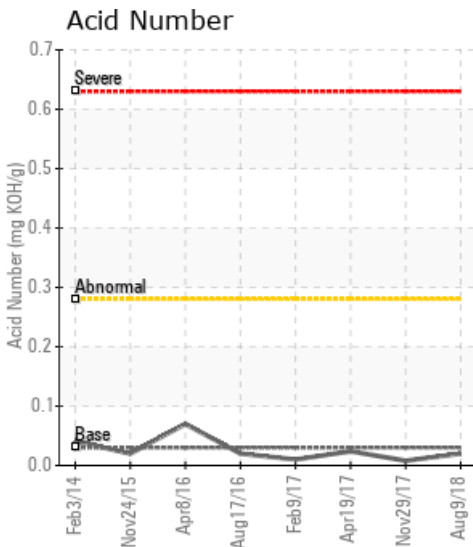


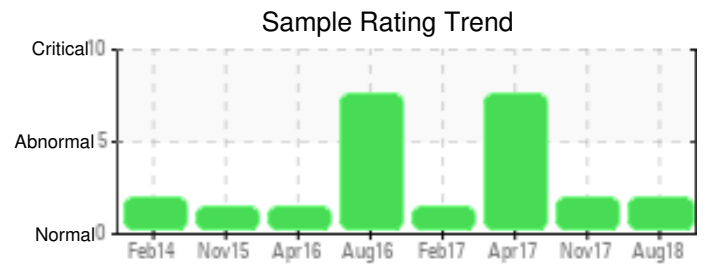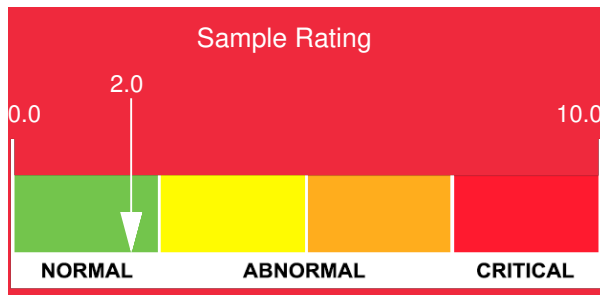


Sample Date	Iron	Chromium	Nickel	Aluminum	Copper	Lead	Tin	Cadmium	Silver	Vanadium	Silicon	Sodium	Potassium	Titanium	Molybdenum	Antimony	Manganese	Lithium	Boron	Magnesium	Calcium	Barium	Phosphorus	Zinc
08/09/18	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
11/29/17	0	0	0	0	0	0	1	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0
04/19/17	0	0	0	0	0	0	1	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0
02/09/17	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0
08/17/16	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0
04/08/16	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0
Baseline Data			0	0						0			0	0					0				0	

Elemental analysis results (above) in parts per million (ppm). [10,000 ppm = 1.0%]

Gas Chromatography Distillation (GCD)

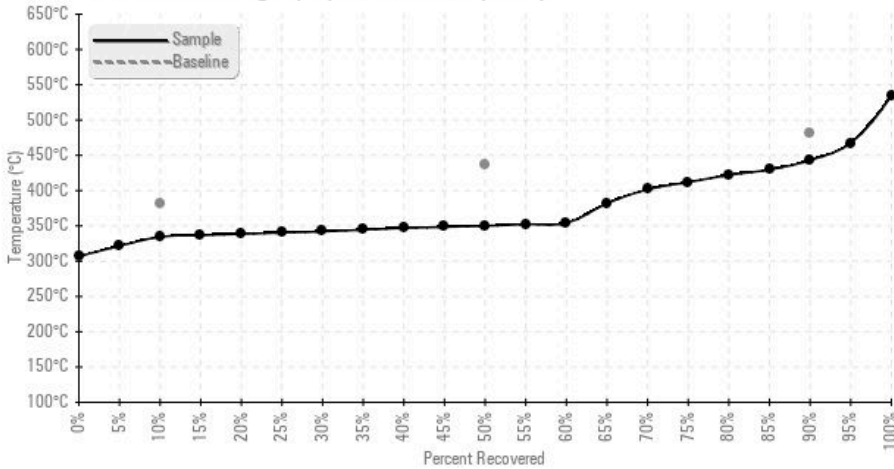

% Boiling < 335°C

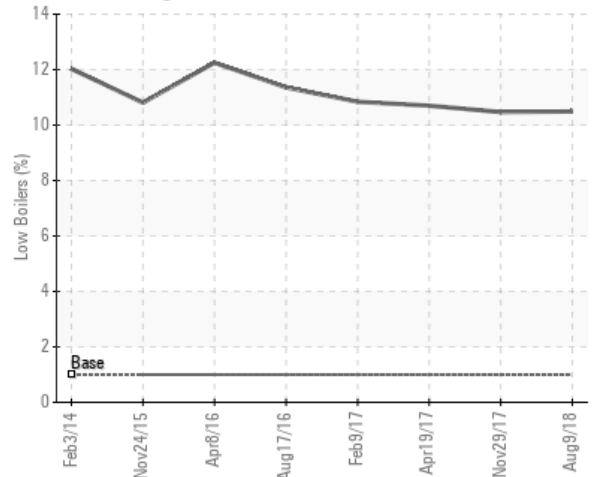

Historical Comments

11/29/17	As reported before, this system previously had Therminol 66 and is still present in the system which has affected some of the distillation results. Compared to the previous samples, this oil is in good condition and suitable for further service. I would suggest that another sample be obtained in 6-9 months to monitor the condition of this oil. All distillation variances come from the presence of residual Therminol 66 in the system. The COC Flash Point is marginally low but not alarming. A complete drain of the load is required to eliminate residual Therminol 66 affects. Nothing to report concerning wear The heat transfer system seems to still contain a certain amount of Therminol 66 HTF which affects the GCD (gas chromatography distillation) results. (GCD) 50% Distillation Point is lower than typical. (GCD) 90% Distillation Point is severely lower than typical. (GCD) 10% Distillation Point is lower than typical. (GCD) % < 335°C is high than typical. COC Flash Point is marginally low.
04/19/17	As reported before, this system previously had Therminol 66 and is still present in the system which has affected some of the distillation results. Compared to the previous samples, this oil is in good condition and suitable for further service. I would suggest that another sample be obtained in 6-9 months to monitor the condition of this oil. GCD 10% Distillation Point is abnormally low, GCD 50% Distillation Point is severely low, GCD 90% Distillation Point is severely low. GCD % < 335°C is abnormally high. COC Flash Point is marginally low. All distillation variances come from presence of residual Therminol 66 in the system. A complete drain of the load is required to eliminate residual Therminol 66. If Therminol 66 does not affect the performance of the heat transfer then no drain is required. (GCD) 50% Distillation Point is severely low. (GCD) 90% Distillation Point is severely low. (GCD) 10% Distillation Point is abnormally low. (GCD) % < 335°C is marginally high. COC Flash Point is marginally low.
02/09/17	This system previously had Therminol 66 and is still present in the system which has affected some the various GCD distillation results. This HTF mixture has not changed much since last samples. All other parameters are normal. The oil is in good condition and suitable for further service. We recommend a new sample be taken in 6 months to monitor condition. (GCD) 50% Distillation Point is severely low. (GCD) 90% Distillation Point is severely low. (GCD) 10% Distillation Point is abnormally low. (GCD) % < 335°C is marginally high. COC Flash Point is marginally low.
08/17/16	This system previously had Therminol 66 and is still present in the system which has affected some the distillation results. Compared to the previous samples, this oil is in good condition and suitable for further service. I would suggest that another sample be obtained in at the beginning of February to monitor the condition of this oil. (GCD) 50% Distillation Point is severely low. (GCD) 90% Distillation Point is severely low. (GCD) % < 335°C is abnormally high. (GCD) 10% Distillation Point is abnormally low. COC Flash Point is marginally low.
04/08/16	This system previously had Therminol 66 and based on these results there is a mix of our Petrotherm and the Therminol 66. Compared to the previous sample, this oil is in good condition and suitable for further service and explains the lower viscosity and the lower values in the distillation curve. I would suggest that another sample be obtained in 6 months to monitor the condition of this oil. (GCD) 50% Distillation Point is severely low. (GCD) 90% Distillation Point is severely low. (GCD) % < 335°C is abnormally high. (GCD) 10% Distillation Point is abnormally low.

Petro-Canada makes no representation or warranty of any kind, either express or implied, as to the accuracy or completeness of the analysis and assumes no responsibility and shall have no liability whatsoever with respect to such analysis, or a party's use of it. Petro-Canada is a division of HollyFrontier Corporation.