




MAXXTEC



Customer: PTRHTF40063	System Information	Sample Information
VAN DEN DOEL BV Markweg Zuid 1b Heijningen, 4794 SN Netherlands Attn: WILBERT SNIJERS Tel: E-Mail: w.snijers@klt.nl	System Volume: 6000 ltr Bulk Operating Temp: 275F / 135C Heating Source: Blanket: Fluid: PETRO CANADA PETRO-THERM Make: MAXXTEC	Lab No: 02235866 Analyst: Philip Riley Sample Date: 08/02/18 Received Date: 08/24/18 Completed: 08/28/18 To discuss this report contact Philip Riley at (440)124-4378171

Recommendation: All key parameters within normal limits. Fit for further use

Comments:



Sample Date	Received Date	Fluid Age	Sample Location	Flash Point (COC)	Water (KF)	Viscosity (40°C)	Acid Number	Solids	GCD 10%	GCD 50%	GCD 90%	GCD % < 335°C
	mm/dd/yy			°F/°C	ppm	cSt	mg/KOH/g	%wt	°F/°C	°F/°C	°F/°C	%
08/02/18	08/24/18	0y		437 / 225	22.2	36.2	0.17	0.109	711 / 377	803 / 429	905 / 485	1.16
08/19/16	08/24/16	10y	PTRHTF40063	412 / 211	31.9	32.9	0.000	0.101	712 / 378	805 / 430	906 / 486	1.17
07/25/14	07/31/14	5y		423 / 217	0.00	36.2	0.05	0.071	715 / 380	801 / 427	902 / 484	0.00
09/22/09	09/22/09			441 / 227	497	35.4	0	0.03	723 / 384		925 / 496	0.9
Baseline Data				433 / 223		34.2	0.03		720 / 382	817 / 436	900 / 482	1.00

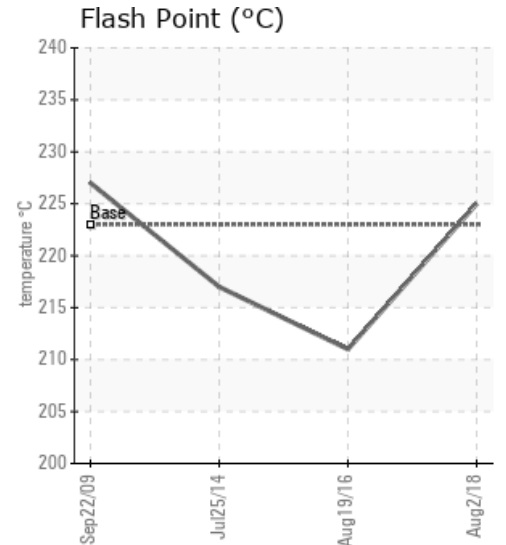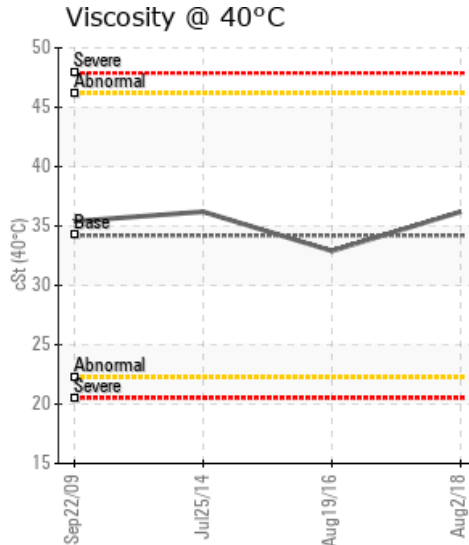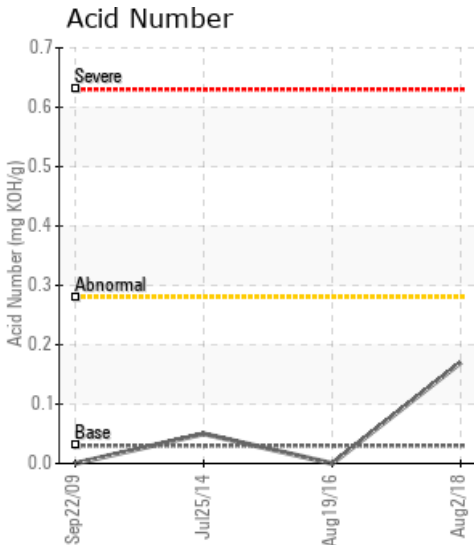

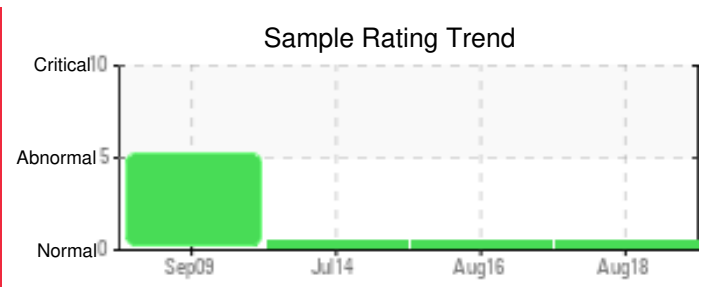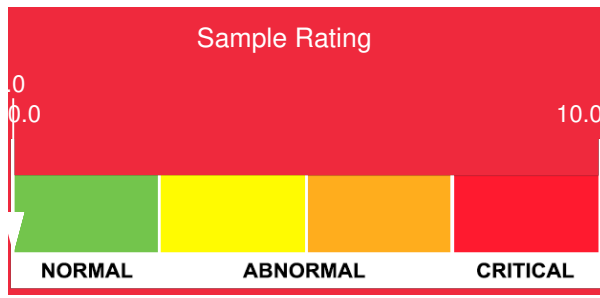

Sample Date	Iron	Chromium	Nickel	Aluminum	Copper	Lead	Tin	Cadmium	Silver	Vanadium	Silicon	Sodium	Potassium	Titanium	Molybdenum	Antimony	Manganese	Lithium	Boron	Magnesium	Calcium	Barium	Phosphorus	Zinc
08/02/18	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	3	0	1	1
08/19/16	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
07/25/14	6	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	1	0	3	0	2	1
09/22/09	6	0	0	0	0	0	0	0	0	0	0	8	0	0	0	0	0	0	0	0	0	1	0	0
Baseline Data			0	0						0			0	0					0				0	

Elemental analysis results (above) in parts per million (ppm). [10,000 ppm = 1.0%]

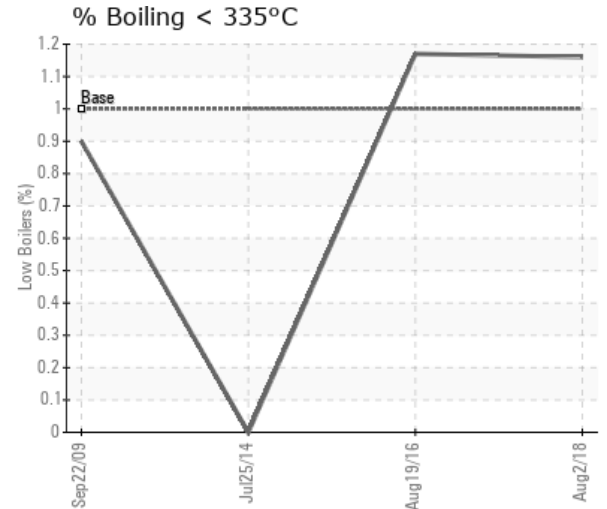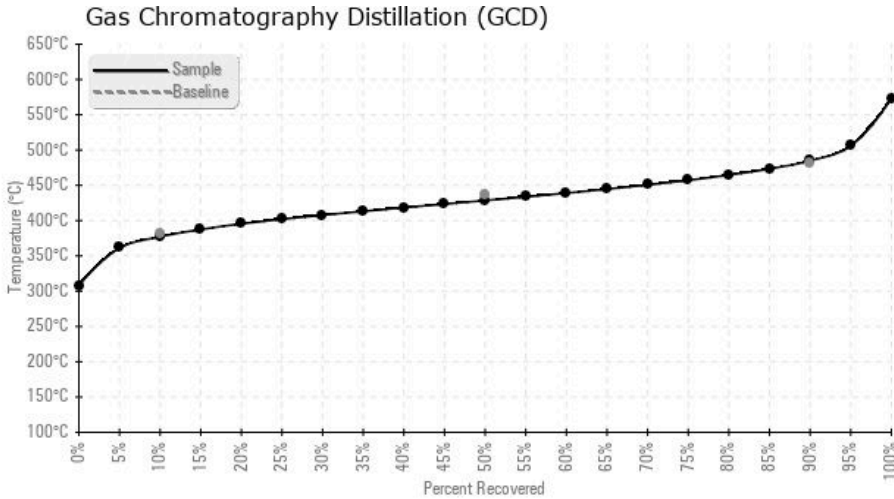

Historical Comments	
08/19/16	Oil is in good condition and fit for further service. Suggest sample at next scheduled maintenance interval.
07/25/14	Oil looks in very good condition. Sample at next scheduled maintenance interval.
09/22/09	

Petro-Canada makes no representation or warranty of any kind, either express or implied, as to the accuracy or completeness of the analysis and assumes no responsibility and shall have no liability whatsoever with respect to such analysis, or a party's use of it. Petro-Canada is a division of HollyFrontier Corporation.