




VTA HOT OIL PUMP



Customer: PTRHTF10004	System Information	Sample Information
ADM VITAMIN E PLANT 3700 EAST DIVISION STREET DECATUR, IL 62526 USA Attn: Rick Cluck Tel: (217)451-7770 E-Mail: ricky.cluck@adm.com	System Volume: 1800 gal Bulk Operating Temp: 650F / 343C Heating Source: Blanket: Fluid: PETRO CANADA PURITY FG HEAT TRANSFER FLUID Make: AMERICAN HEATING	Lab No: 02241819 Analyst: Joe Goecke Sample Date: 09/20/18 Received Date: 09/27/18 Completed: 10/01/18 To discuss this report contact Joe Goecke at (859)543-0092

Recommendation: Viscosity is half of new oil, Flash point is extremely low, low boilers are very high at 17.8% 10% distillation point also very low at 261.8C. This heat transfer efficacy of this oil is going to suffer. Oil needs to be changed ASAP to improve safety of operation.

Comments: (GCD) % < 335°C is severely high. (GCD) 10% Distillation Point is severely low. COC Flash Point is severely low. Visc @ 40°C is severely low.



Sample Date	Received Date	Fluid Age	Sample Location	Flash Point (COC)	Water (KF)	Viscosity (40°C)	Acid Number	Solids	GCD 10%	GCD 50%	GCD 90%	GCD % < 335°C
	mm/dd/yy			°F/°C	ppm	cSt	mg/KOH/g	%wt	°F/°C	°F/°C	°F/°C	%
09/20/18	09/27/18	2y		232 / 111	8.6	17.7	0.01	0.021	503 / 262	775 / 413	882 / 472	17.77
03/13/18	03/21/18	0y		264 / 129	6.2	20.0	0.042	0.049	535 / 280	761 / 405	880 / 471	19.53
12/14/17	12/21/17	0y		252 / 122	0.00	17.2	0.067	0.024	539 / 282	782 / 417	893 / 478	16.12
09/14/17	09/21/17	0y	B4 HOT OIL PUMP	270 / 132	4.7	21.1	0.01	0.030	547 / 286	781 / 416	890 / 477	15.19
06/13/17	06/19/17	18y	VTA EAST HOT OIL PMP	349 / 176	5.4	26.3	0.285	0.015	657 / 347	797 / 425	899 / 482	7.88
05/22/17	05/26/17	0y	VTA EAST PUMP	352 / 178	0.00	26.0	0.279	0.032	656 / 347	800 / 427	900 / 482	7.90
Baseline Data				459 / 237		37.12	0.90		721 / 383	807 / 431	892 / 478	1.5

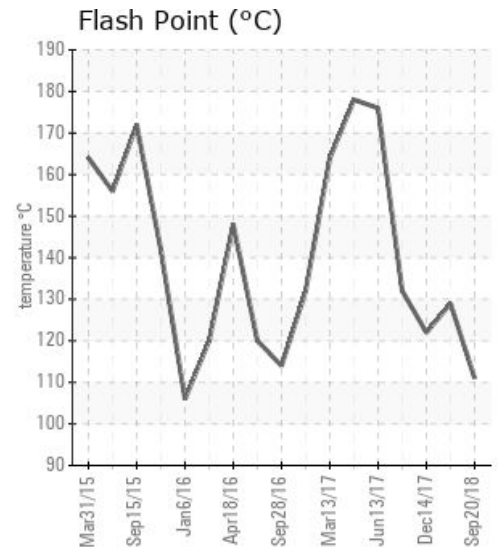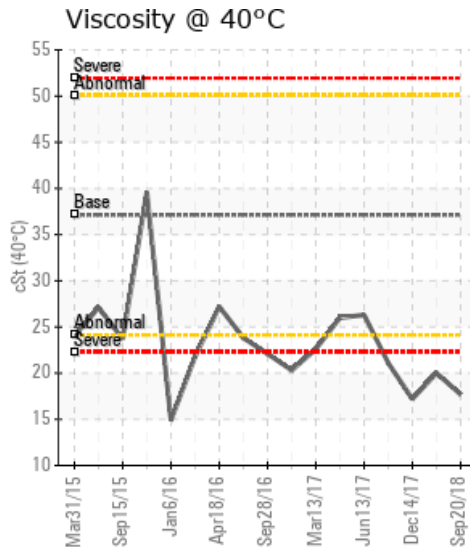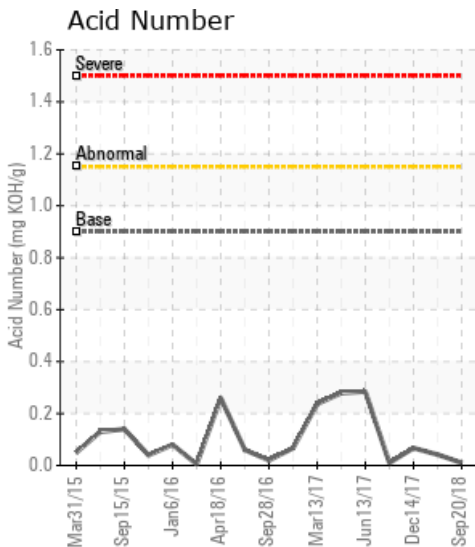

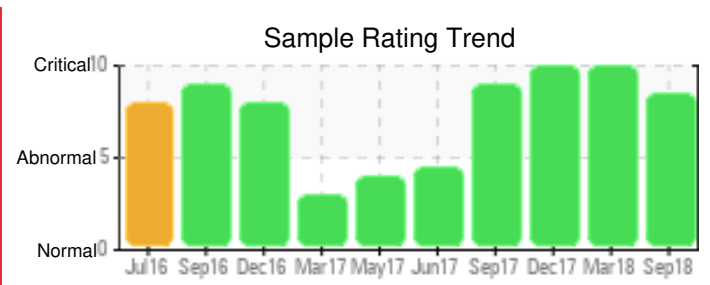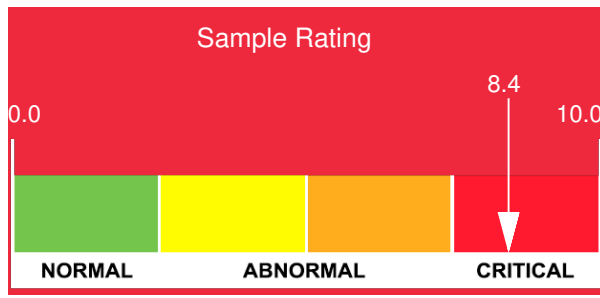

Sample Date	Iron	Chromium	Nickel	Aluminum	Copper	Lead	Tin	Cadmium	Silver	Vanadium	Silicon	Sodium	Potassium	Titanium	Molybdenum	Antimony	Manganese	Lithium	Boron	Magnesium	Calcium	Barium	Phosphorus	Zinc
09/20/18	1	0	0	0	0	0	4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	56	0
03/13/18	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	63	0
12/14/17	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	56	0
09/14/17	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	52	0
06/13/17	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	2	0	0	0	54	0
05/22/17	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	51	0
Baseline Data			0	0						0			0	0					0				230	

Elemental analysis results (above) in parts per million (ppm). [10,000 ppm = 1.0%]

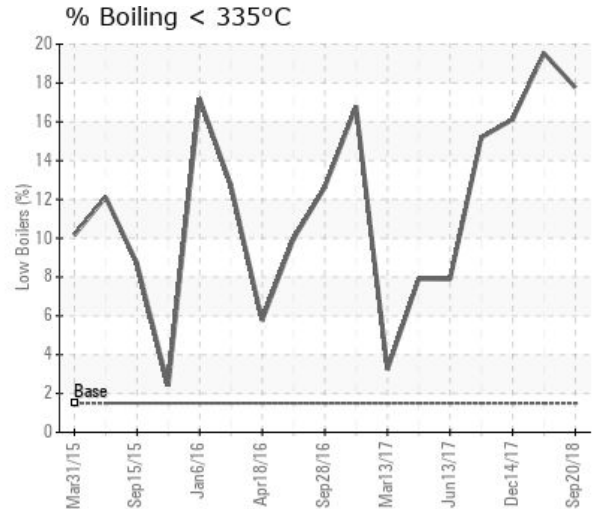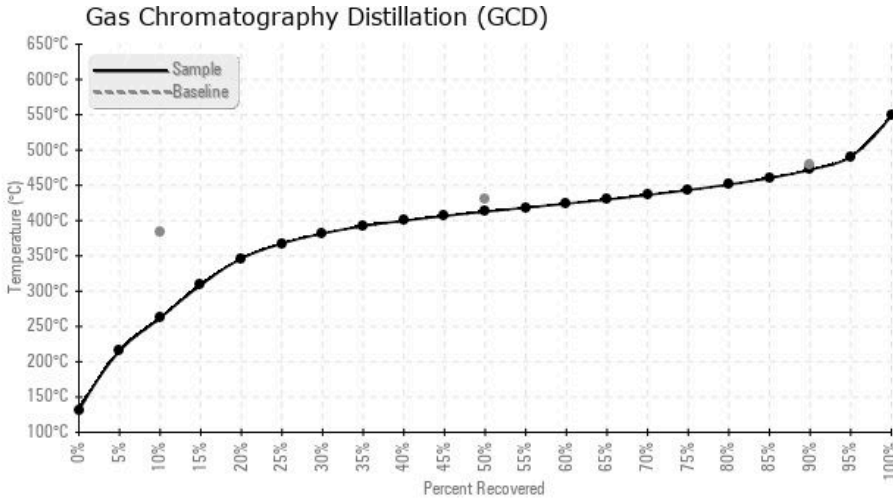

Historical Comments

03/13/18	System continues to be dangerously low on flash point and getting higher with low boilers or light ends creating a concern. System should be changed ASAP. Viscosity also critically low. (GCD) % < 335°C is severely high. (GCD) 10% Distillation Point is severely low. COC Flash Point is severely low. Visc @ 40°C is severely low.
12/14/17	This system should be changed as soon as possible. Low boilers are high flash point and viscosity are very low. The sample rating should be a 10 but cannot be changed by my system. (GCD) 10% Distillation Point is severely low. COC Flash Point is severely low. Visc @ 40°C is severely low. (GCD) % < 335°C is abnormally high.
09/14/17	System needs to be scheduled to be changed. Viscosity @ 40 C is below 22, Flash point dropped 40 degrees C from 3 months ago and Low boilers have increased to 15%. Since these cannot be vented the system need to be changed to improve heat transfer and safe operating properties. (GCD) 10% Distillation Point is severely low. COC Flash Point is severely low. Visc @ 40°C is severely low. (GCD) % < 335°C is abnormally high.
06/13/17	Sample results very similar to last sample. Flash point marginally lower. Light ends unchanged. Viscosity slightly higher Suggest resample in about 45-60 days COC Flash Point is severely low. (GCD) % < 335°C is marginally high. (GCD) 10% Distillation Point is marginally low.
05/22/17	Viscosity is low but higher than last sample, COC flash is also slightly higher than last sample, Acid number increased slightly, low boilers have doubled and passed the 7% threshold, and the GCD 10% distillation is dropping. We recommend resampling in 3 months and prepare for change later this year based on low boiler rise. COC Flash Point is abnormally low. (GCD) % < 335°C is marginally high. (GCD) 10% Distillation Point is marginally low.

Petro-Canada makes no representation or warranty of any kind, either express or implied, as to the accuracy or completeness of the analysis and assumes no responsibility and shall have no liability whatsoever with respect to such analysis, or a party's use of it. Petro-Canada is a division of HollyFrontier Corporation.