




[SIMONETTE GAS PLANT / LSD: 9-6-63-25-W5] H620 STABILIZER SIMONETTE



Customer: PTRHTF20187	System Information	Sample Information
KEYERA ENERGY- SIMONETTE GAS PLANT PO BOX 58 VALLEYVIEW, AB T0H 3N0 Canada Attn: Justin Clark Tel: (780)524-8940 E-Mail: justin_clarke@keyera.com	System Volume: 18000 ltr Bulk Operating Temp: 446F / 230C Heating Source: Blanket: Fluid: PETRO CANADA PETRO-THERM Make: PETROTECH	Lab No: 02254407 Analyst: Peter Hartevelde Sample Date: 11/19/18 Received Date: 11/29/18 Completed: 12/07/18

Recommendation: Compared with the previous condition of the fluid there are improvements in Flash Point and low boiler vapor content. Viscosity and distillation curve temperatures are still low. The fluid is suitable for further use. Please keep venting on a regular basis and re-sample in 6 months.

Comments: (GCD) 10% Distillation Point is severely low. (GCD) 90% Distillation Point is severely low. (GCD) % < 335°C is abnormally high. (GCD) 50% Distillation Point is abnormally low. COC Flash Point is marginally low.



Sample Date	Received Date	Fluid Age	Sample Location	Flash Point (COC)	Water (KF)	Viscosity (40°C)	Acid Number	Solids	GCD 10%	GCD 50%	GCD 90%	GCD % < 335°C
	mm/dd/yy			°F/°C	ppm	cSt	mg/KOH/g	%wt	°F/°C	°F/°C	°F/°C	%
11/19/18	11/29/18	15m		374 / 190	187.7	22.5	0.029	0.019	609 / 321	737 / 392	842 / 450	12.71
04/05/18	04/16/18	7m		345 / 174	10.3	21.5	0.02	0.014	556 / 291	803 / 428	915 / 490	16.47
01/22/18	01/29/18	5m		356 / 180	4.2	23.0	0.015	0.036	550 / 288	789 / 421	906 / 485	19.74
10/04/17	10/17/17	42m		360 / 182	23.3	21.3	0.035	0.043	551 / 288	793 / 423	908 / 486	18.43
Baseline Data				433 / 223		34.2	0.03		720 / 382	817 / 436	900 / 482	1.00

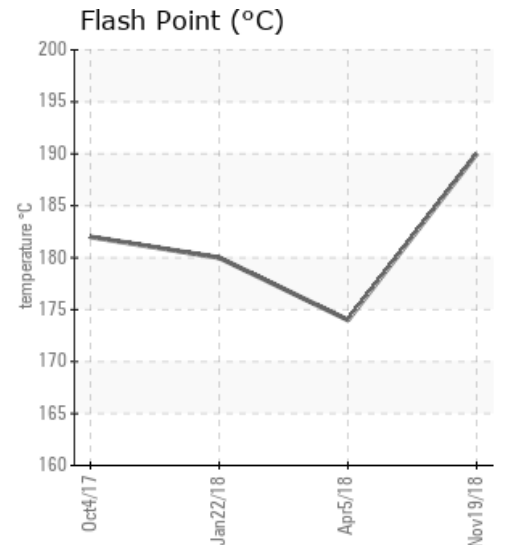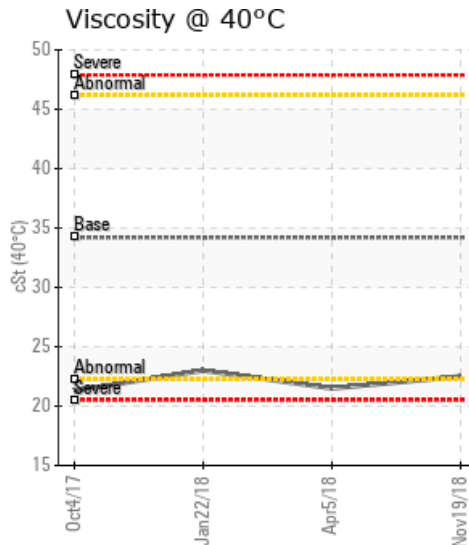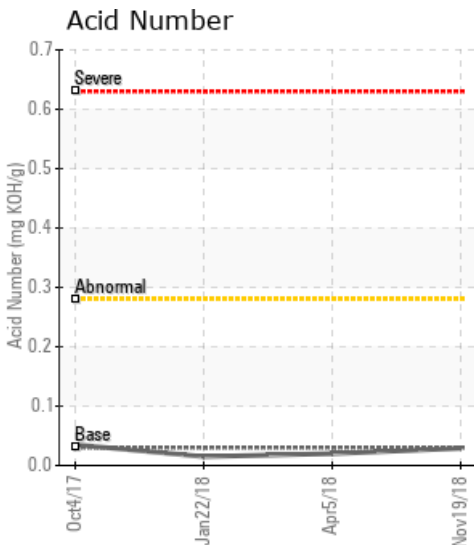

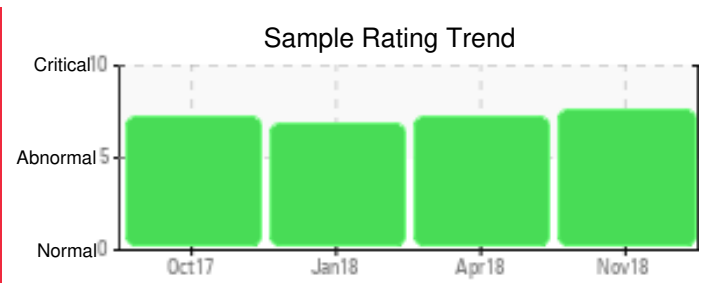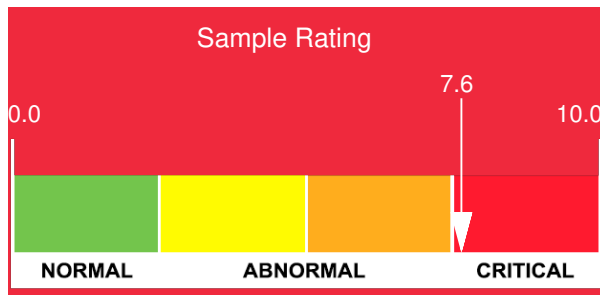

Sample Date	Iron	Chromium	Nickel	Aluminum	Copper	Lead	Tin	Cadmium	Silver	Vanadium	Silicon	Sodium	Potassium	Titanium	Molybdenum	Antimony	Manganese	Lithium	Boron	Magnesium	Calcium	Barium	Phosphorus	Zinc
11/19/18	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
04/05/18	2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
01/22/18	4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
10/04/17	2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Baseline Data			0	0						0			0	0					0				0	

Elemental analysis results (above) in parts per million (ppm). [10,000 ppm = 1.0%]

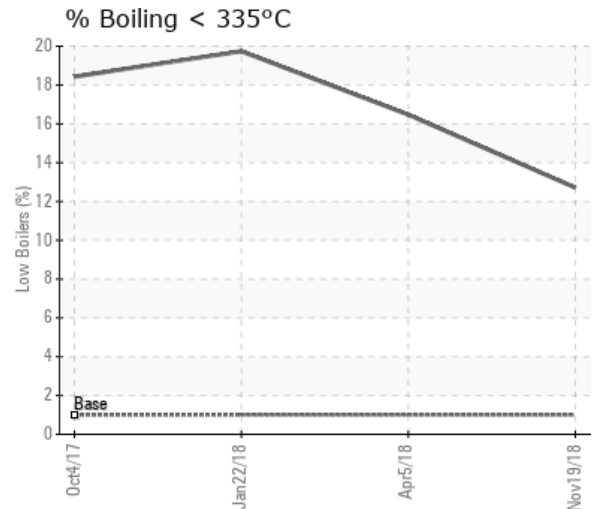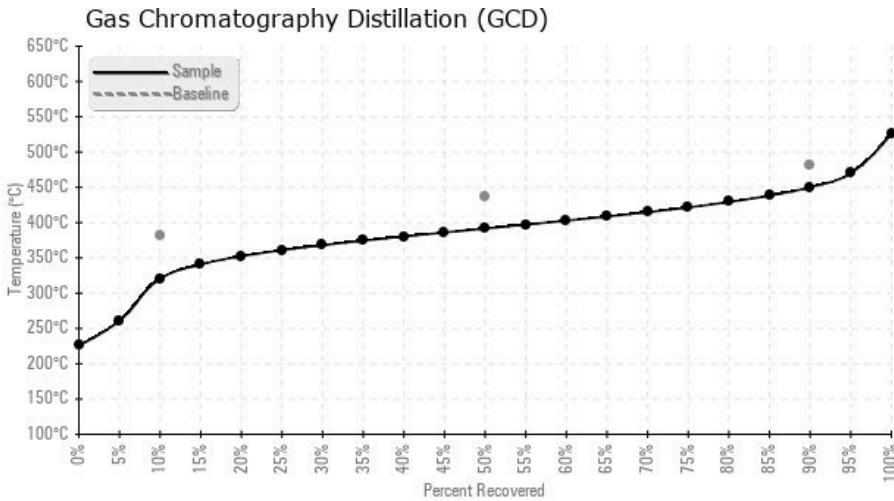

Historical Comments	
04/05/18	Condition of the fluid is similar to condition in January. Viscosity is very low, Flash Point is low, % boil-off below 335C. is high. The condition is believed to be the result of mixing with a low viscosity fluid (Therminol 59) with some additional thermal degradation indicated by the low 10% GCD temperature. Please vent off low boiler vapor to atmosphere and resample in 3 months. (GCD) % < 335°C is severely high. (GCD) 10% Distillation Point is severely low. COC Flash Point is abnormally low. Visc @ 40°C is abnormally low.
01/22/18	Like the fluid in the Refridge system, the condition has remained the same. Viscosity, Flash Point and 10% GCD temp are low and low boiler vapor content is high. (% boil-off <335C) A low boiler vapor content of almost 20% is a problem for circulation of the fluid through the system. Pumps can vapor lock and damage due to cavitation. It's recommended to top-up with 10% of the total volume to lower the low boiler vapor content. This will take several steps of topping-up which can take place at a 6 months interval followed by taking a sample. The fluid is suitable for use. (GCD) % < 335°C is severely high. (GCD) 10% Distillation Point is severely low. COC Flash Point is marginally low.
10/04/17	A combination of low viscosity, Flash Point and 10% GCD temperature plus a very high low boiler vapor content (% boil-off <335C.) would normally indicate thermal degradation but since fluid service life has only been 42 days this condition could be the result of one of the following: 1. Mixing with another (low viscosity) heat transfer fluid. 2. Contamination with a process fluid. 3. Ingress of blanket gas when blanket gas pressure is too high and natural gas is in use. Please identify the problem and rectify (GCD) % < 335°C is severely high. (GCD) 10% Distillation Point is severely low. Visc @ 40°C is abnormally low. COC Flash Point is marginally low.

Petro-Canada makes no representation or warranty of any kind, either express or implied, as to the accuracy or completeness of the analysis and assumes no responsibility and shall have no liability whatsoever with respect to such analysis, or a party's use of it. Petro-Canada is a division of HollyFrontier Corporation.