

WANSON 800LN

Customer: PTRHTF40108

WILTHAGEN VLEESWAREN ENERGIE WEG 1

THOLEN, 4691SE Netherlands

Attn: Wilbert Snijers

Tel:

E-Mail: w.snijers@klt.nl

System Information

System Volume: 1600 ltr

Bulk Operating Temp: 410F / 210C

Heating Source:

Blanket:

Fluid: BP TRANSCAL N

Make: WANSON


Sample Information

Lab No: 02264528 Analyst: Philip Riley Sample Date: 01/10/19 Received Date: 01/25/19


Completed: 02/01/19


Recommendation: Not P-C product therefore cannot give informed recommendations


Comments: Pentane Insolubles levels are severely high. Acid Number (AN) is abnormally high.

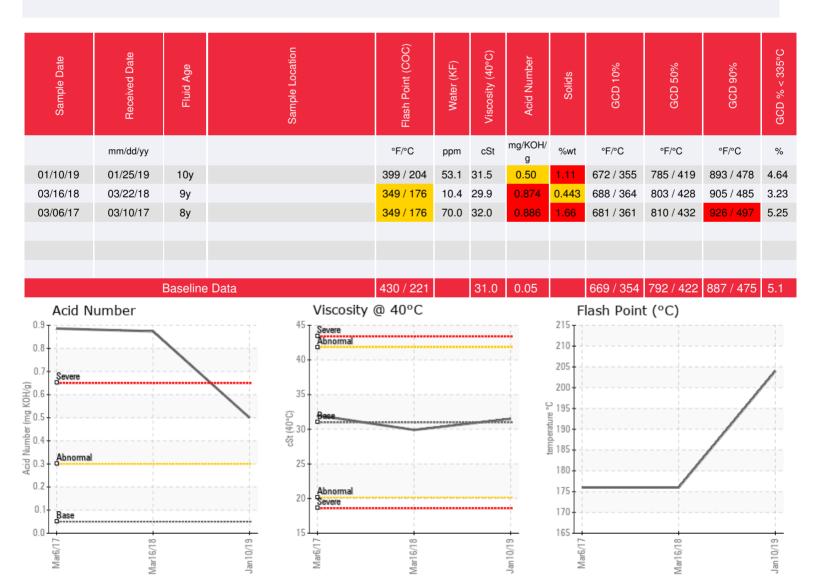




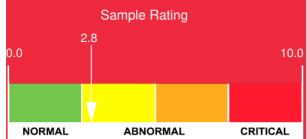


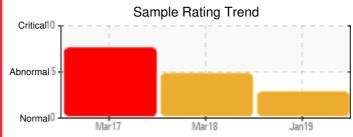

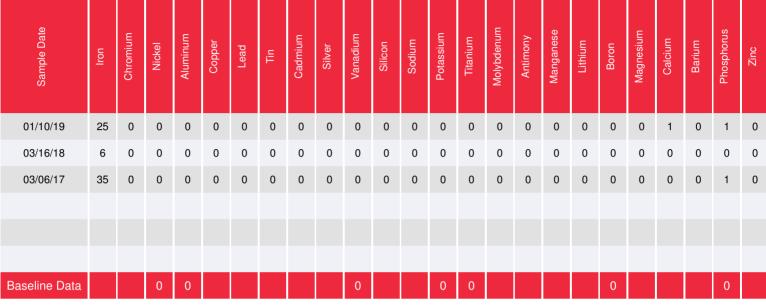

Elemental analysis results (above) in parts per million (ppm). [10,000 ppm = 1.0%]

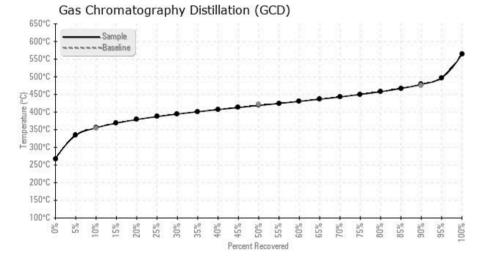

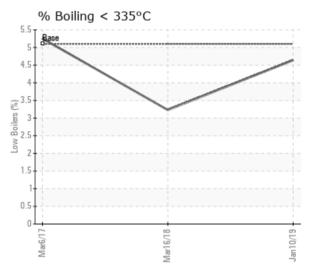

Historical Comments

The fluid is degraded and the oil change is recommended. Because insoluble are high, it is recommended to inspect the system in case cleaning is needed. Pentane insoluble and TAN are too high indicating fluid degradation. Flash point is too low. Pentane Insolubles levels are abnormally high. Acid Number (AN) is 03/16/18 severely high. COC Flash Point is abnormally low Not a Petro-Canada Oil. Ranking is not good. Pentane Insolubles levels are severely high. Acid Number (AN) is severely high. (GCD) 90% Distillation Point is 03/06/17

severely high. COC Flash Point is abnormally low.

Petro-Canada makes no representation or warranty of any kind, either express or implied, as to the accuracy or completeness of the analysis and assumes no responsibility and shall have no liability whatsoever with respect to such analysis, or a party's use of it. Petro-Canada is a division of HollyFrontier Corporation.