




## [VIT E 116] EAST



Customer: PTRHTF10004	System Information	Sample Information
ADM VITAMIN E PLANT 3700 EAST DIVISION STREET DECATUR, IL 62526 USA Attn: Rick Cluck Tel: (217)451-7770 E-Mail: ricky.cluck@adm.com	System Volume: 2200 gal Bulk Operating Temp: 550F / 288C Heating Source: Blanket: Fluid: PETRO CANADA PURITY FG HEAT TRANSFER FLUID Make: AMERICAN HEATING	Lab No: 02266861 Analyst: Joe Goecke Sample Date: 01/30/19 Received Date: 02/08/19 Completed: 02/13/19

Recommendation: This sample looks better than the last. Light ends are fairly stable, flash point 10 degrees higher, and viscosity slightly higher. Overall fluid looks okay for continued use. Resample at next scheduled interval.

Comments: COC Flash Point is abnormally low. (GCD) 10% Distillation Point is abnormally low. (GCD) % < 335°C is marginally high.



Sample Date	Received Date	Fluid Age	Sample Location	Flash Point (COC)	Water (KF)	Viscosity (40°C)	Acid Number	Solids	GCD 10%	GCD 50%	GCD 90%	GCD % < 335°C
	mm/dd/yy			°F/°C	ppm	cSt	mg/KOH/g	%wt	°F/°C	°F/°C	°F/°C	%
01/30/19	02/08/19	0m		367 / 186	8.4	27.0	0.283	0.020	641 / 339	778 / 415	888 / 475	8.94
11/30/18	12/07/18	2m		342 / 172	12.8	26.2	0.14	0.087	658 / 348	802 / 428	910 / 488	7.95
10/11/18	10/18/18	0m		230 / 110	11.1	24.1	0.08	0.018	669 / 354	796 / 424	899 / 481	6.68
09/29/17	10/06/17	0m		248 / 120	14.1	24.2	0.10	0.028	686 / 364	805 / 430	918 / 492	4.06
06/29/17	07/07/17	0m	EAST PUMP - EAST UNT	342 / 172	11.6	26.7	0.20	0.021	710 / 377	819 / 437	942 / 506	2.01
05/22/17	05/26/17	0m	EAST HO PMP EAST	318 / 159	2.9	26.4	0.313	0.033	658 / 348	803 / 429	907 / 486	7.78
Baseline Data				459 / 237		37.12	0.90		721 / 383	807 / 431	892 / 478	1.5

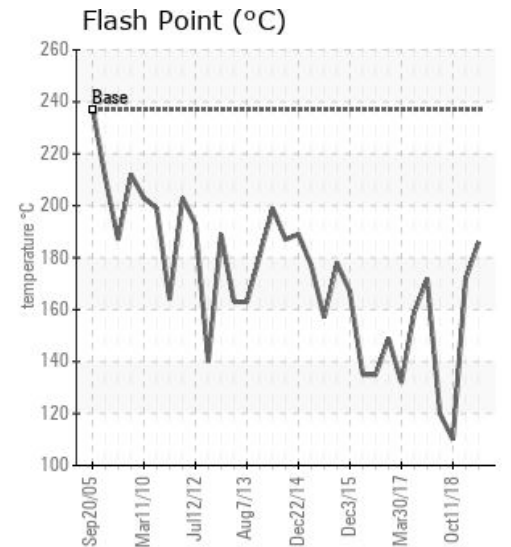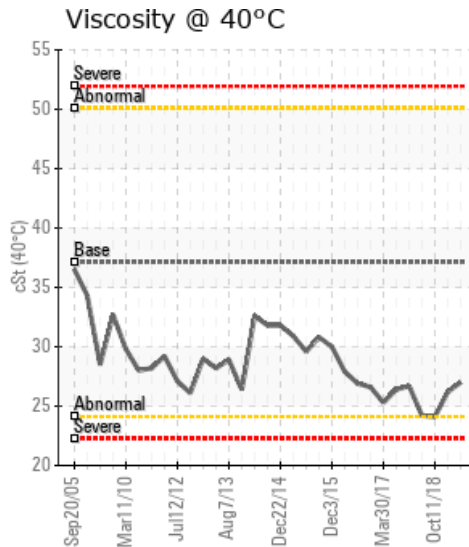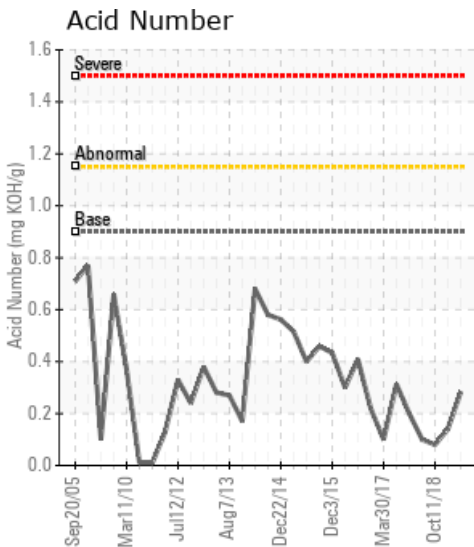

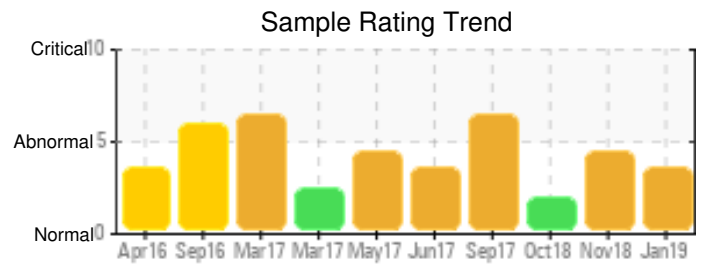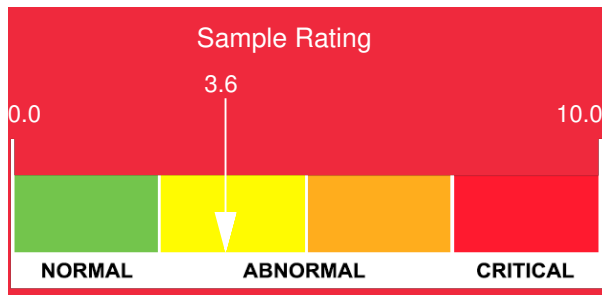

Sample Date	Iron	Chromium	Nickel	Aluminum	Copper	Lead	Tin	Cadmium	Silver	Vanadium	Silicon	Sodium	Potassium	Titanium	Molybdenum	Antimony	Manganese	Lithium	Boron	Magnesium	Calcium	Barium	Phosphorus	Zinc
01/30/19	7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	16	2
11/30/18	34	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	14	0
10/11/18	2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	11	0
09/29/17	11	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	7	0
06/29/17	4	0	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	6	1
05/22/17	2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	25	0
<b>Baseline Data</b>			0	0						0			0	0					0				230	

Elemental analysis results (above) in parts per million (ppm). [10,000 ppm = 1.0%]

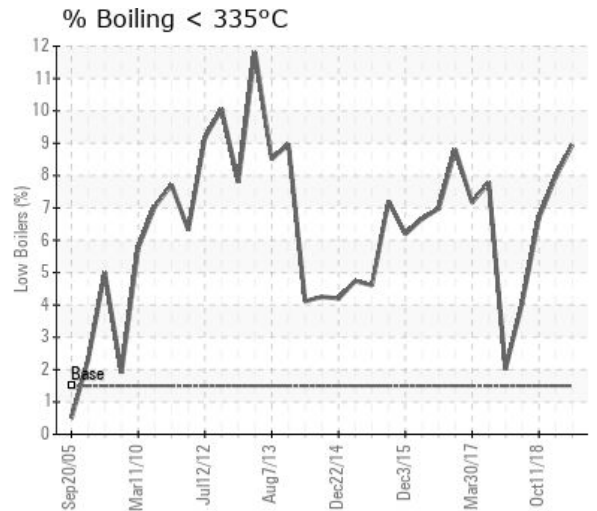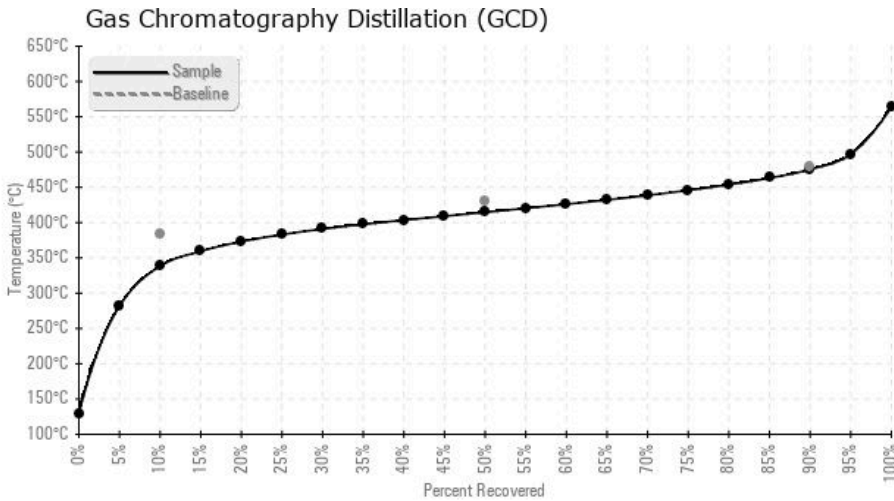

Historical Comments	
11/30/18	Sample has improved on Flash Point and viscosity. Sample looks okay to continue use and resample next quarter. COC Flash Point is severely low. (GCD) % < 335°C is marginally high. (GCD) 10% Distillation Point is marginally low.
10/11/18	Flash point and Viscosity remain low, however low boilers are within range. Continue to use and resample in 60 days. COC Flash Point is severely low. Visc @ 40°C is abnormally low.
09/29/17	Flash point is very low on this sample. Although other tests that would normally support this like GCD <335 and viscosity are not too far out of range I would recommend resampling in 30 days to confirm the flash point. If it continues to remain low a complete or partial change should be considered. COC Flash Point is severely low. (GCD) 90% Distillation Point is marginally high.
06/29/17	Flash point is lower than a new sample and viscosity slightly lower but low boilers are low and all other parameters in good shape. Continue to use and resample at normal interval. (GCD) 90% Distillation Point is severely high. COC Flash Point is severely low.
05/22/17	All measurements are the same or better than last sample with the exception of a slight rise in acid number and very slight decrease in viscosity. Flash point higher and low boilers lower. Continue to monitor as normal and resample in 3 months. COC Flash Point is severely low. (GCD) % < 335°C is marginally high. (GCD) 10% Distillation Point is marginally low.

Petro-Canada makes no representation or warranty of any kind, either express or implied, as to the accuracy or completeness of the analysis and assumes no responsibility and shall have no liability whatsoever with respect to such analysis, or a party's use of it. Petro-Canada is a division of HollyFrontier Corporation.