




## [PEYTO BRAZEAU PLANT / 100/6-12-44-13W5] 6-12-44-13W5 H-1611 HEAT MEDIUM


Customer: PTRHTF20124	System Information	Sample Information
PEYTO EXPLORATION 11-17-55-21W5 BOX 7198 EDSON, AB T7E 1V4 Canada Attn: Cory Pambrub Tel: (780)712-0217 E-Mail: cpambrun@peyto.com	System Volume: 0 ltr Bulk Operating Temp: 383F / 195C Heating Source: Blanket: Fluid: PETRO CANADA PETRO-THERM Make: HEAT TECH	Lab No: 02269085 Analyst: Terry Veenstra Sample Date: 02/19/19 Received Date: 02/21/19 Completed: 03/14/19

Recommendation: This fluid has greatly improved since the pressure has been reduced and the system has been vented. Continue to vent periodically as part of a good maintenance program and resample in 6 months.

Comments:



Sample Date	Received Date	Fluid Age	Sample Location	Flash Point (COC)	Water (KF)	Viscosity (40°C)	Acid Number	Solids	GCD 10%	GCD 50%	GCD 90%	GCD % < 335°C
	mm/dd/yy			°F/°C	ppm	cSt	mg/KOH/g	%wt	°F/°C	°F/°C	°F/°C	%
02/19/19	02/21/19	3y		432 / 222	9.3	31.6	0.052	0.023	719 / 381	807 / 431	911 / 489	0.91
11/26/18	11/29/18	3y		343 / 173	2.6	27.5	0.01	0.039	660 / 349	746 / 396	842 / 450	4.23
05/11/18	05/15/18	2y	100/6-12-44-13W5	387 / 197	0.00	27.7	0.02	0.041	685 / 363	774 / 412	892 / 478	2.86
Baseline Data				433 / 223		34.2	0.03		720 / 382	817 / 436	900 / 482	1.00

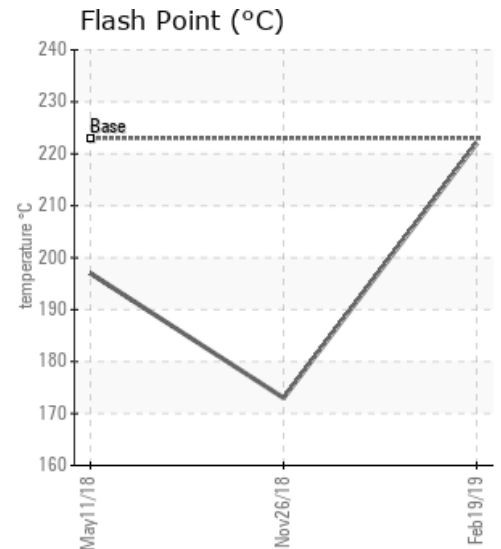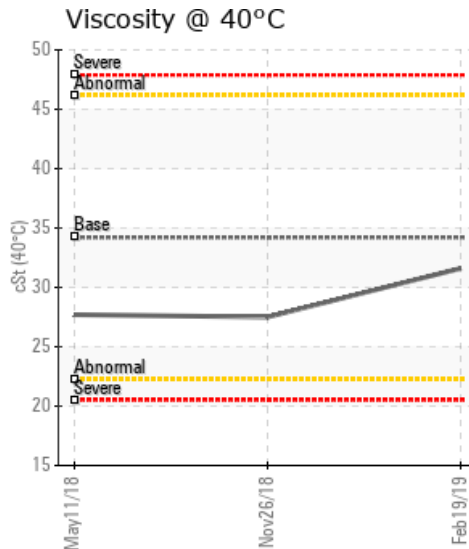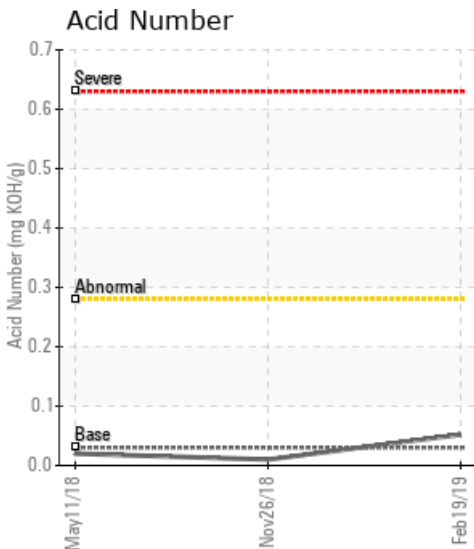

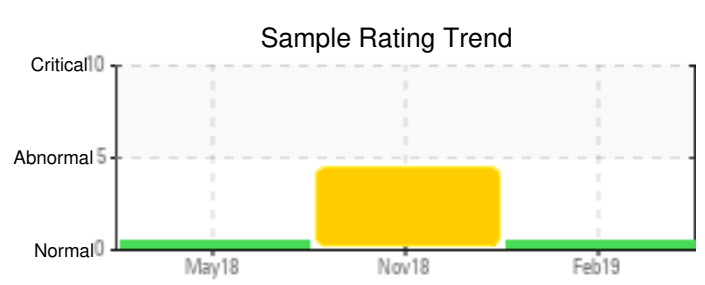

Sample Date	Iron	Chromium	Nickel	Aluminum	Copper	Lead	Tin	Cadmium	Silver	Vanadium	Silicon	Sodium	Potassium	Titanium	Molybdenum	Antimony	Manganese	Lithium	Boron	Magnesium	Calcium	Barium	Phosphorus	Zinc
02/19/19	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
11/26/18	1	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	1	0	0	0
05/11/18	2	0	0	0	0	0	0	0	0	0	1	4	0	4	0	0	0	0	0	0	3	0	0	0
<b>Baseline Data</b>			0	0						0			0	0					0				0	

Elemental analysis results (above) in parts per million (ppm). [10,000 ppm = 1.0%]

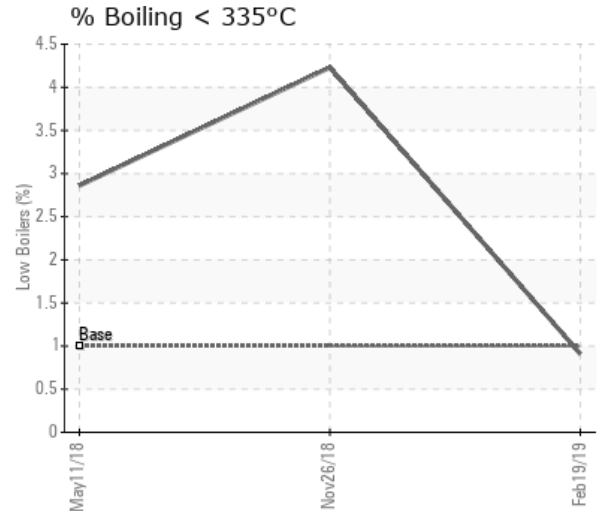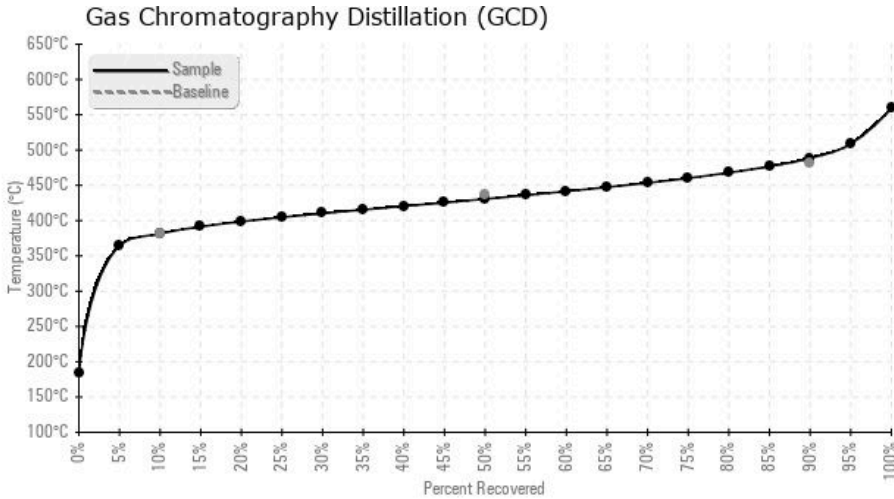

Historical Comments	
11/26/18	The condition of the fluid shows signs similar to thermal degradation but as commented previously this is most likely the effect of too high pressure blanket gas. The Flash Point has decreased further and the distillation curve is low as a whole. Percentage low boiler vapors has increased to 4.23%. This will become problematic for the pumps at 7-8%. Since this is probably the result of blanket gas ingress it looks like natural gas is still in use. The use of N2 is recommended. Please re-sample in 6 months. When sending in the sample please list system volume. Fluid is suitable for further use. (GCD) 90% Distillation Point is severely low. COC Flash Point is abnormally low. (GCD) 10% Distillation Point is marginally low. (GCD) 50% Distillation Point is marginally low.
05/11/18	The fluid is in good condition and suitable for further use. Viscosity and Flash Point are slightly low. % boil-off below 335C is slightly high. These parameters in combination with decreased 10%- and 50% GCD temperatures indicate thermal degradation of the fluid and/or ingress of blanket gas. At this moment it is not a problem but it is recommended to start venting-off low boiler vapors to atmosphere to bring the fluid back to a condition closer to the condition of fresh fluid. Venting should be part of regular maintenance. Please re-sample in 6 months.

Petro-Canada makes no representation or warranty of any kind, either express or implied, as to the accuracy or completeness of the analysis and assumes no responsibility and shall have no liability whatsoever with respect to such analysis, or a party's use of it. Petro-Canada is a division of HollyFrontier Corporation.