




YONG SHUN UP A-B


Customer: PTRHTF60007	System Information	Sample Information
CANADIAN RESOURCES INC 2F 71 CHONG CHING NORTH ROAD S C 3 TAIPEI, TAIWAN, PROVINC Attn: HUGO CHENG Tel: (886)225-853509 E-Mail: roychen1018@hotmail.com	System Volume: 7585 ltr Bulk Operating Temp: 419F / 215C Heating Source: Blanket: Fluid: PETRO CANADA CALFLO HTF Make:	Lab No: 02329284 Analyst: Philip Riley Sample Date: 12/18/19 Received Date: 12/30/19 Completed: 01/06/20

Recommendation: Fluid meets all expected parameters and raises no areas of concern. Fit for further use, please sample in 12 months time

Comments:




Sample Date	Received Date	Fluid Age	Sample Location	Flash Point (COC)	Water (KF)	Viscosity (40°C)	Acid Number	Solids	GCD 10%	GCD 50%	GCD 90%	GCD % < 335°C
	mm/dd/yy			°F/°C	ppm	cSt	mg/KOH/g	%wt	°F/°C	°F/°C	°F/°C	%
12/18/19	12/30/19	0h		414 / 212	14.2	38.8	0.229	0.193	665 / 352	786 / 419	900 / 482	4.71
02/23/18	03/07/18	0h		417 / 214	25.7	41.7	0.315	0.838	670 / 355	808 / 431	921 / 494	2.60
11/29/16	12/08/16	0h		417 / 214	80.6	40.1	0.08	0.070	665 / 352	808 / 431	930 / 499	3.64
08/17/15	08/21/15	0h		410 / 210	30.5	40.6	0.249	0.353	684 / 362	805 / 429	904 / 484	0.13
11/24/14	11/28/14	0h	UP-A,B	410 / 210	9.6	41.1	0.05	0.768	657 / 347	798 / 426	924 / 496	4.27
Baseline Data				448 / 231		35.20	.1		712 / 378	810 / 432	910 / 488	1.75

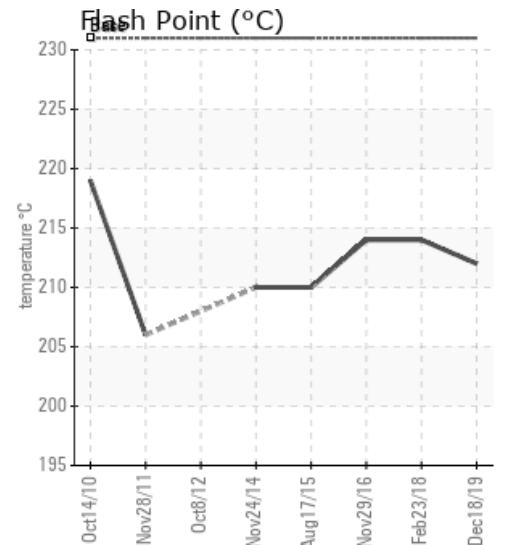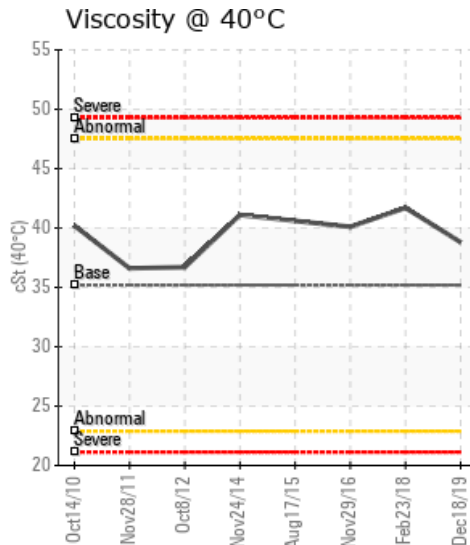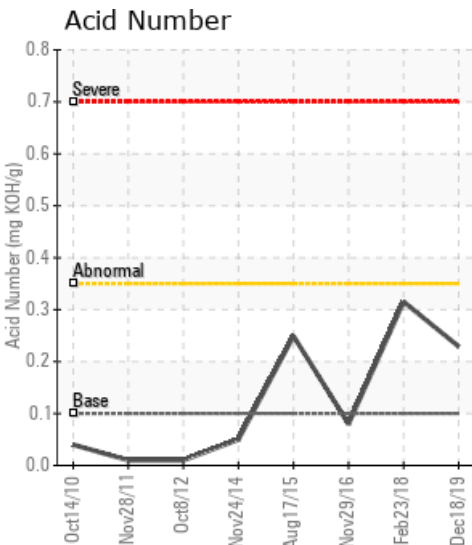

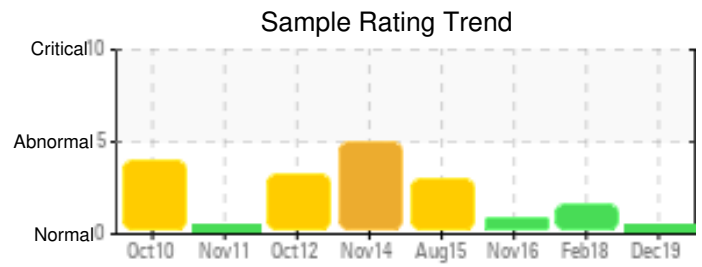

Sample Date	Iron	Chromium	Nickel	Aluminum	Copper	Lead	Tin	Cadmium	Silver	Vanadium	Silicon	Sodium	Potassium	Titanium	Molybdenum	Antimony	Manganese	Lithium	Boron	Magnesium	Calcium	Barium	Phosphorus	Zinc
12/18/19	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	45	0
02/23/18	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	3	0	54	1
11/29/16	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	53	0
08/17/15	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	53	0
11/24/14	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	55	0
Baseline Data			0	0						0			0	0					0				280	

Elemental analysis results (above) in parts per million (ppm). [10,000 ppm = 1.0%]

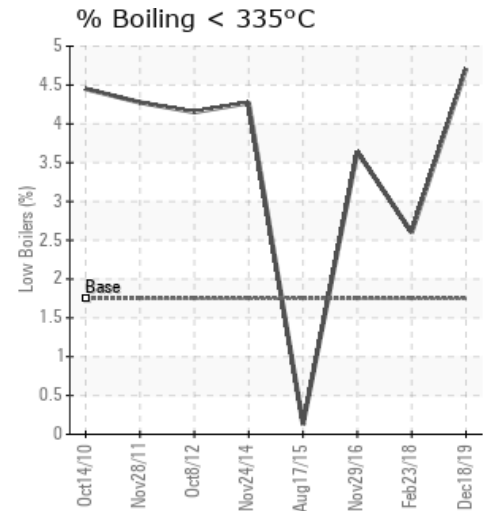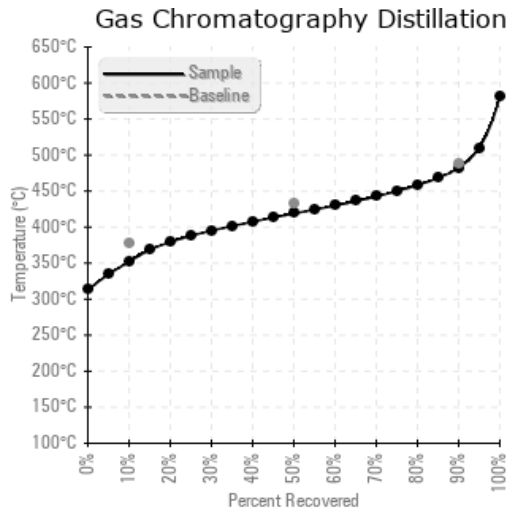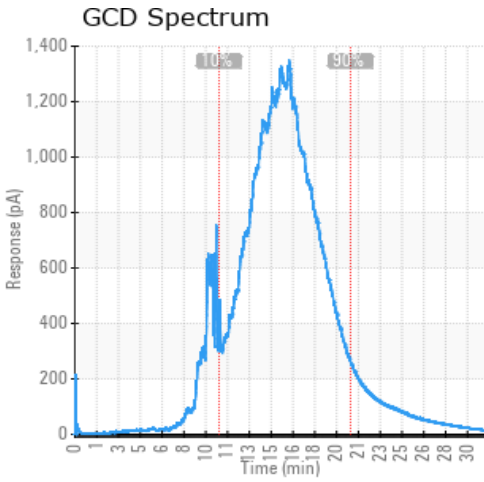

Historical Comments

02/23/18	The current fluid had moderate oxidation. The viscosity and solid contents are all high. Please take one sample in 6 months to monitor the conditions. The fluid hours are not reported, which definitely limit our interpretation. Please inform Yutong Gao at Petro-Canada for the detailed fluid hours.
11/29/16	The current fluid has adequate flash point, acid number, distillation points, water and the solid content. The fluid is OK for continual run and please take a sample in 12 months to monitor the conditions.
08/17/15	The current fluid has normal TAN, GCD, solid and water. The higher viscosity might be from a mild oxidation or a heavier oil top up, but this fluid is suitable for further use. Please take one sample in one year to monitor the conditions. Please remember to provide the total fluid working hours when you send the future samples. Visc @ 40°C is abnormally high.
11/24/14	The current fluid has moderate oxidation and mild thermal cracking, but it is still suitable for the further use. Please take one sample in 3 months to monitor the conditions. Solid levels are severely high. Visc @ 40°C is abnormally high. (GCD) 10% Distillation Point is marginally low.

Petro-Canada makes no representation or warranty of any kind, either express or implied, as to the accuracy or completeness of the analysis and assumes no responsibility and shall have no liability whatsoever with respect to such analysis, or a party's use of it. Petro-Canada is a division of HollyFrontier Corporation.