[LSD / C-46-C/94-H-4] BLACK SWAN NIG CREEK

Customer: PTRHTF20046

QUADRA CHEMICALS 12925 146TH STREET

EDMONTON, AB T5L 2H6 CANADA

Attn: Quadra Samples

Tel:

E-Mail: quadra samples@quadra.ca

System Information

System Volume: 180000 ltr

Bulk Operating Temp: Not Specified

Heating Source:

Blanket:

Fluid: PETRO CANADA PETRO-THERM

Make: HEAT TEACH

Sample Information


Lab No: 02341088 Analyst: Peter Harteveld Sample Date: 02/19/20 Received Date: 03/03/20 Completed: 03/09/20


Peter Harteveld

peter.harteveld@petrocanadalsp.com

Recommendation: The fluid is in a good condition and suitable for further use. 90% GCD temperature is high and so is the distillation curve as a whole. Flash Point is high as well. This is no problem but is either an indication of the presence of a heavier fluid (which is not supported by viscosity) or the onset of fluid oxidation (which is not supported by AN). More trending data is required to make a better evaluation of fluid condition. Please re-sample in 3 months and in the mean time check proper operation of the blanket gas system.

Comments: (GCD) 90% Distillation Point is abnormally high.

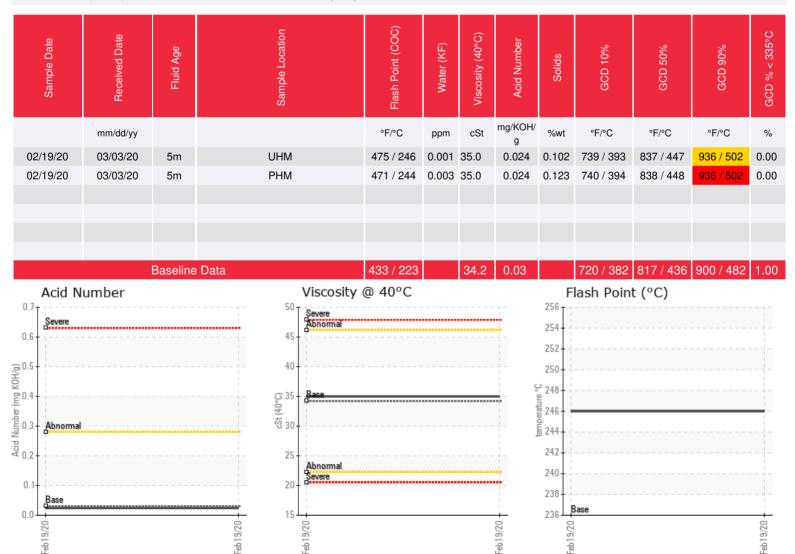

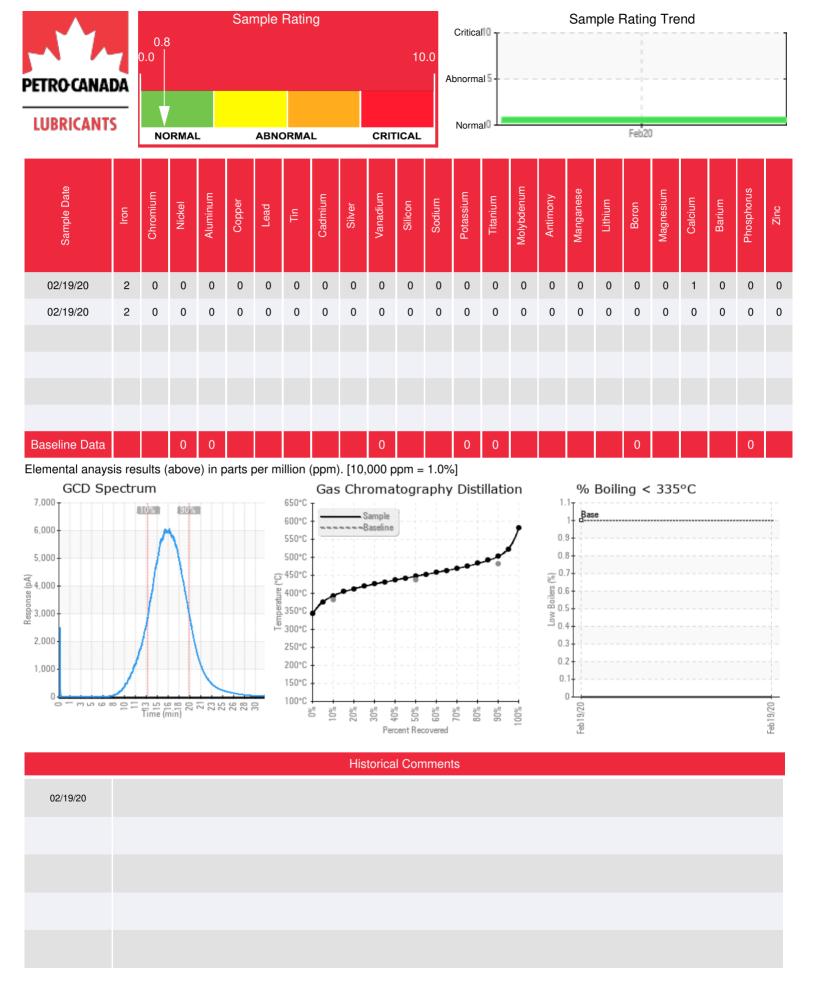

Petro-Canada makes no representation or warranty of any kind, either express or implied, as to the accuracy or completeness of the analysis and assumes no responsibility and shall have no liability whatsoever with respect to such analysis, or a party's use of it. Petro-Canada is a division of HollyFrontier Corporation.