


## LN02 Laminator Hot Oil System


Customer: PTRHTF10141	System Information	Sample Information
TAMKO BUILDING PRODUCTS	System Volume: 110 gal	Lab No: 02343480
2300 35TH ST	Bulk Operating Temp: 350F / 177C	Analyst: Jake Finn
TUSCALOOSA, AL 35401 USA	Heating Source:	Sample Date: 03/05/20
Attn: Greg Colburn	Blanket:	Received Date: 03/13/20
Tel: (205)752-3555	Fluid: PETRO CANADA CALFLO HTF	Completed: 03/24/20
E-Mail: gregory_colburn@tamko.com	Make: Heat Exchanger And T	Jake Finn
		jake.finn@petrocanadalsp.com

Recommendation: COC Flash point has improved since last sample, and this fluid appears to be in great condition. Please remember to include time on oil and filter in future sample submissions. Fluid is suitable for continued use, please resubmit in one year.

Comments: N/A

Sample Date	Received Date	Fluid Age	Sample Location	Flash Point (COC)	Water (KF)	Viscosity (40°C)	Acid Number	Solids	GCD 10%	GCD 50%	GCD 90%	GCD % < 335°C
	mm/dd/yy			°F/°C	ppm	cSt	mg/KOH/ g	%wt	°F/°C	°F/°C	°F/°C	%
03/05/20	03/13/20	0m	PORT	435 / 224	15.7	31.9	0.062	0.073	708 / 376	803 / 428	904 / 485	0.13
10/03/19	10/15/19	0m		381 / 194	27.2	32.7	0.158	0.081	729 / 387	822 / 439	919 / 493	0.41
02/25/19	03/06/19	18m	PORT	381 / 194	16.1	32.1	0.050	0.070	696 / 369	798 / 425	893 / 478	3.00
08/24/18	09/04/18	24m	PORT	428 / 220	17.1	32.2	0.01	0.052	710 / 377	808 / 431	903 / 484	1.78
03/02/18	03/13/18	12m		410 / 210	15.9	32.5	0.04	0.184	717 / 381	792 / 422	902 / 483	0.00

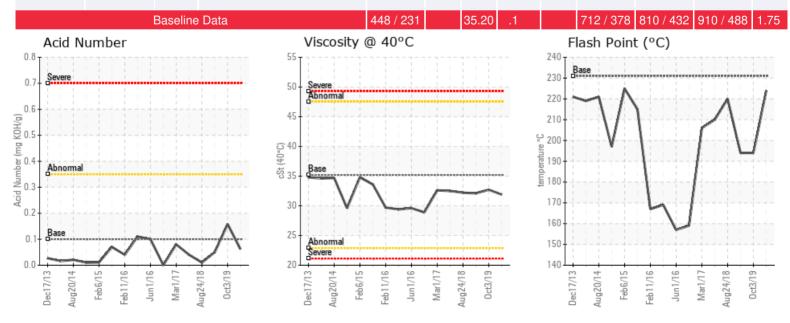

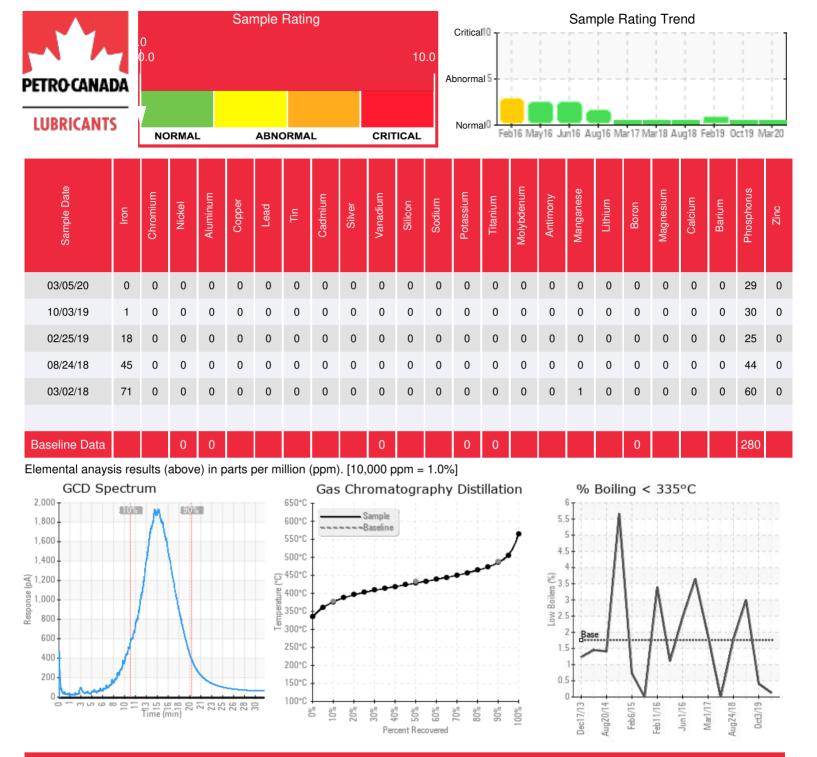

## Historical Comments

10/03/19	Oil is suitable for continued use. Please resubmit sample in one year.COC Flash Point is marginally low. Venting the system may improve flash point. Iron levels have continued to improve over previous samples.
02/25/19	Fluid is suitable for continued use. Please re-sample and send to lab in 12 months.COC Flash Point is marginally low. Venting the system may improve flash point. Iron levels have continued to improve compared to previous two samples.
08/24/18	Fluid is suitable for continued use and sample from this 100-gal system should be re-submitted in August of 2019. All critical fluid parameters are in-line and free of contaminants. Some very lite debris was noticed by the lab technician. If system has any filters please change them. Furthermore, the fluid could be filtered using a kidney loop system during a safe shutdown period to obtain optimum cleanliness levels.
03/02/18	Fluid is suitable for continued use. Please re-sample and submit to the lab in 1-year. An increase in the iron level is noted. All other component wear rates are normal. Very light debris has been noticed visually. Changing system filters, if any, is recommended and/or using a portable filter cart during the next scheduled maintenance will clean the fluid.

Petro-Canada makes no representation or warranty of any kind, either express or implied, as to the accuracy or completeness of the analysis and assumes no responsibility and shall have no liability whatsoever with respect to such analysis, or a party's use of it. Petro-Canada is a division of HollyFrontier Corporation.