




[2020 BLENDS] 2020 BLENDS - MAIN HOT OIL SYSTEM



Customer: PTRHTF10068	System Information	Sample Information
Certainteed - Saint Gobain 1077 PLEASANT ST NORWOOD, MA 02062 USA Attn: David Fletcher Tel: (781)551-0656 E-Mail: david.r.fletcher@saint-gobain.com	System Volume: 5000 gal Bulk Operating Temp: 560F / 293C Heating Source: Blanket: Fluid: PETRO CANADA CALFLO AF Make: A.M.KINNEY	Lab No: 02345494 Analyst: Gaston Arseneault Sample Date: 03/19/20 Received Date: 03/24/20 Completed: 04/08/20 Gaston Arseneault gaston.arseneault@petrocanadalsp.com

Recommendation: This blend is 60% current oil + 40% fresh Calflo AF. The flash point improved from 307F to 383F and the low boilers also went down judging by the GCD 10% boiling temperature increasing from 692F to 714F.

Comments: (GCD) 90% Distillation Point is marginally high.




Sample Date	Received Date	Fluid Age	Sample Location	Flash Point (COC)	Water (KF)	Viscosity (40°C)	Acid Number	Solids	GCD 10%	GCD 50%	GCD 90%	GCD % < 335°C
	mm/dd/yy			°F/°C	ppm	cSt	mg/KOH/g	%wt	°F/°C	°F/°C	°F/°C	%
03/19/20	03/24/20	7y	UIP HEATER	383 / 195	10.0	28.6	0.045	0.089	715 / 379	803 / 428	907 / 486	0.00
03/19/20	03/24/20	7y	UIP HEATER	396 / 202	4.1	29.2	0.052	0.083	717 / 380	803 / 429	907 / 486	0.00
01/30/20	02/11/20	6y	DUPLEX FILTERS	442 / 228	18.6	74.0	0.245	0.106	696 / 369	792 / 422	896 / 480	0.78
01/30/20	02/11/20	17y	DUPLEX FILTERS	432 / 222	22.2	60.0	0.144	0.050	690 / 365	791 / 422	899 / 482	2.14
Baseline Data				435 / 224		32.7	0.03		693 / 367	790 / 421	887 / 475	2.5

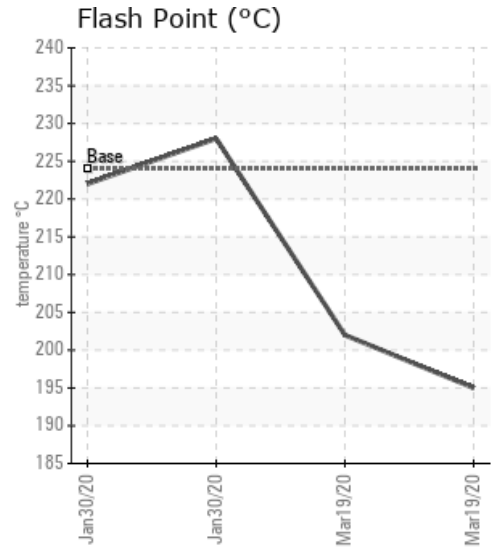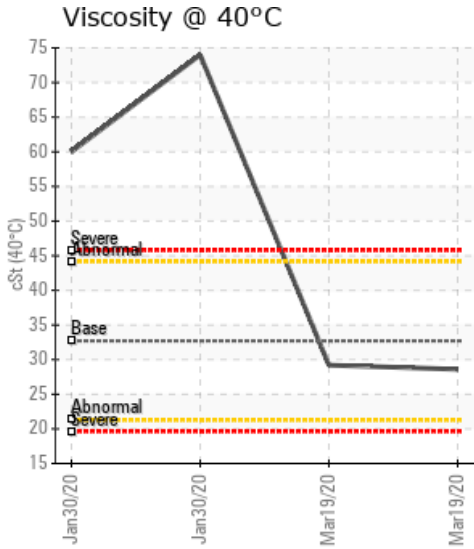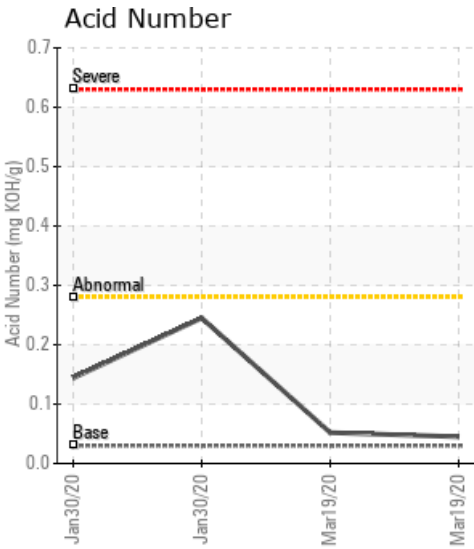

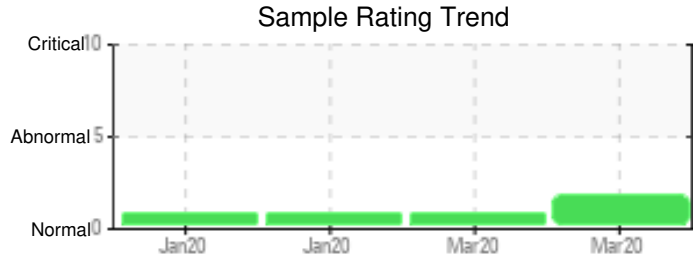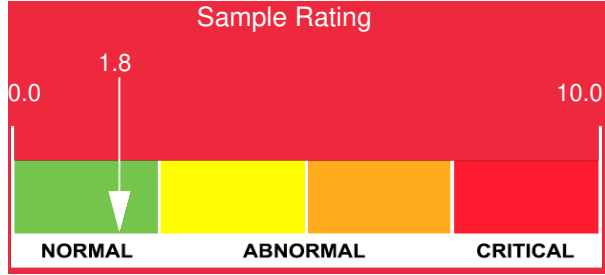

Sample Date	Iron	Chromium	Nickel	Aluminum	Copper	Lead	Tin	Cadmium	Silver	Vanadium	Silicon	Sodium	Potassium	Titanium	Molybdenum	Antimony	Manganese	Lithium	Boron	Magnesium	Calcium	Barium	Phosphorus	Zinc
03/19/20	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	120	0
03/19/20	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	145	0
01/30/20	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	48	0
01/30/20	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	40	0
Baseline Data			0	0						0			0	0					0				270	

Elemental analysis results (above) in parts per million (ppm). [10,000 ppm = 1.0%]

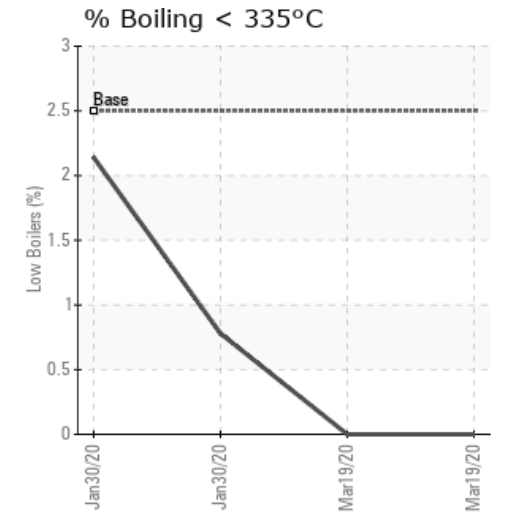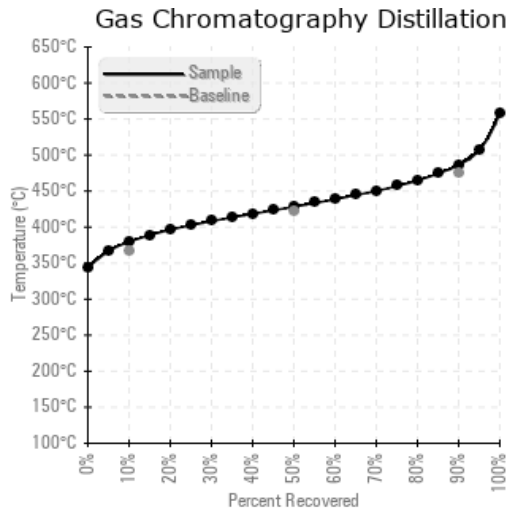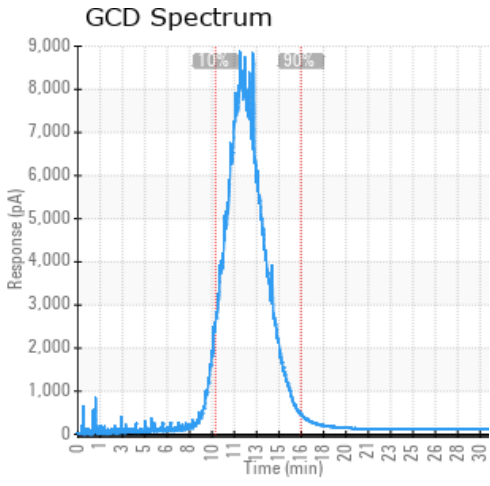

Historical Comments	
03/19/20	This blend is 50% current oil + 50% fresh Calflo AF. The flash point improved from 307F to 396F (the 40% Calflo AF addition raised the flash point to 383F). The low boilers also went down judging by the GCD 10% boiling temperature increasing from 692F to 716F (the 40% addition raised the GCD 10% to 714F). (GCD) 90% Distillation Point is marginally high.
01/30/20	Visc @ 40°C is severely high.
01/30/20	discard this sample, correct blend samples coming Visc @ 40°C is severely high.

Petro-Canada makes no representation or warranty of any kind, either express or implied, as to the accuracy or completeness of the analysis and assumes no responsibility and shall have no liability whatsoever with respect to such analysis, or a party's use of it. Petro-Canada is a division of HollyFrontier Corporation.