

## 2-11-80-16W6M 5500-1

### Customer: PTRHTF20156

TOURMALINE OIL 9920 98a Ave

FORT ST. JOHN, BC V1J 1S2 Canada

Attn: Brandon Braun Tel: (250)262-5420

E-Mail:

Brandon.braun@tourmalineoil.com

# System Information

System Volume: 15000 ltr

Bulk Operating Temp: 345F / 174C

Heating Source:

Blanket:

Fluid: PETRO CANADA PETRO-THERM

Make:

### Sample Information


Lab No: 02351289 Analyst: Clinton Buhler Sample Date: 04/28/20 Received Date: 04/29/20 Completed: 05/04/20

Clinton Buhler


Clinton.Buhler@PetroCanadaLSP.com

Recommendation: Sample results indicate that the heat transfer fluid is suitable for continued service. There is 301ppm of water which is not as high as unit 5500-2, but should be monitored. Please ensure sample point and hardware is thoroughly purged before obtaining fluid sample. Please re-sample in 12 months.

#### Comments:

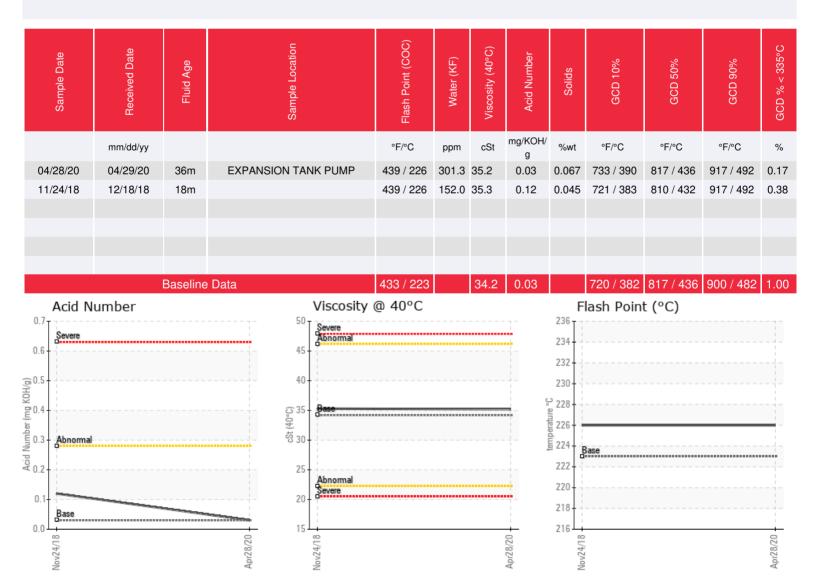

Report ID: [02351289] (Generated: 05/04/2020 12:51:04) - Page 1 - Copyright 2020 Wearcheck Inc. All Rights Reserved.

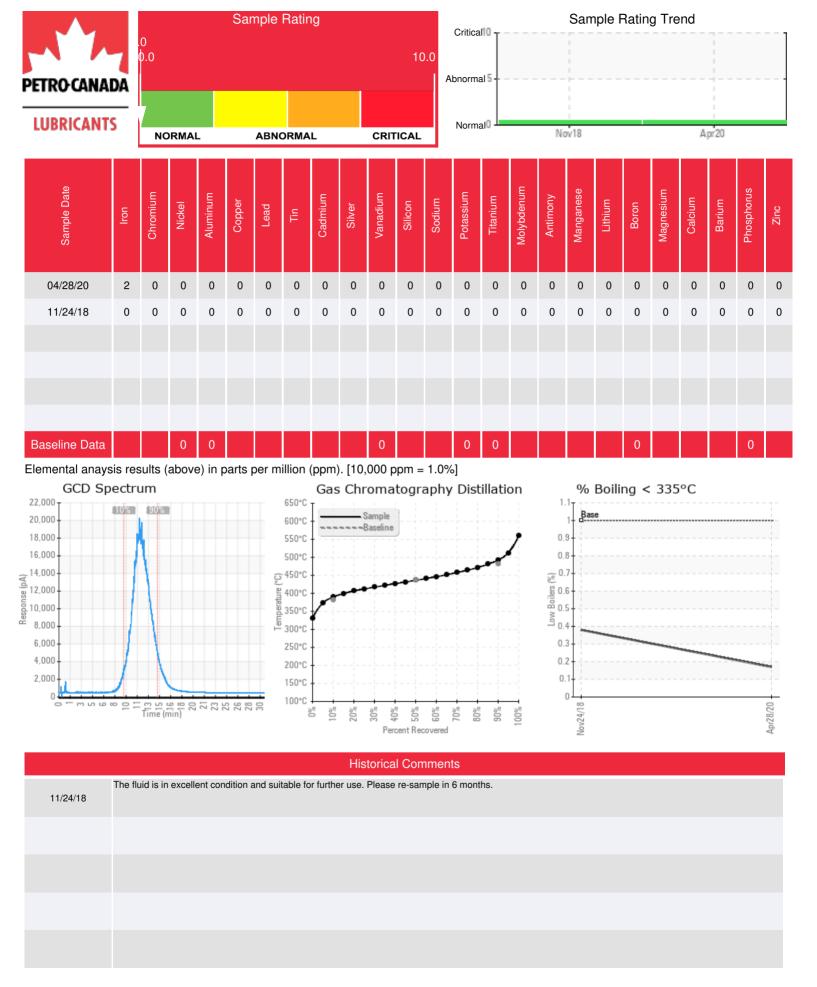

Petro-Canada makes no representation or warranty of any kind, either express or implied, as to the accuracy or completeness of the analysis and assumes no responsibility and shall have no liability whatsoever with respect to such analysis, or a party's use of it. Petro-Canada is a division of HollyFrontier Corporation.