




PHASE 2


Customer: PTRHTF10092	System Information	Sample Information
REC GROUP 119410 RICK JONES WAY BUTTE (SILVER BOW), MT 59750 USA Attn: ZACK KELLY Tel: (406)496-9717 E-Mail: zack.kelly@recgroup.com	System Volume: 41640 gal Bulk Operating Temp: 425F / 218C Heating Source: Blanket: Fluid: PETRO CANADA CALFLO AF Make: EXOTHERM	Lab No: 02356546 Analyst: Ron LeBlanc Sample Date: 05/13/20 Received Date: 05/29/20 Completed: 06/09/20 Ron LeBlanc Ronald.LeBlancSr@petrocanadalsp.com

Recommendation: Sample appears normal. Sample at regular interval.

Comments:




Sample Date	Received Date	Fluid Age	Sample Location	Flash Point (COC)	Water (KF)	Viscosity (40°C)	Acid Number	Solids	GCD 10%	GCD 50%	GCD 90%	GCD % < 335°C
	mm/dd/yy			°F/°C	ppm	cSt	mg/KOH/g	%wt	°F/°C	°F/°C	°F/°C	%
05/13/20	05/29/20	0y	P-2712A	421 / 216	24.6	31.1	0.03	0.119	698 / 370	793 / 423	882 / 472	1.56
10/11/19	11/04/19	0y	PH 2 HOT OIL TANK	406 / 208	0.5	24.0	0.026	0.127	678 / 359	777 / 414	871 / 466	2.60
05/21/19	06/05/19	0y		410 / 210	11.1	30.9	0.035	0.084	691 / 366	789 / 421	884 / 473	1.64
01/04/19	01/25/19	0y		421 / 216	12.4	30.9	0.01	0.041	665 / 352	763 / 406	858 / 459	3.99
09/21/18	10/10/18	0y		417 / 214	8.4	30.8	0.01	0.029	698 / 370	785 / 419	877 / 469	0.00
Baseline Data				435 / 224		32.7	0.03		693 / 367	790 / 421	887 / 475	2.5

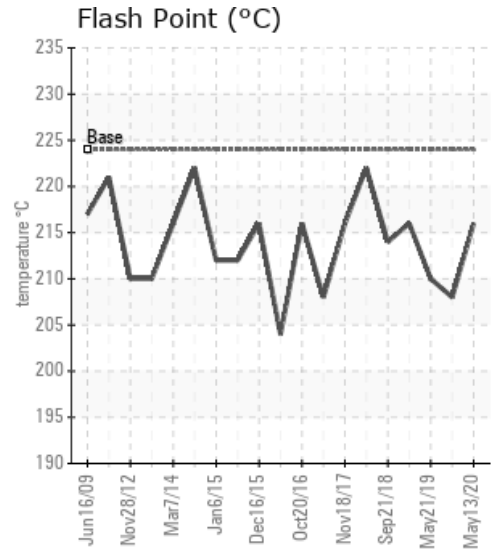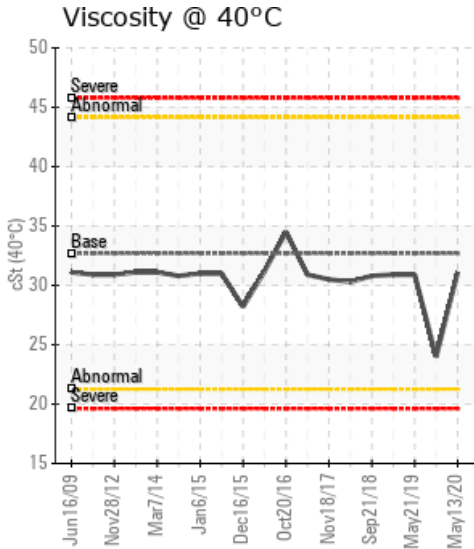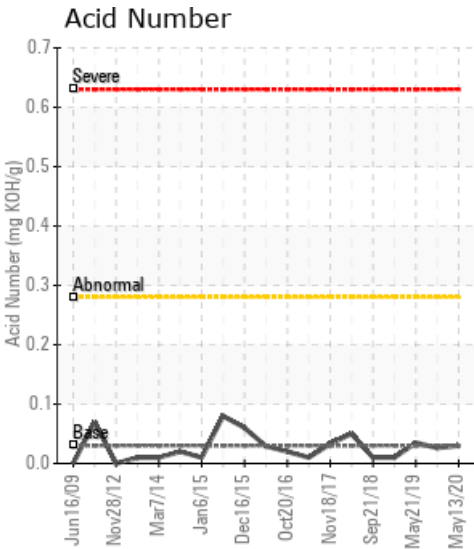

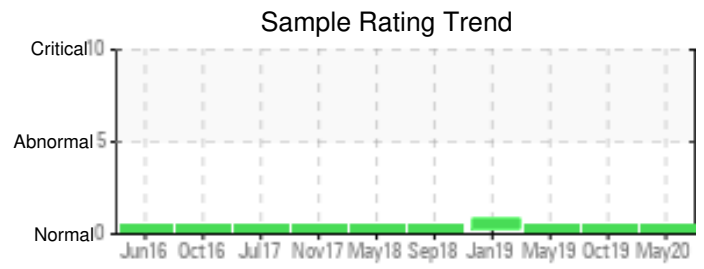

Sample Date	Iron	Chromium	Nickel	Aluminum	Copper	Lead	Tin	Cadmium	Silver	Vanadium	Silicon	Sodium	Potassium	Titanium	Molybdenum	Antimony	Manganese	Lithium	Boron	Magnesium	Calcium	Barium	Phosphorus	Zinc
05/13/20	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	7	0
10/11/19	2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	7	0
05/21/19	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	7	0
01/04/19	2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	8	0
09/21/18	2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	8	0
Baseline Data			0	0						0			0	0					0				270	

Elemental analysis results (above) in parts per million (ppm). [10,000 ppm = 1.0%]

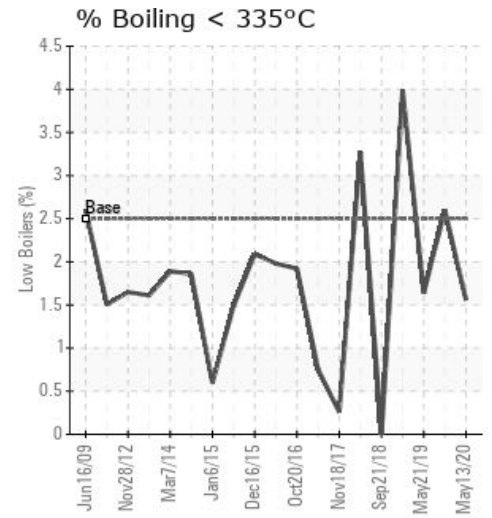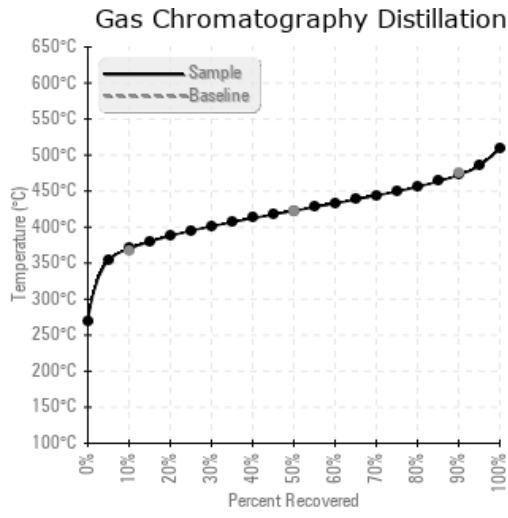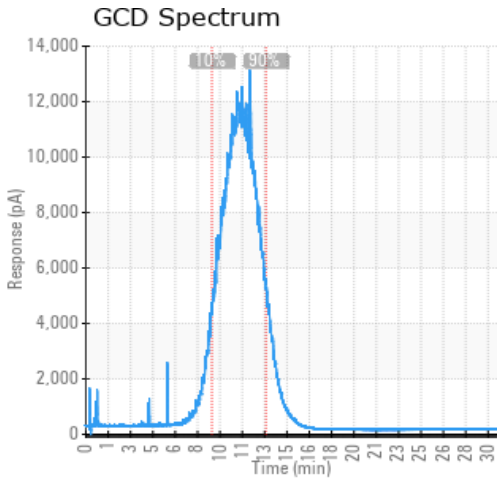

Historical Comments

10/11/19	Oil appears normal. Sample in 6 months.
05/21/19	Sample appears normal. Re-sample at normal interval.
01/04/19	(GCD) 90% Distillation Point has dropped from previous sample. Pentane insolubles have increased from previous sample. Take another sample in 1 month. (GCD) 90% Distillation Point is abnormally low.
09/21/18	Sample appears normal. Re-Sample at next scheduled date.

Petro-Canada makes no representation or warranty of any kind, either express or implied, as to the accuracy or completeness of the analysis and assumes no responsibility and shall have no liability whatsoever with respect to such analysis, or a party's use of it. Petro-Canada is a division of HollyFrontier Corporation.