


HEAT TRANSFER


Customer: PTRHTF30101	System Information	Sample Information
Roseburg Pembroke MDF Inc.	System Volume: 100000 ltr	Lab No: 02365086
777 Fibreboard Drive	Bulk Operating Temp: 518F / 270C	Analyst: Pierre Castagne
Pembroke, ON K8A 6W5 Canada	Heating Source:	Sample Date: 07/09/20
Attn: Dan Havis	Blanket:	Received Date: 07/16/20
Tel: (613)732-3939	Fluid: PETRO CANADA PETRO-THERM	Completed: 08/04/20
E-Mail: danielh@rfpco.com	Make:	Pierre Castagne
·		pierre.castagne@hollyfrontier.com


Recommendation: The Potassium level are severly high, Acid Number (AN) is high, GCD @ 90% is high, GCD % <335C is high, Pentane Insolubles is high. With the high level of Potassium, we suspect product contamination, please verify the possible source of contamination. There is some thermal degradation of the oil. Re-sample the oil at regular sample date.

Comments: Potassium ppm levels are severely high. Acid Number (AN) is abnormally high. (GCD) 90% Distillation Point is marginally high.

Sample Date	Received Date	Fluid Age	Sample Location	Flash Point (COC)	Water (KF)	Viscosity (40°C)	Acid Number	Solids	GCD 10%	GCD 50%	GCD 90%	GCD % < 335°C
	mm/dd/yy			°F/°C	ppm	cSt	mg/KOH/ g	%wt	°F/°C	°F/°C	°F/°C	%
07/09/20	07/16/20	10.0y	hp line at main pump	435 / 224	268.6	37.2	0.32	0.348	718 / 381	815 / 435	922 / 495	2.35
01/31/20	02/05/20	0.0y	H.P. PUMPS	421 / 216	298.7	38.2	0.434	0.924	699 / 370	785 / 418	887 / 475	0.00
10/30/17	11/02/17	0.0y		421 / 216	41.0	37.5	0.08	0.227	714 / 379	812 / 434	924 / 496	0.91
05/12/17	05/15/17	0.0y		399 / 204	40.9	37.1	0.04	0.111	714 / 379	821 / 439	944 / 507	2.09
05/11/17	05/15/17	0.0y		414 / 212	34.9	37.0	0.05	0.083	714 / 379	822 / 439	949 / 510	2.05

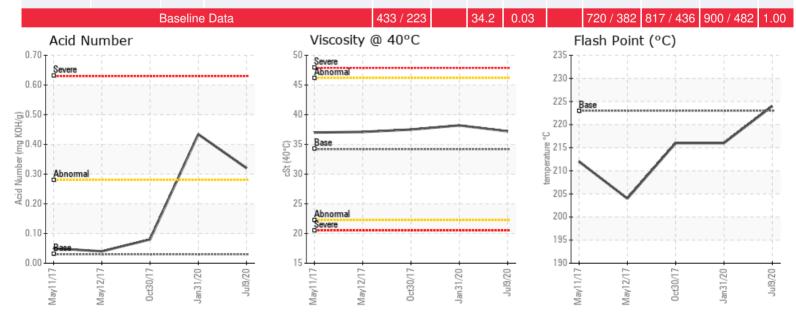

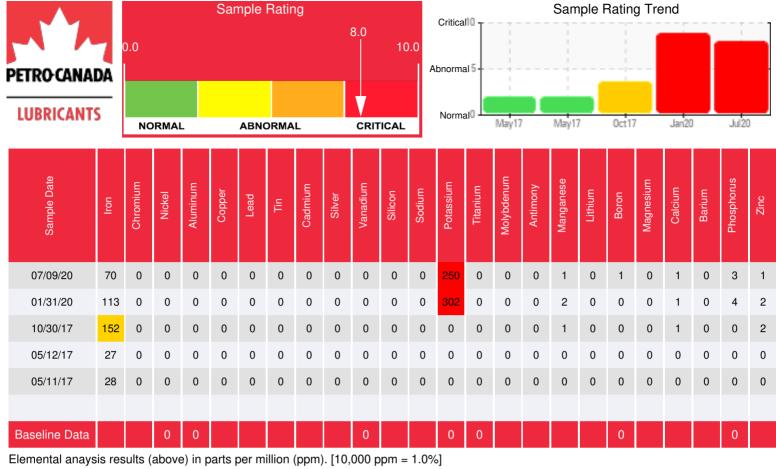

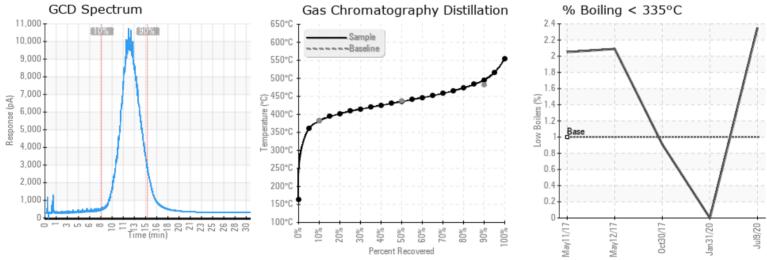

Historical Comments

01/31/20	Potassium PPM levels are severely high. Pentane Insoluble are severely high. Acid number (AN) is abnormal high. Resample to confirm finding. Potassium ppm levels are severely high. Pentane Insolubles levels are severely high. Acid Number (AN) is abnormally high.
10/30/17	Apart for high Iron, the sample looks goodPQ levels are abnormal. Iron ppm levels are abnormal. (GCD) 90% Distillation Point is marginally high.
05/12/17	GCD @ 90% are very high, this impacts the viscosity and carbone deposit (GCD) 90% Distillation Point is severely high.
05/11/17	GCD @ 90% are very high, this impacts the viscosity and carbon deposits (GCD) 90% Distillation Point is severely high.

Petro-Canada makes no representation or warranty of any kind, either express or implied, as to the accuracy or completeness of the analysis and assumes no responsibility and shall have no liability whatsoever with respect to such analysis, or a party's use of it. Petro-Canada is a division of HollyFrontier Corporation.