



## THERMAL ENERGY PLANT

## Customer: PTRHTF20179

Canfor - Polar 36654 Hart Highway General Delivery

Bear Lake, BC V0J 3G0 Canada

Attn: Kevin Meise Tel: (250)552-5028

E-Mail: kevin.meise@canfor.com

## System Information

System Volume: 0 gal

Bulk Operating Temp: 446F / 230C

Heating Source:

Blanket:

Fluid: PETRO CANADA PETRO-THERM

Make: DELTECH

## Sample Information


Lab No: 02395153 Analyst: Ray Rolston Sample Date: 12/17/20 Received Date: 12/29/20 Completed: 01/20/21


Ray Rolston

Ray.Rolston@petrocanadalsp.com

Recommendation: Petro-Therm fluid age is reported to be 10 years. System volume is unknown. There are no previous sample results available to monitor trends. The water content is externely high at 9.697% which is 96972 ppm. Free water is reported to be 0.2% or 2000 ppm, and emulsified water is >10%. Recommend that another more representative sample be drawn and submitted to the lab for analysis. The AN (Acid Number) is externely high at 4.42 mg KOH/g. AN test was re-run to verify accuracy; the results were 4.42 and 4.21 mg KOH/g. Once again, please obtain a sample that is representative of the Petro-Therm that is circulating through the heat transfer system and submit for analysis. All other test results appear to be normal.

Comments: Water contamination levels are severely high. Water contamination levels are severely high.. ppm Water contamination levels are severely high. Acid Number (AN) is severely high.

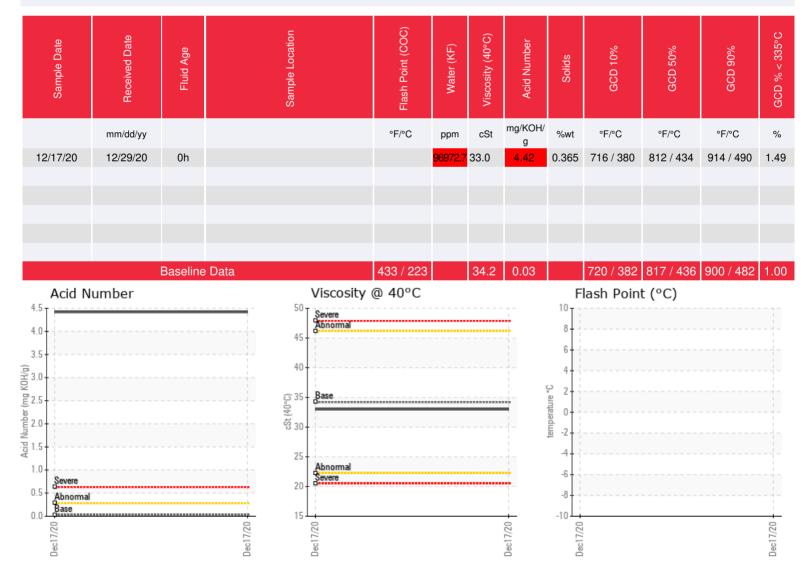

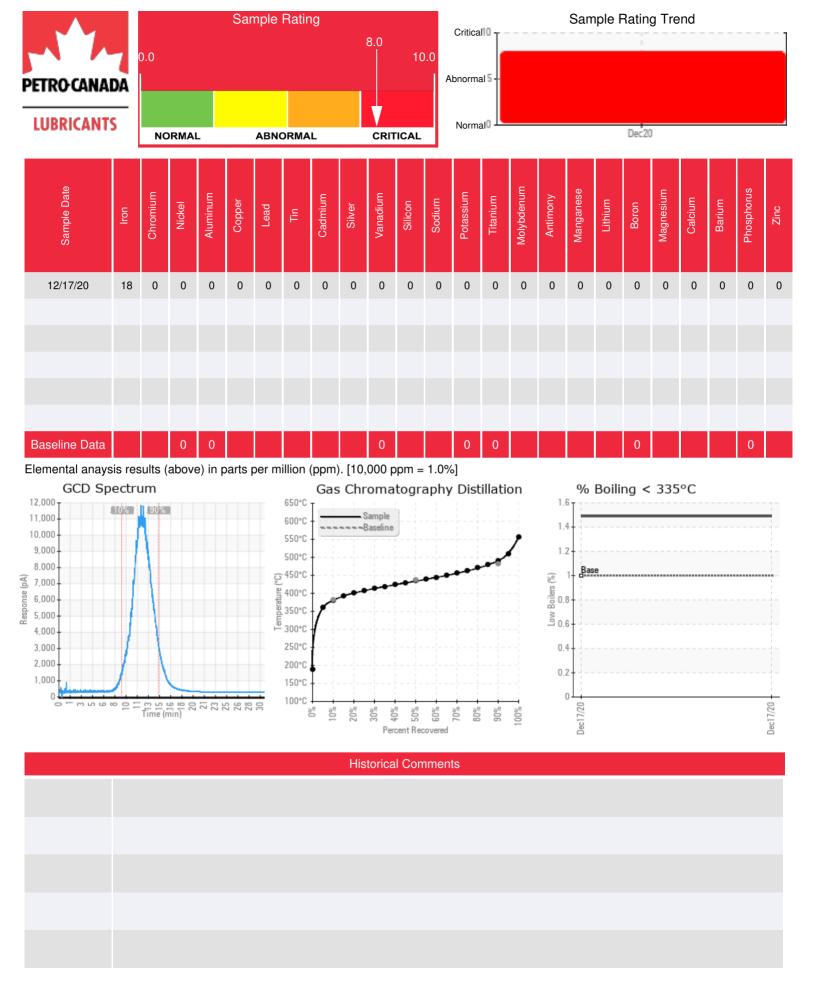

Petro-Canada makes no representation or warranty of any kind, either express or implied, as to the accuracy or completeness of the analysis and assumes no responsibility and shall have no liability whatsoever with respect to such analysis, or a party's use of it. Petro-Canada is a division of HollyFrontier Corporation.