




## THERMISCHE OLIE SITE B



Customer: PTRHTF40045	System Information	Sample Information
OVI NV SA HOOGBUUL 1 OLEN 2250 OLEN, 2250 Belgium Attn: Philippe Vanreusel Tel: 3(201)421-3051 E-Mail: Philippev@ovi.be	System Volume: 6200 ltr Bulk Operating Temp: 536F / 280C Heating Source: Blanket: Fluid: PETRO CANADA PURITY FG HEAT TRANSFER FLUID Make: WANSON	Lab No: 02398199 Analyst: Matthias Voss Sample Date: 01/06/21 Received Date: 01/18/21 Completed: 01/20/21 Matthias Voss Matthias.Voss@petrocanadalsp.com

Recommendation: Fluid fit for further use. Please send in next sample at next service interval.

Comments: (GCD) 90% Distillation Point is abnormally high.




Sample Date	Received Date	Fluid Age	Sample Location	Flash Point (COC)	Water (KF)	Viscosity (40°C)	Acid Number	Solids	GCD 10%	GCD 50%	GCD 90%	GCD % < 335°C
	mm/dd/yy			°F/°C	ppm	cSt	mg/KOH/g	%wt	°F/°C	°F/°C	°F/°C	%
01/06/21	01/18/21	1w	REAR FLOW COLLECTOR	446 / 230	62.3	32.8	0.95	0.113	725 / 385	825 / 441	924 / 496	2.21
Baseline Data				459 / 237		37.12	0.90		721 / 383	807 / 431	892 / 478	1.5

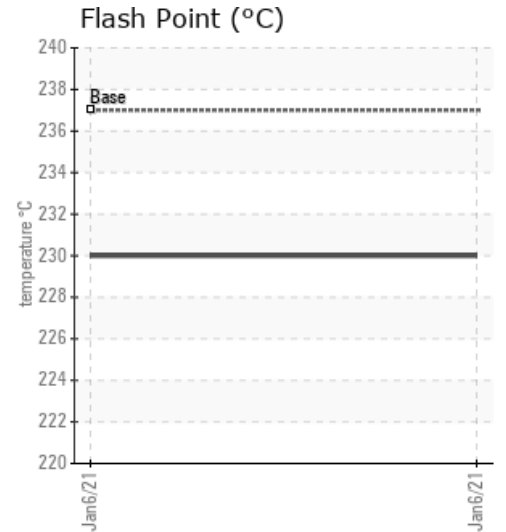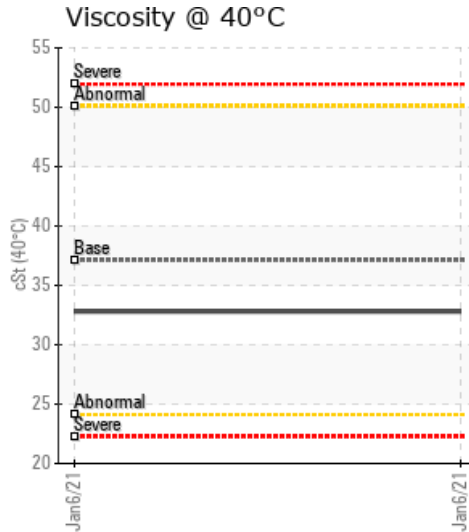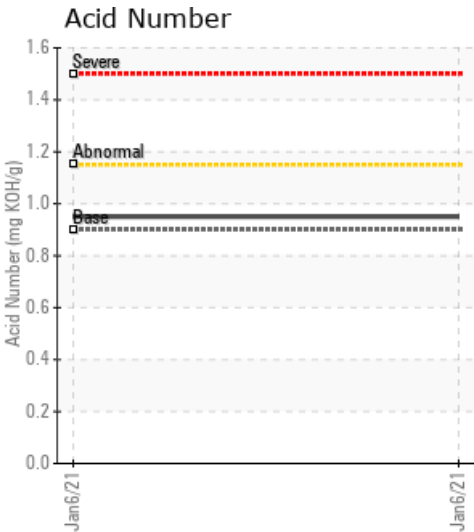

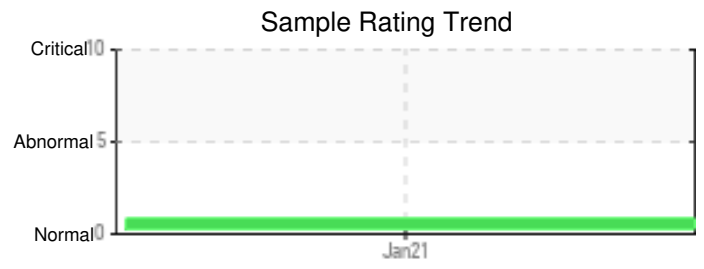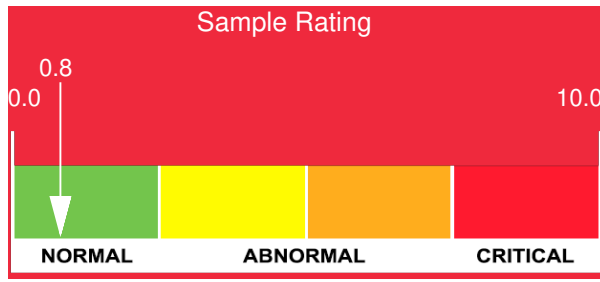

Sample Date	Iron	Chromium	Nickel	Aluminum	Copper	Lead	Tin	Cadmium	Silver	Vanadium	Silicon	Sodium	Potassium	Titanium	Molybdenum	Antimony	Manganese	Lithium	Boron	Magnesium	Calcium	Barium	Phosphorus	Zinc
01/06/21	8	0	0	0	0	0	0	0	0	0	4	0	0	0	0	0	0	0	0	0	0	0	90	0
<b>Baseline Data</b>			0	0						0			0	0				0	0				230	

Elemental analysis results (above) in parts per million (ppm). [10,000 ppm = 1.0%]

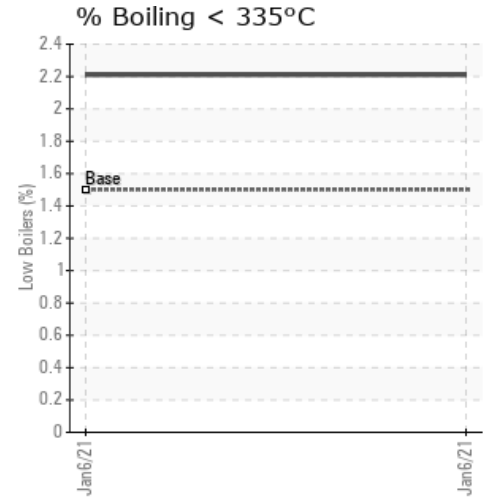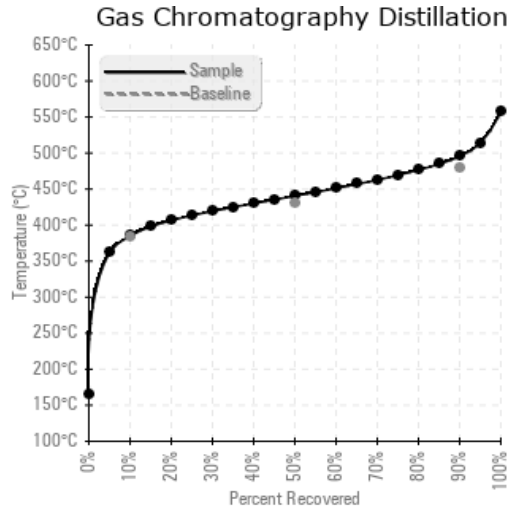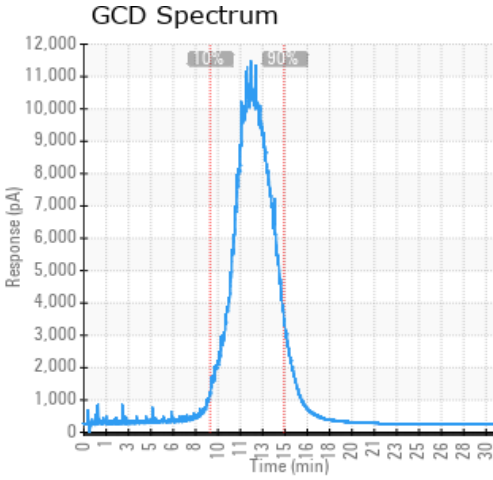

### Historical Comments


Petro-Canada makes no representation or warranty of any kind, either express or implied, as to the accuracy or completeness of the analysis and assumes no responsibility and shall have no liability whatsoever with respect to such analysis, or a party's use of it. Petro-Canada is a division of HollyFrontier Corporation.