

## [STORM RESOURCES / D-39-D/94-H-3] H-4030

**Customer: PTRHTF20175**  
 QUADRA CHEMICALS  
 7802 98 STREET  
 CLAIRMONT, AB T0H 0W0 Canada  
 Attn: Quadra Samples  
 Tel:  
 E-Mail: quadra\_samples@quadra.ca




**System Information**  
 System Volume: 14000 ltr  
 Bulk Operating Temp: 518F / 270C  
 Heating Source:  
 Blanket:  
 Fluid: PETRO CANADA PETRO-THERM  
 Make: ALCO



**Sample Information**  
 Lab No: 02426839  
 Analyst: Clinton Buhler  
 Sample Date: 06/08/21  
 Received Date: 06/14/21  
 Completed: 06/28/21  
 Clinton Buhler  
 Clinton.Buhler@hollyfrontier.com

Recommendation: Sample results indicate that oxidative fluid degradation is ongoing based on elevated fluid viscosity and Acid Number; fluid acidity may be contributing to corrosion as noted in iron content increase. Elevated solids content of 0.932% may be associated to oxidation but may also be related to thermal degradation (see low boiling vapor content increase to 3.49%). Please ensure blanket gas is properly operational. For large systems, it is generally advised to sweeten the system when acid number reaches ~0.4. Before doing this, another sample should be taken to confirm results. Please ensure that the sample is taken from pump discharge and that the sample valve and tubing is thoroughly purged before gathering a sample.

Comments: Pentane Insolubles levels are severely high. Acid Number (AN) is abnormally high. Visc @ 40°C is abnormally high.




Sample Date	Received Date	Fluid Age	Sample Location	Flash Point (COC)	Water (KF)	Viscosity (40°C)	Acid Number	Solids	GCD 10%	GCD 50%	GCD 90%	GCD % < 335°C
	mm/dd/yy			°F/°C	ppm	cSt	mg/KOH/g	%wt	°F/°C	°F/°C	°F/°C	%
06/08/21	06/14/21	0.0m	C/S REBOILER	453 / 234	319.9	47.8	0.32	0.932	700 / 371	798 / 426	908 / 486	3.49
05/11/21	05/26/21	5.0m	Reboiler	446 / 230	51.4	47.4	0.97	1.40	701 / 372	798 / 426	922 / 494	3.38
01/21/19	02/01/19	12.0m		450 / 232	157.0	43.2	0.410	0.241	706 / 375	792 / 422	892 / 478	0.36
05/06/18	07/10/18	18.0m		432 / 222	159.7	35.8	0.289	0.210	718 / 381	810 / 432	907 / 486	1.33
Baseline Data				433 / 223		34.2	0.03		720 / 382	817 / 436	900 / 482	1.00

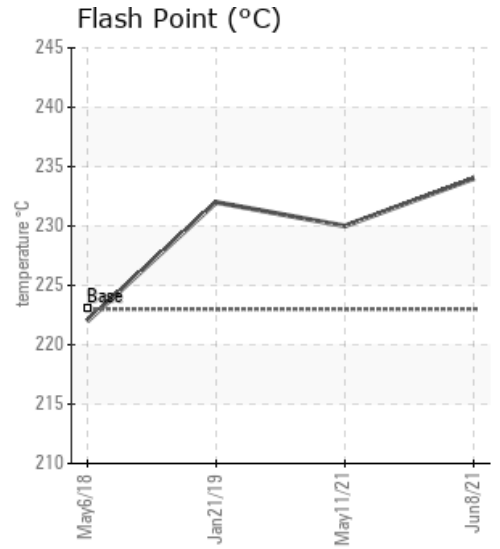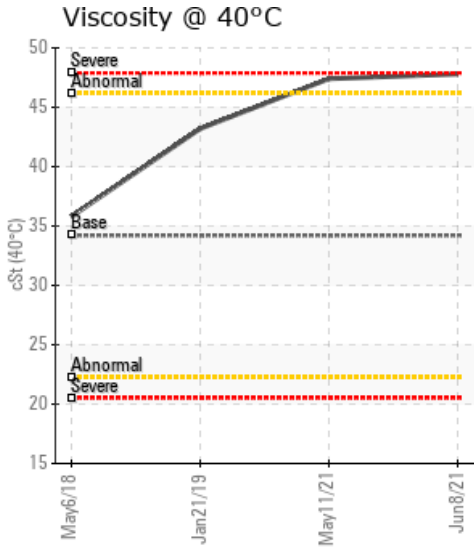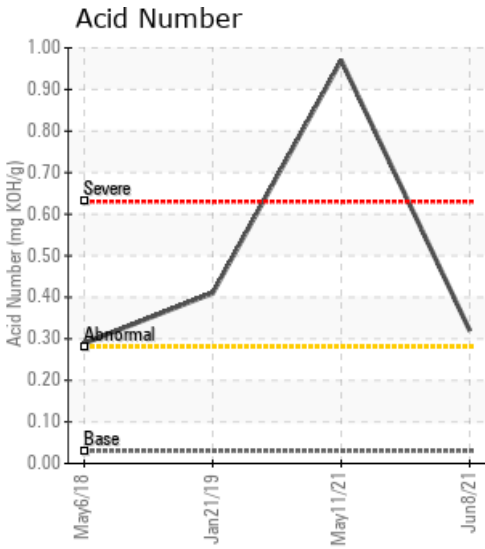

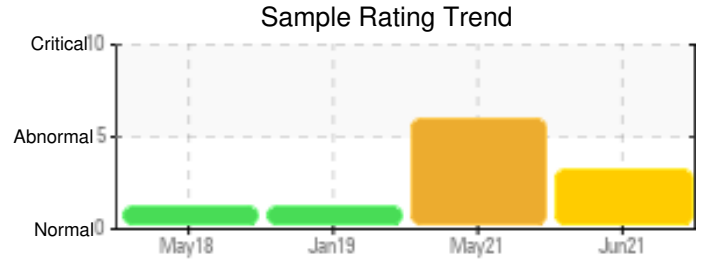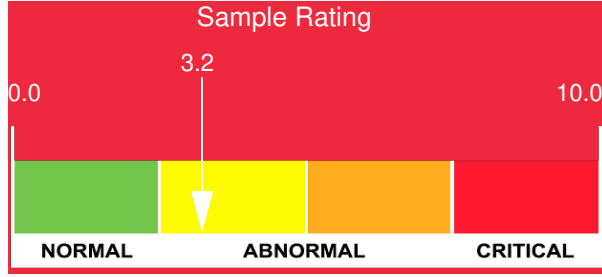

Sample Date	Iron	Chromium	Nickel	Aluminum	Copper	Lead	Tin	Cadmium	Silver	Vanadium	Silicon	Sodium	Potassium	Titanium	Molybdenum	Antimony	Manganese	Lithium	Boron	Magnesium	Calcium	Barium	Phosphorus	Zinc
06/08/21	51	0	0	0	0	0	0	0	0	0	0	0	0	2	0	0	0	0	0	0	4	0	0	0
05/11/21	21	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
01/21/19	96	0	0	0	0	0	0	0	0	0	15	0	0	0	0	0	0	0	0	0	0	0	0	0
05/06/18	11	0	0	0	0	0	0	0	0	0	20	0	0	0	0	0	0	0	0	0	0	0	0	0
Baseline Data			0	0						0			0	0					0				0	

Elemental analysis results (above) in parts per million (ppm). [10,000 ppm = 1.0%]

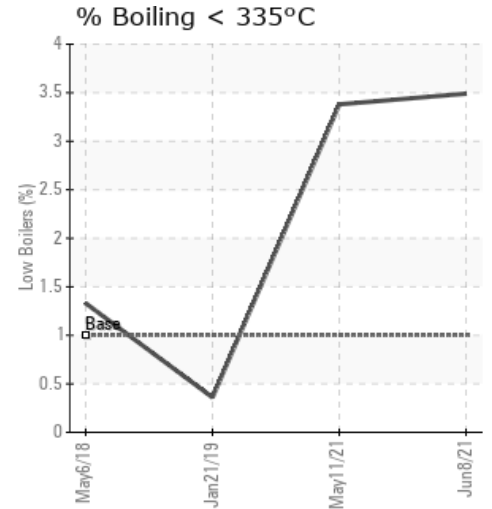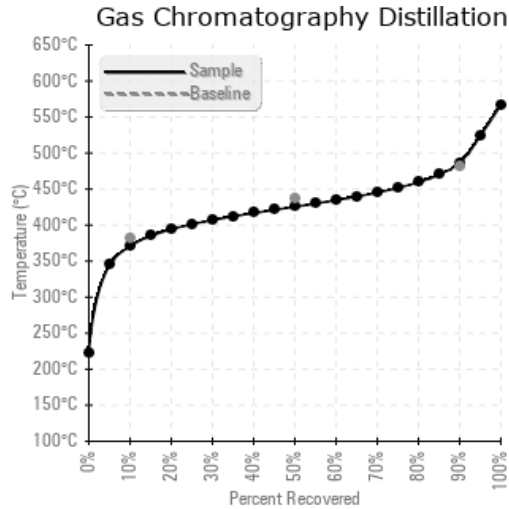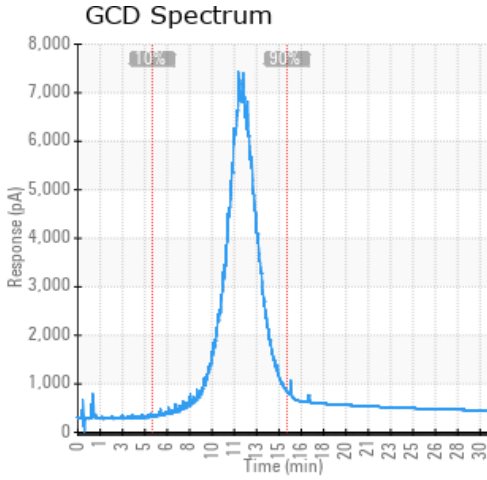

### Historical Comments

05/11/21	Sample results indicate that the rate of fluid degradation by oxidation has increased since last analysis. Acid Number is at 0.97 (sweetening is recommended ~0.4) and the increase in fluid viscosity, 90% GCD and solids content supports this. It is recommended to make plans to clean system and replace with fresh fluid as oxidation and system fouling can begin to increase exponentially if left. It is critical that blanket gas is properly operation on top of the system's expansion tank to reduce/prevent fluid oxidation. Please contact Petro-Canada's Technical Services to discuss further
01/21/19	Sample results indicate that the fluid's acidity is increasing as evidenced by the increase in Acid Number as well as the increased viscosity. These two values may indicate ongoing oxidation. The increase in Iron levels may also indicate that corrosion is ongoing. Consider sweetening of the system to reduce the level of acidity and possible related system corrosion. Ensure blanket gas is operational to reduce the rate of oxidation. Re-sample once sweetening completed. Acid Number (AN) is abnormally high.
05/06/18	sample results indicate that the heat transfer fluid is suitable for continued service. Please note Acid Number at 0.289. This can be an indication of oxidation. Please ensure blanket gas is operational. Iron at 11 ppm can be associated to Acid Number (possible corrosion). Silicon at 20 ppm; this can be from dirt/dust in the system. Please ensure system is sealed from outside contaminants and that fluid transfer devices and hoses are clean. % boil off <335C can be an indication of thermal degradation. As part of a sound maintenance program, periodic venting of low boiling vapors is beneficial. Re-sample in 6-12 months

Petro-Canada makes no representation or warranty of any kind, either express or implied, as to the accuracy or completeness of the analysis and assumes no responsibility and shall have no liability whatsoever with respect to such analysis, or a party's use of it. Petro-Canada is a division of HollyFrontier Corporation.