




WANSON BH/INC 1200



Customer: PTRHTF40127	System Information	Sample Information
Dalco Foods B.V Everdenberg 50 Oosterhout, 4902TT Netherlands Attn: Wilbert Snijers Tel: E-Mail: w.snijers@klt.nl	System Volume: 4200 gal Bulk Operating Temp: 518F / 270C Heating Source: Blanket: Fluid: PETRO CANADA PURITY FG HEAT TRANSFER FLUID Make: WANSON	Lab No: 02436771 Analyst: Bill Quesnel CLS,OMA II,MLA-III,LLA-I Sample Date: 07/30/21 Received Date: 08/04/21 Completed: 08/10/21 Bill Quesnel CLS,OMA II,MLA-III,LLA-I

Recommendation: Flash Point (COC) is very low and off specification. Recommend venting the system in order to reduce number of low boilers and recover flash point.

Comments: COC Flash Point is severely low. (GCD) 10% Distillation Point is abnormally low. (GCD) % < 335°C is marginally high.




Sample Date	Received Date	Fluid Age	Sample Location	Flash Point (COC)	Water (KF)	Viscosity (40°C)	Acid Number	Solids	GCD 10%	GCD 50%	GCD 90%	GCD % < 335°C
	mm/dd/yy			°F/°C	ppm	cSt	mg/KOH/g	%wt	°F/°C	°F/°C	°F/°C	%
07/30/21	08/04/21	3.3y		313 / 156	26.1	25.1	0.32	0.136	647 / 341	797 / 425	896 / 480	8.86
04/07/21	04/13/21	3.0y		306 / 152	22.8	23.0	0.26	0.128	592 / 311	788 / 420	908 / 486	11.83
11/02/20	11/09/20	2.5y		298 / 148	9.6	24.6	0.30	0.136	649 / 343	798 / 425	899 / 482	8.68
04/10/20	04/17/20	1.9y		324 / 162	19.3	25.7	0.28	0.065	677 / 358	800 / 427	898 / 481	6.44
11/14/19	11/26/19	1.5y		338 / 170	10.4	25.9	0.284	0.106	616 / 325	780 / 416	883 / 473	10.68
Baseline Data				459 / 237		37.12	0.90		721 / 383	807 / 431	892 / 478	1.5

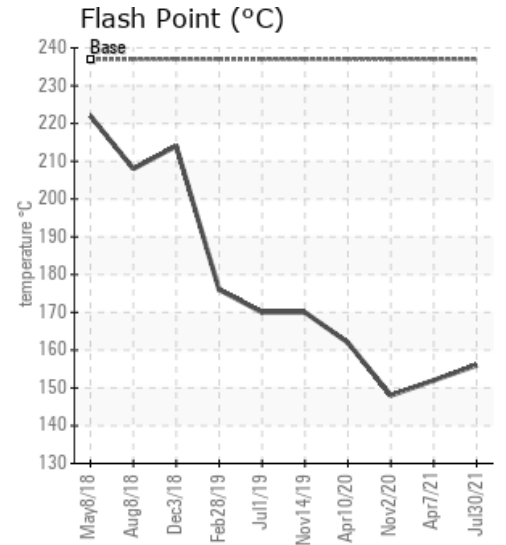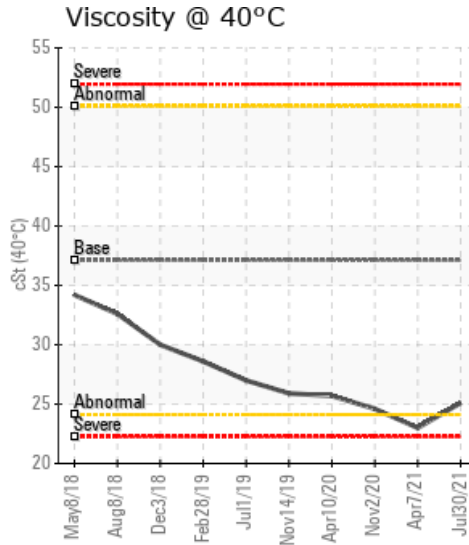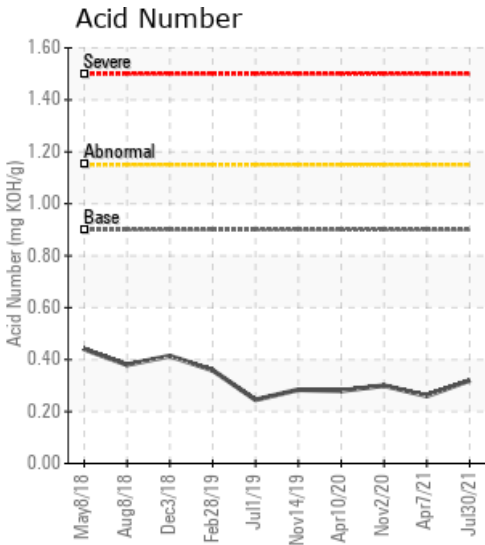

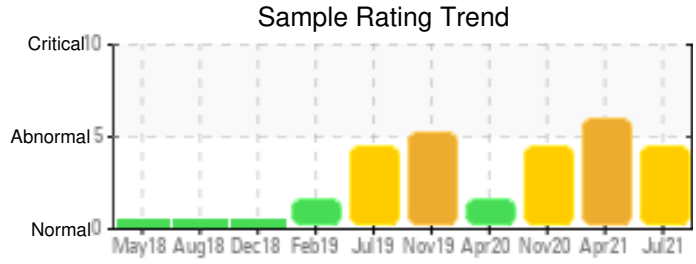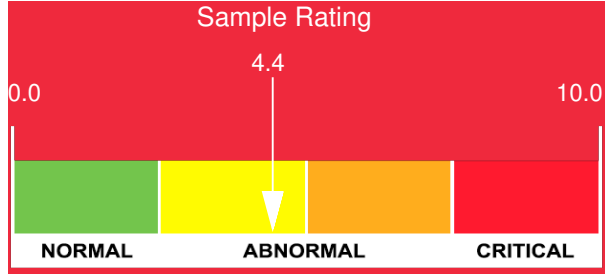

Sample Date	Iron	Chromium	Nickel	Aluminum	Copper	Lead	Tin	Cadmium	Silver	Vanadium	Silicon	Sodium	Potassium	Titanium	Molybdenum	Antimony	Manganese	Lithium	Boron	Magnesium	Calcium	Barium	Phosphorus	Zinc
07/30/21	16	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	34	0
04/07/21	12	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	22	0
11/02/20	19	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	32	0
04/10/20	4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	25	0
11/14/19	3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	30	0
Baseline Data			0	0						0			0	0				0	0				230	

Elemental analysis results (above) in parts per million (ppm). [10,000 ppm = 1.0%]

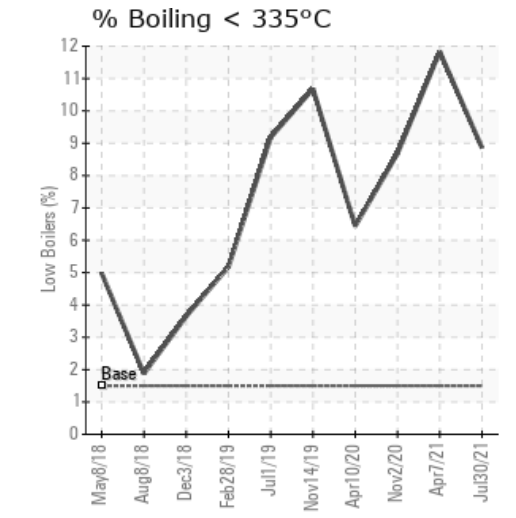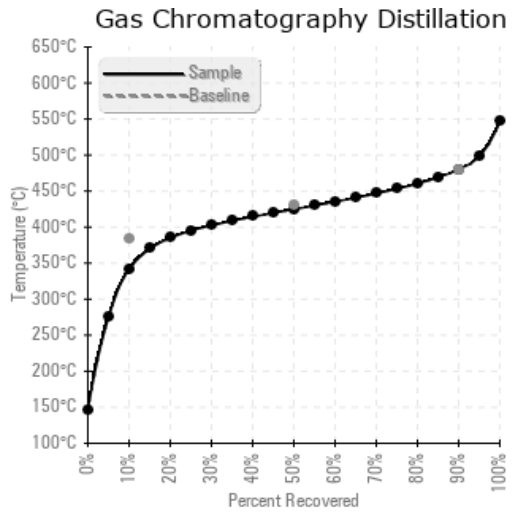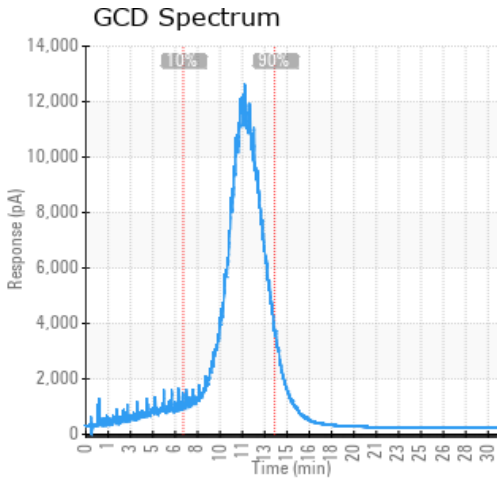

Historical Comments	
04/07/21	Flash Point continues to be very low. Viscosity has decreased and evidence of cracking of the oil. Viscosity reduction is consistent and the value is distant from what we expect to see, it supports the theory of lower viscosity molecules being produced. Please try safe venting and check for recovery. Several warnings now on flash point and if recovery attempts have failed, recommend to look towards change. (GCD) 10% Distillation Point is severely low. COC Flash Point is severely low. (GCD) % < 335°C is abnormally high. Visc @ 40°C is abnormally low.
11/02/20	Flash Point (COC) is very low and off specification. Recommend venting the system in order to reduce number of low boilers and recover flash point. COC Flash Point is severely low. (GCD) % < 335°C is marginally high. (GCD) 10% Distillation Point is marginally low.
04/10/20	Whilst sample rating looks to have recovered, other parameters, namely Flash Point and viscosity continue to decline. Viscosity has decreased and evidence of cracking of the oil (shape of curve), also reducing flash point. Please try safe venting and check for recovery. Otherwise, operating at 270C is well above the current flash point which has reduced down to 162C. Several warnings now on flash point and if recovery attempts have failed, recommend to look towards change. Viscosity reduction is consistent and the value is distant from what we expect to see, it supports the theory of lower viscosity molecules being produced. COC Flash Point is severely low.
11/14/19	Sample continues to deteriorate. How long has the system been running as there are inconsistent values of age input against previous samples. Viscosity has decreased and evidence of cracking of the oil (shape of curve), also reducing flash point and 10% distillation. Please try safe venting and check for recovery. Otherwise, operating at 270C is well above the current flash point which has reduced down to 170C. Recommended venting and re-sample to check recovery. If continues to deteriorate look towards a change. Please, again, clarify the actual operating time as the sequence does not make sense in previous samples (GCD) 10% Distillation Point is severely low. COC Flash Point is severely low. (GCD) % < 335°C is marginally high.

Petro-Canada makes no representation or warranty of any kind, either express or implied, as to the accuracy or completeness of the analysis and assumes no responsibility and shall have no liability whatsoever with respect to such analysis, or a party's use of it. Petro-Canada is a division of HollyFrontier Corporation.