

[ATHABASCA OIL CORP / 05-27-078-10W4M] L3 (PAD C) LIESMER

Customer: PTRHTF20133
 ATHABASCA OIL CORP.
 LEISMER DEMONSTRATION PLANT
 LSD2-79-10-W4M
 NEAR CONKLIN, AB Canada
 Attn: George Ball
 Tel: (587)233-1312
 E-Mail: gball@atha.com




System Information
 System Volume: 8000 ltr
 Bulk Operating Temp: 212F / 100C
 Heating Source:
 Blanket:
 Fluid: PETRO CANADA CALFLO LT
 Make: TORNADO TECHNOLOGIES


Sample Information
 Lab No: 02470278
 Analyst: Terry Veenstra
 Sample Date: 01/21/22
 Received Date: 02/04/22
 Completed: 02/07/22
 Terry Veenstra
 terry.veenstra@hollyfrontier.com

Recommendation: Fluid is in good condition and suitable for continued use. Resample in 6 months.

Comments:




Sample Date	Received Date	Fluid Age	Sample Location	Flash Point (COC)	Water (KF)	Viscosity (40°C)	Acid Number	Solids	GCD 10%	GCD 50%	GCD 90%	GCD % < 335°C
	mm/dd/yy			°F/°C	ppm	cSt	mg/KOH/g	%wt	°F/°C	°F/°C	°F/°C	%
01/21/22	02/04/22	0.0y	system header	345 / 174	5.1	7.6	0.07	0.015	610 / 321	644 / 340	734 / 390	43.55
07/29/21	08/10/21	0.0y	pit 12c 0285	352 / 178	13.7	7.6	0.08	0.037	613 / 323	642 / 339	732 / 389	41.08
02/03/21	02/24/21	0.0y	bottom of tracer tre	360 / 182	27.0	7.5	0.11	0.125	611 / 322	643 / 339	737 / 391	43.31
08/12/20	08/31/20	0.0y	OT0285	338 / 170	6.3	7.4	0.12	0.043	612 / 322	643 / 340	735 / 391	42.84
01/16/20	02/10/20	0.0y	HORM-12C-0001-001	352 / 178	6.6	7.5	0.072	0.092	582 / 306	616 / 324	700 / 371	58.64
Baseline Data				349 / 176		7.52	0.1		604 / 318	640 / 338	734 / 390	47.0

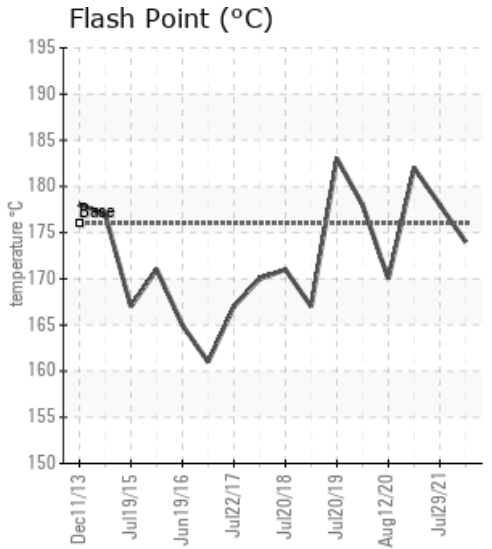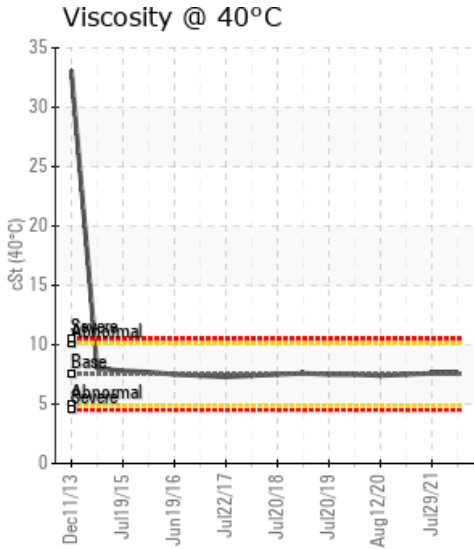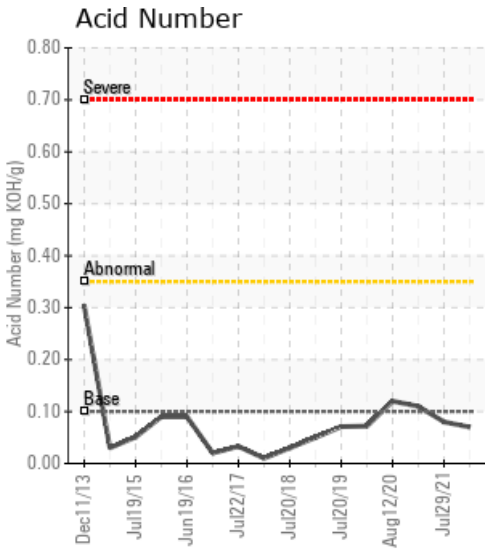

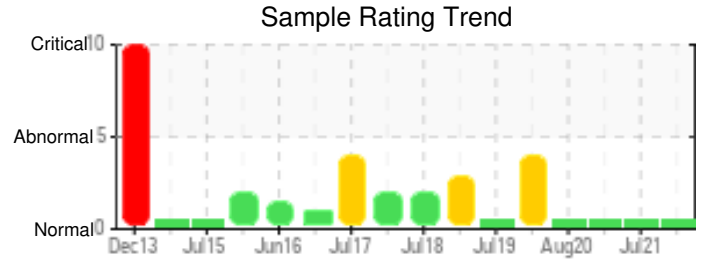

Sample Date	Iron	Chromium	Nickel	Aluminum	Copper	Lead	Tin	Cadmium	Silver	Vanadium	Silicon	Sodium	Potassium	Titanium	Molybdenum	Antimony	Manganese	Lithium	Boron	Magnesium	Calcium	Barium	Phosphorus	Zinc
01/21/22	3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	85	0
07/29/21	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	88	0
02/03/21	2	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	82	0
08/12/20	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	87	0
01/16/20	3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	83	0
Baseline Data			0	0						0			0	0				0	0				270	

Elemental analysis results (above) in parts per million (ppm). [10,000 ppm = 1.0%]

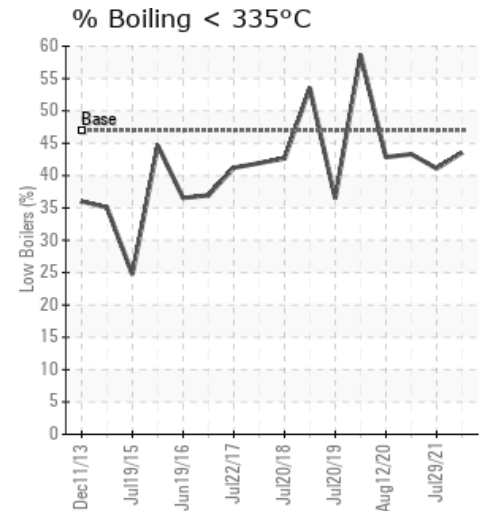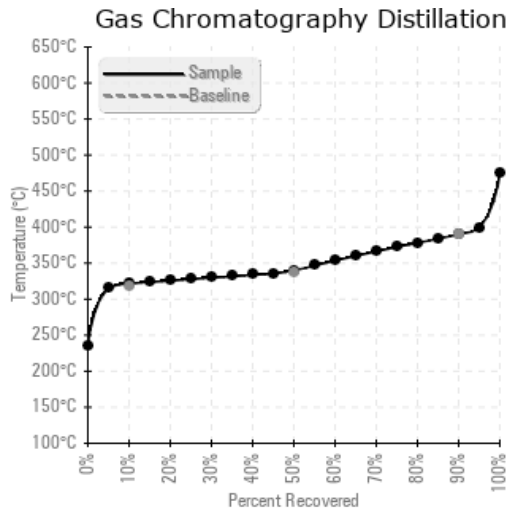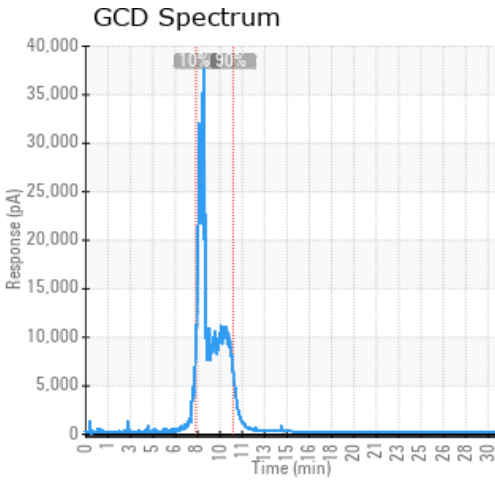

Historical Comments

07/29/21	Fluid is in good condition and is suitable for continued use. Resample in 6 months.
02/03/21	Fluid is in good condition and good for continued use. Resample in 6 months
08/12/20	Results Normal. No action needed at this time. Resample at next scheduled date.
01/16/20	Consider venting of expansion tank to reduce low boilers. Resample after venting of expansion tank. Wear metals low. Contaminants, water, insolubles are low. (GCD) % < 335°C is severely high. (GCD) 90% Distillation Point is abnormally low. - 67% increase in (GCD) % < 335 deg. C. (from new fluid 35% to 58.4%), & - 5% decrease in 90% Distillation Point, (from new fluid 390 C. to 371.1 C.), indicate presence of low boilers.

Petro-Canada makes no representation or warranty of any kind, either express or implied, as to the accuracy or completeness of the analysis and assumes no responsibility and shall have no liability whatsoever with respect to such analysis, or a party's use of it. Petro-Canada is a division of HollyFrontier Corporation.