




**LINE 1**



Customer: PTRHTF20031	System Information	Sample Information
MCCAIN FOODS PORTAGE PO BOX 220 1 McCain Avenue PORTAGE LA PRARIE, MB R1N 3B5 Canada Attn: Mike Weissig Tel:	System Volume: 19000 ltr Bulk Operating Temp: 540F / 282C Heating Source: Blanket: Fluid: PETRO CANADA CALFLO HTF Make: KONUS-KESSEL	Lab No: 02470279 Analyst: Peter Harteveld Sample Date: 01/17/22 Received Date: 02/04/22 Completed: 02/07/22 Peter Harteveld peter.harteveld@HFSinclair.com

Recommendation: Thermal degradation of the fluid is causing a decrease in viscosity, Flash Point and 10% GCD temperature. Low boiler vapor content is elevated (GCD% <335C = 7.89%) It is advised to vent off low boiler vapor to atmosphere on a regular basis a part of fluid maintenance. Please re-sample in 3 months to check the effect of the venting.

Comments: COC Flash Point is severely low. (GCD) % < 335°C is marginally high. (GCD) 10% Distillation Point is marginally low.




Sample Date	Received Date	Fluid Age	Sample Location	Flash Point (COC)	Water (KF)	Viscosity (40°C)	Acid Number	Solids	GCD 10%	GCD 50%	GCD 90%	GCD % < 335°C
	mm/dd/yy			°F/°C	ppm	cSt	mg/KOH/g	%wt	°F/°C	°F/°C	°F/°C	%
01/17/22	02/04/22	6.0y	#2 toh drop vent	338 / 170	8.3	25.8	0.01	0.031	658 / 348	801 / 427	911 / 489	7.89
07/31/21	08/12/21	5.0y		352 / 178	38.8	27.1	0.02	0.081	669 / 354	805 / 429	917 / 492	7.13
08/09/20	04/16/21	0.0y		392 / 200	21.5	28.4	0.02	0.071	636 / 335	785 / 418	914 / 490	9.44
07/31/19	08/06/19	0.0y	2 PRIMARY	316 / 158	11.3	29.2	0.066	0.046	672 / 356	801 / 427	912 / 489	6.30
03/04/19	03/07/19	2.5y	2 PRIMARY PUMP DISCH	345 / 174	10.0	28.8	0.009	0.109	650 / 343	790 / 421	900 / 482	8.33
Baseline Data				448 / 231		35.20	.1		712 / 378	810 / 432	910 / 488	1.75

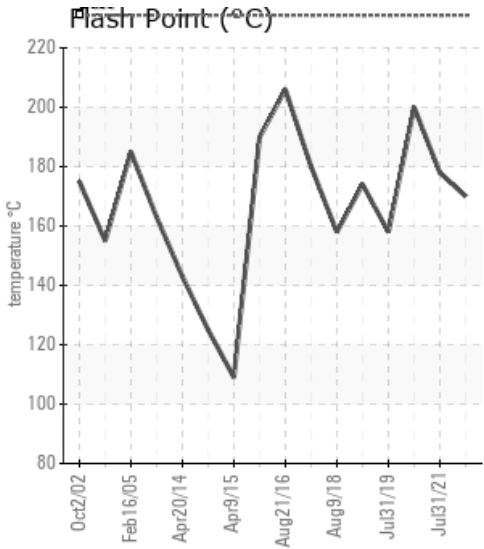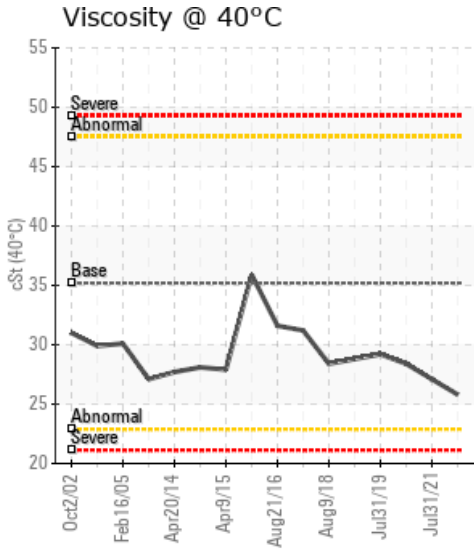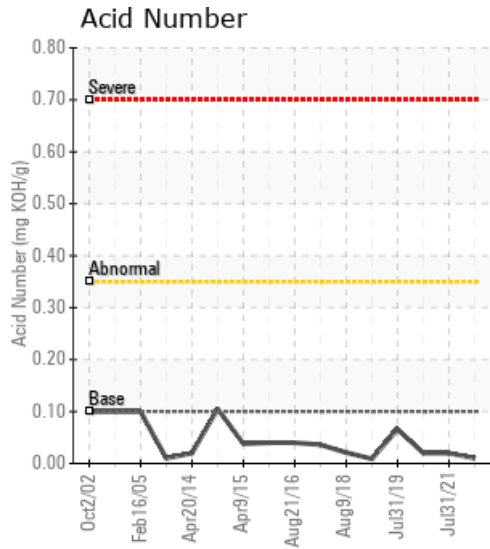

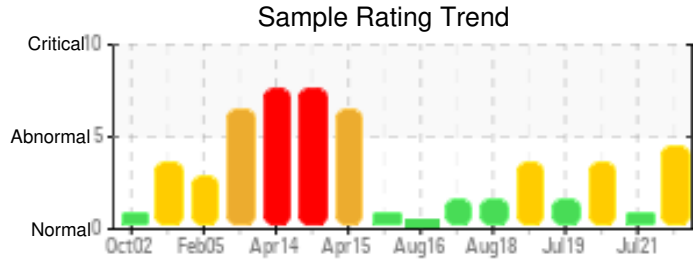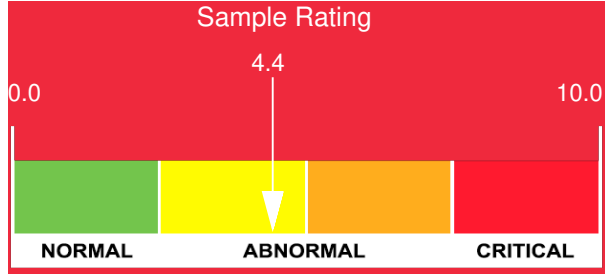

Sample Date	Iron	Chromium	Nickel	Aluminum	Copper	Lead	Tin	Cadmium	Silver	Vanadium	Silicon	Sodium	Potassium	Titanium	Molybdenum	Antimony	Manganese	Lithium	Boron	Magnesium	Calcium	Barium	Phosphorus	Zinc
01/17/22	3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	13	0
07/31/21	4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	23	0
08/09/20	6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	27	0
07/31/19	4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	24	0
03/04/19	9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	29	0
Baseline Data			0	0						0			0	0				0	0				280	

Elemental analysis results (above) in parts per million (ppm). [10,000 ppm = 1.0%]

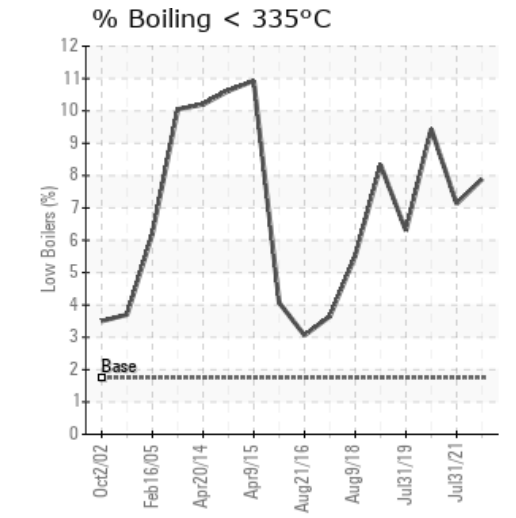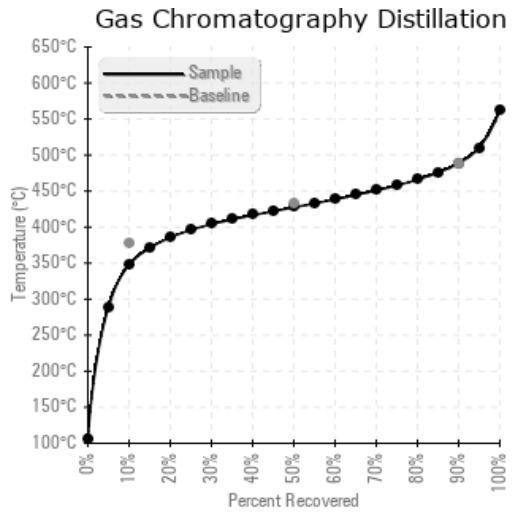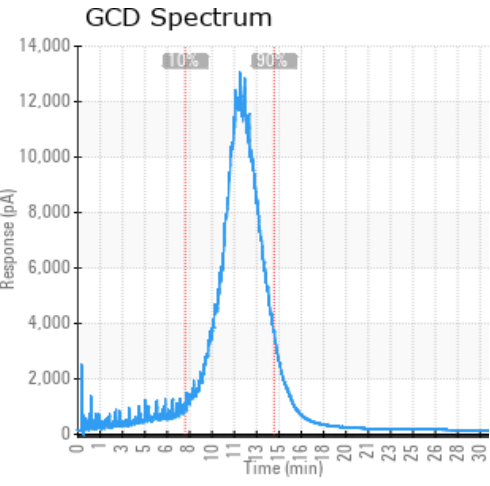

Historical Comments	
07/31/21	The fluid is in a good condition and suitable for further use but thermal degradation has increased the low boiler vapor content. (% GCD<335C. = 7.13) Indications of thermal degradation are a slight decrease in viscosity in combination with a reduced Flash Point and 10% GCD temperature. It is recommended to vent off low boiler vapor as part of fluid maintenance. Please vent once a week for 3 months and submit a sample after doing that. COC Flash Point is abnormally low.
08/09/20	The fluid is in a good condition and suitable for further use. The combination of low viscosity, reduced Flash Point, low 10% GCD temperature and an elevated low boiler vapor content of 9.44% indicates thermal degradation of the fluid. It is advised to vent off the low boiler vapors. Please re-sample in 6 months and note down fluid service life on the analysis request form. (GCD) 10% Distillation Point is abnormally low. (GCD) % < 335°C is marginally high. COC Flash Point is marginally low.
07/31/19	The current fluid has normal viscosity and distillation points. The acid number and solid contents are all low meaning the minimum fluid oxidation. The reduced flash point is due to the thermal cracking at the constant 282C high bulk temperature. Please conduct the system venting as much as possible. Take one sample in 6 months to monitor the fluid conditions. COC Flash Point is low.
03/04/19	The current fluid condition have been improved after the system venting in the last week of Feb. The viscosity is normal, the contaminants such as water, dirt are minimum. The acid number is extremely low indicating minimum oil oxidation. The flash point is still lower than the fresh fluid due to the thermal cracking at high bulk fluid temperature. Please continue to run the fluid and conduct the system venting as a routine maintenance activity, take one sample in 6 months to monitor the conditions. COC Flash Point is abnormally low. (GCD) % < 335°C is marginally high. (GCD) 10% Distillation Point is marginally low.

Petro-Canada makes no representation or warranty of any kind, either express or implied, as to the accuracy or completeness of the analysis and assumes no responsibility and shall have no liability whatsoever with respect to such analysis, or a party's use of it. Petro-Canada is a division of HollyFrontier Corporation.