BABINE ENERGY SYSTEM

Customer: PTRHTF20130

BABINE FOREST PRODUCTS 19479 HIGHWAY 16

EAST BURNS LAKE, BC V0J1E0

Canada

Attn: Troy Cooper Tel: (250)692-4599

E-Mail: troycooper@hamptonlumber.com

System Information

System Volume: 50000 ltr

Bulk Operating Temp: 500F / 260C

Heating Source:

Blanket:

Fluid: PETRO CANADA PETRO-THERM

Make: WELLONS

Sample Information

Lab No: 02494395 Analyst: Ray Rolston Sample Date: 05/31/22 Received Date: 06/13/22 Completed: 06/15/22


Ray Rolston

Ray.Rolston@hollyfrontier.com

Recommendation: The Petro-Therm fluid's age is not known. The used Petro-Therm heat transfer fluid sample remains in very good condition. Iron wear at 6 ppm is lower than the previous sample which was 11 ppm. No other wear metals were detected. The Acid Number (AN) is low at 0.16 mg KOH/g, and the oil's viscosity is normal. Gas Chromatography Distillation (GCD) results are normal. Pentane Insolubles (solids content) has improved from 0.05wt% on the previous sample to 0.039wt%. Recommend resampling again next year to monitor.


Comments:

Sample Date	Received Date	Fluid Age	Sample Location	Flash Point (COC)	Water (KF)	Viscosity (40°C)	Acid Number	Solids	GCD 10%	GCD 50%	GCD 90%	GCD % < 335°C
	mm/dd/yy			°F/°C	ppm	cSt	mg/KOH/ g	%wt	°F/°C	°F/°C	°F/°C	%
05/31/22	06/13/22	0.0y	Pump	432 / 222	6.8	37.7	0.16	0.039	728 / 386	825 / 441	911 / 488	1.75
06/10/21	06/17/21	0.0y	PRIMARY PUMP	424 / 218	17.7	37.6	0.15	0.050	715 / 380	808 / 431	920 / 493	1.90
05/14/20	05/19/20	0.0y	BOOSTER PUMP	424 / 218	8.4	30.2	0.18	0.283	724 / 385	830 / 443	911 / 488	2.35
05/14/20	05/19/20	0.0y	RADIANT COIL	424 / 218	9.0	35.8	0.24	0.232	721 / 383	830 / 443	912 / 489	3.12
05/14/20	05/19/20	0.0y	PRIMARY PUMP	399 / 204	25.8	38.4	0.20	0.191	725 / 385	830 / 444	912 / 489	2.34
Baseline Data				433 / 223		34.2	0.03		720 / 382	817 / 436	900 / 482	1.00
Acid Number Viscosity				@ 40°C Flash Point (°C)								
Severe Abnormal								235				

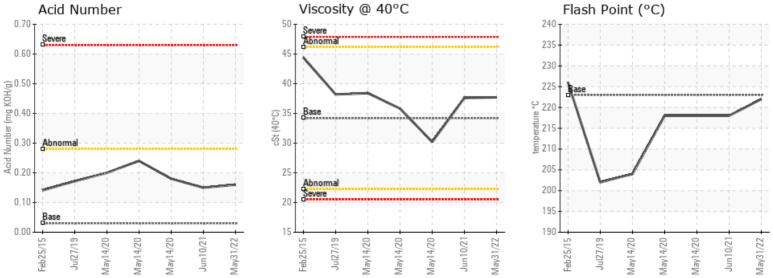



Elemental analysis results (above) in parts per million (ppm). [10,000 ppm = 1.0%]

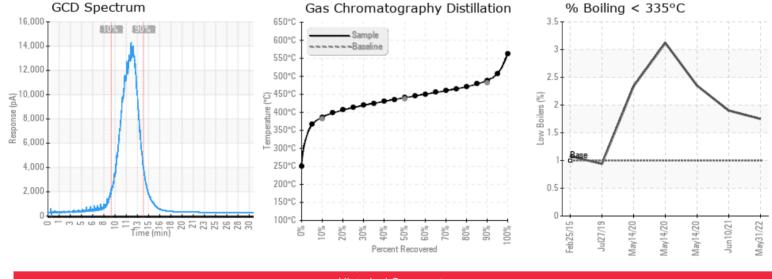

Historical Comments The used Petro-Therm heat transfer fluid sample remains in very good condition. Iron wear at 11 ppm is lower than the previous sample which was 53 ppm. No other wear metals were detected. The Acid Number (AN) is low at 0.15 mg KOH/g, and the oil's viscosity is normal. Pentane Insolubles (solids content) has improved from 0.283wt% on the previous sample to 0.05wt%. Recommend submitting another sample next year. (GCD) 90% Distillation Point is marginally high. Lab Number 0234552 sample was obtained from Booster Pump. Note 53 ppm iron wear content and lower viscosity (30.2 cSt @ 40 C). Petro-Therm heat transfer fluid is suitable for continued use; re-sample in one year to monitor fluid's condition. Note: Lab Number 02354550 sample was obtained from Primary Pump; 02354551 was obtained from Radiant Coil Section; 0234552 was obtained from Booster Pump. Used oil analysis results from 02354550 were provided on May 25, 2020.Note 53 ppm iron wear content and lower viscosity (30.2 cSt @ 40 C) from 02354551 Booster Pump. Note low Initial Boiling Point on all 3 samples, but normal 10% through Final Boiling Point Distillation Range.Petro-Therm is suitable for continued use; re-sample in one year to monitor fluid's condition. Petro-Therm heat transfer fluid is in satisfactory condition for continued use. Recommend re-sampling in one year to monitor.

Petro-Canada makes no representation or warranty of any kind, either express or implied, as to the accuracy or completeness of the analysis and assumes no responsibility and shall have no liability whatsoever with respect to such analysis, or a party's use of it. Petro-Canada is a division of HollyFrontier Corporation.