




## PT KOBE BOGA UTAMA



Customer: PTRHTF60035	System Information	Sample Information
PT. Indonesia Millenium Perdana	System Volume: 0 ltr	Lab No: 02503842
Jakarta, ZZ 13220 Indonesia	Bulk Operating Temp: Not Specified	Analyst: Philip Riley
Attn: Nathaniel Utama	Heating Source:	Sample Date: 07/04/22
Tel: (628)129-0912801	Blanket:	Received Date: 08/08/22
E-Mail: nathanielutama@petrocanada-imp.com	Fluid: PETRO CANADA PURITY FG HEAT TRANSFER FLUID	Completed: 08/10/22
	Make:	Philip Riley
		philip.riley@hollyfrontier.com

Recommendation: Minor difference in the 90% Distillation. Other parameters such as viscosity, flash point are mid point of specification. Satisfied this oil is in good condition

Comments: (GCD) 90% Distillation Point is marginally high.




Sample Date	Received Date	Fluid Age	Sample Location	Flash Point (COC)	Water (KF)	Viscosity (40°C)	Acid Number	Solids	GCD 10%	GCD 50%	GCD 90%	GCD % < 335°C
	mm/dd/yy			°F/°C	ppm	cSt	mg/KOH/g	%wt	°F/°C	°F/°C	°F/°C	%
07/04/22	08/08/22	0.0h	BATCH PC210079	435 / 224	0.00	36.5	1.03	0.195	732 / 389	821 / 438	914 / 490	0.75
Baseline Data				459 / 237		37.12	0.90		721 / 383	807 / 431	892 / 478	1.5

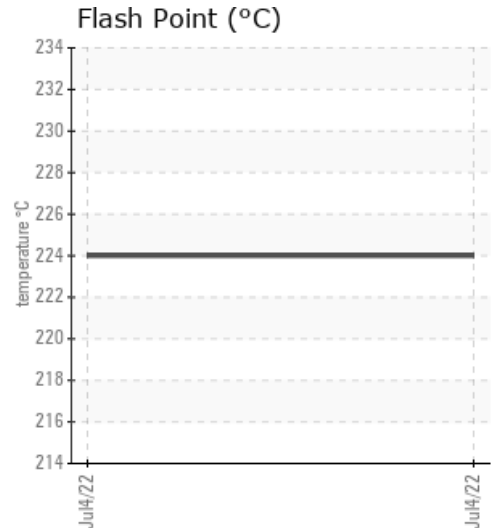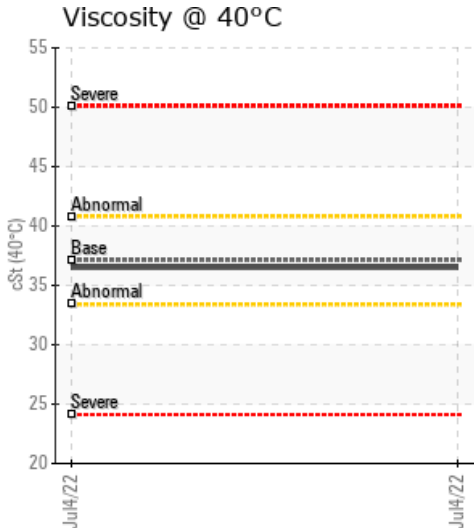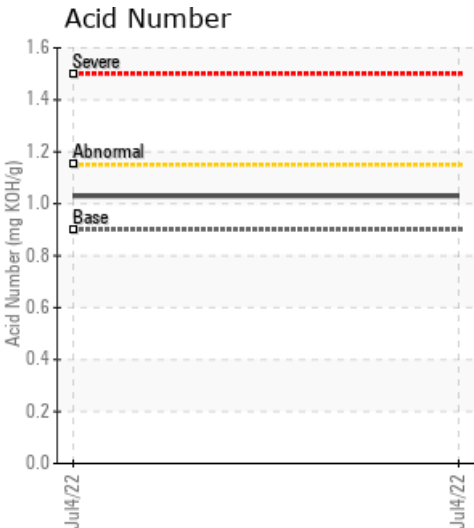

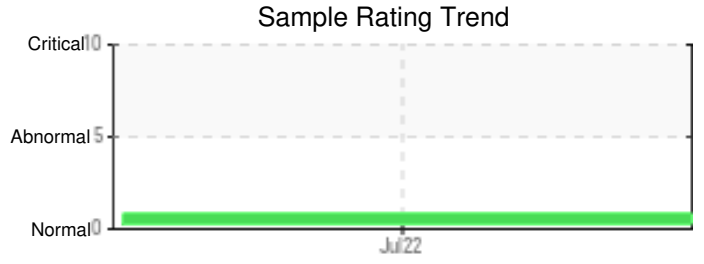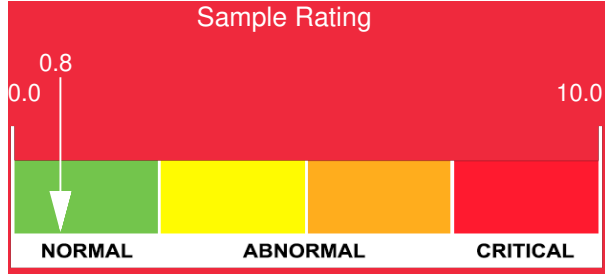

Sample Date	Iron	Chromium	Nickel	Aluminum	Copper	Lead	Tin	Cadmium	Silver	Vanadium	Silicon	Sodium	Potassium	Titanium	Molybdenum	Antimony	Manganese	Lithium	Boron	Magnesium	Calcium	Barium	Phosphorus	Zinc	
07/04/22	0	0	0	0	0	0	0	0	0	0	3	0	0	0	0	0	0	0	0	0	0	0	0	234	0
<b>Baseline Data</b>			0	0						0			0	0				0	0					230	

Elemental analysis results (above) in parts per million (ppm). [10,000 ppm = 1.0%]

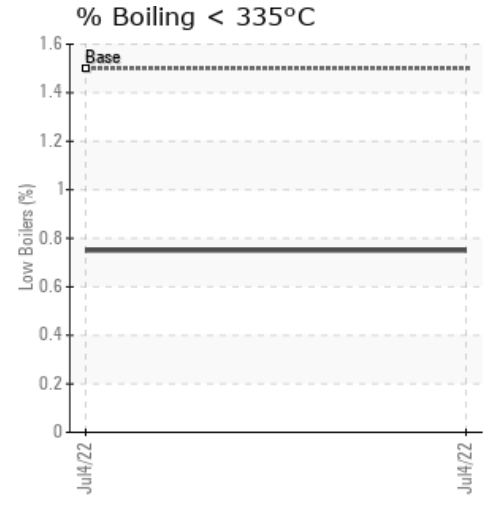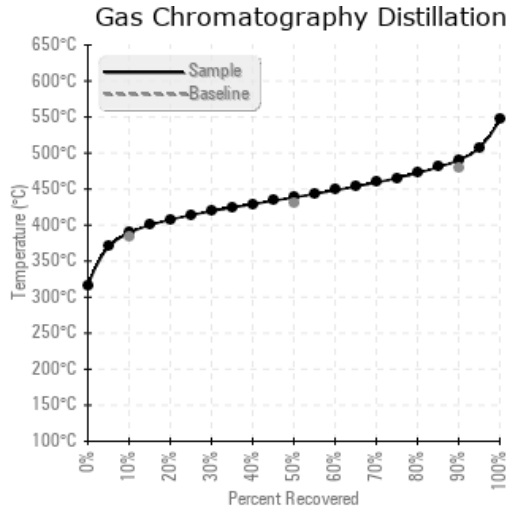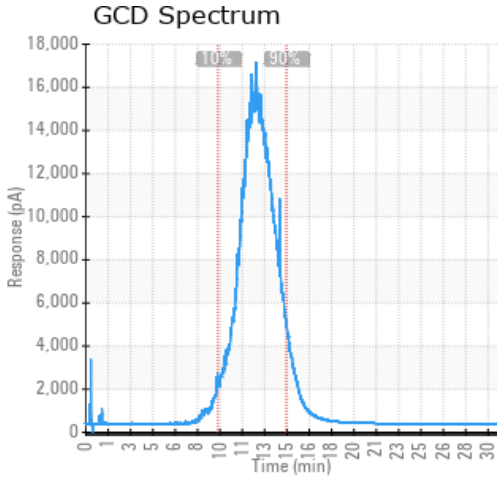

### Historical Comments


Petro-Canada makes no representation or warranty of any kind, either express or implied, as to the accuracy or completeness of the analysis and assumes no responsibility and shall have no liability whatsoever with respect to such analysis, or a party's use of it. Petro-Canada is a division of HollyFrontier Corporation.