




[SC. INTERSNACK ROMANIA SRL] PC2000 CHIPS AURA AKL7504G


Customer: PTRHTF40121	System Information	Sample Information
S.C Brenntag SRL Street Garii No. 1 Chiajna Ilfov, 077040 Romania Attn: Remina Feifer Tel: 1(407)451-2327 E-Mail: remina.feifer@brenntag.ro	System Volume: 17000 ltr Bulk Operating Temp: 545F / 285C Heating Source: Blanket: Fluid: PETRO CANADA PURITY FG HEAT TRANSFER FLUID Make: AURA	Lab No: 02513338 Analyst: Bill Quesnel CLS,OMA II,MLA-III,LLA-I Sample Date: 03/21/22 Received Date: 09/27/22 Completed: 09/29/22 Bill Quesnel CLS,OMA II,MLA-III,LLA-I

Recommendation: The COC Flash Point is very low. Recommend venting the expansion tank to remove light ends. Resample in 6 months to monitor.

Comments: COC Flash Point is severely low. (GCD) 90% Distillation Point is marginally high.




Sample Date	Received Date	Fluid Age	Sample Location	Flash Point (COC)	Water (KF)	Viscosity (40°C)	Acid Number	Solids	GCD 10%	GCD 50%	GCD 90%	GCD % < 335°C
	mm/dd/yy			°F/°C	ppm	cSt	mg/KOH/g	%wt	°F/°C	°F/°C	°F/°C	%
03/21/22	09/27/22	2.0y	DRAIN VALVE	334 / 168	25.0	32.6	0.76	0.135	678 / 359	803 / 429	911 / 488	6.37
Baseline Data				459 / 237		37.12	0.90		721 / 383	807 / 431	892 / 478	1.5

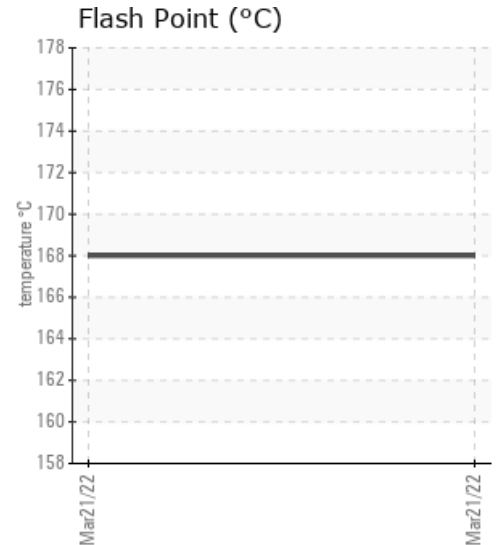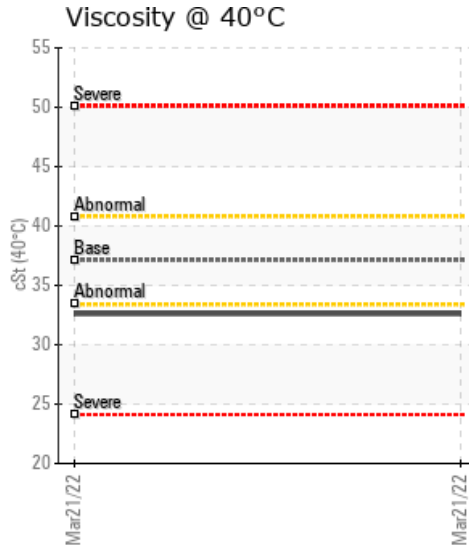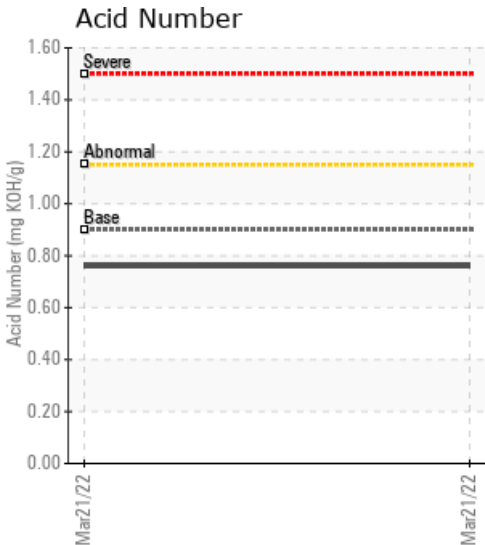

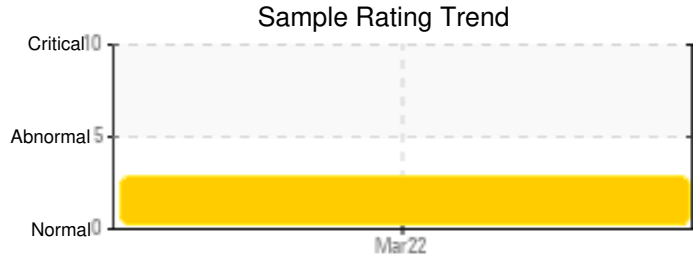

Sample Date	Iron	Chromium	Nickel	Aluminum	Copper	Lead	Tin	Cadmium	Silver	Vanadium	Silicon	Sodium	Potassium	Titanium	Molybdenum	Antimony	Manganese	Lithium	Boron	Magnesium	Calcium	Barium	Phosphorus	Zinc
03/21/22	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	6	0
Baseline Data			0	0						0			0	0				0	0					230

Elemental analysis results (above) in parts per million (ppm). [10,000 ppm = 1.0%]

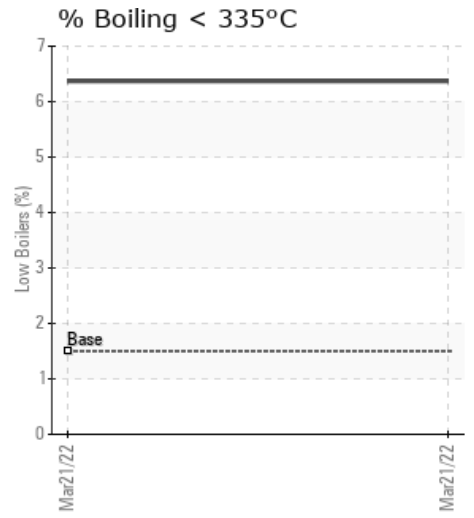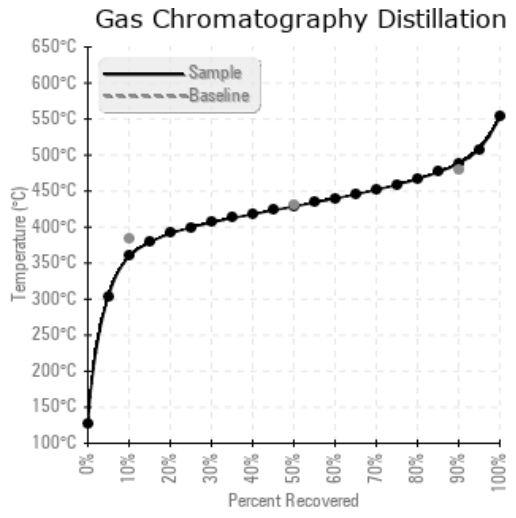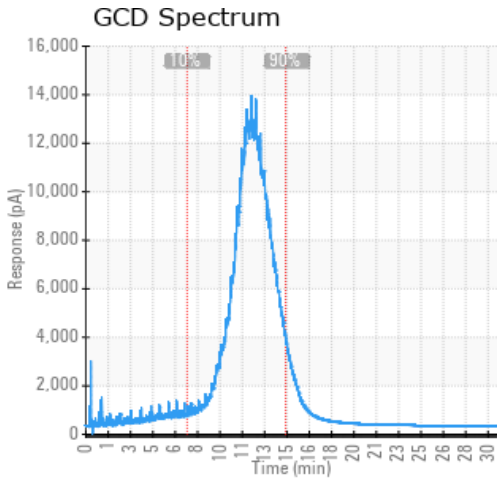

Historical Comments

Petro-Canada makes no representation or warranty of any kind, either express or implied, as to the accuracy or completeness of the analysis and assumes no responsibility and shall have no liability whatsoever with respect to such analysis, or a party's use of it. Petro-Canada is a division of HollyFrontier Corporation.