



[7-27-51-19W5 / Ansel Gas Plant] HEAT MEDIUM

Customer: PTRHTF20103

CANADIAN NATURAL RESOURCES

(CNRL)

P.O. BOX 6808

EDSON, AB T7E 1L5 Canada

Attn: Keith Webster Tel: (780)725-1411

E-Mail: keith.webster@cnrl.com

System Information

System Volume: 14200 ltr

Bulk Operating Temp: 446F / 230C

Heating Source:

Blanket:

Fluid: PETRO CANADA PETRO-THERM

Make: PRESSON

Sample Information


Lab No: 02514237 Analyst: Clinton Buhler Sample Date: 09/19/22 Received Date: 10/03/22 Completed: 10/05/22


Clinton Buhler


Clinton.Buhler@HFSinclair.com


Recommendation: Sample results indicate that fluid degradation (oxidation) continues to progress as evidenced by increased AN and fluid viscosity; fresh Petro-Therm viscosity is 35.8 cSt and it has thickened to 48.4 cSt. Acid Number is at 0.74 and is likely contributing to corrosion as Iron content has climbed from 45 ppm to 93 ppm. The condemning limit for AN is 1. It is advised to make plans for replacement of the fluid along with system cleaning to removed the Solids content which remains elevated. Petro-Canada Lubricants technical services can assist with cleaning procedures. Please ensure blanket gas is operational in the expansion tank


Comments: Pentane Insolubles levels are severely high. Acid Number (AN) is severely high. Visc @ 40°C is severely high.

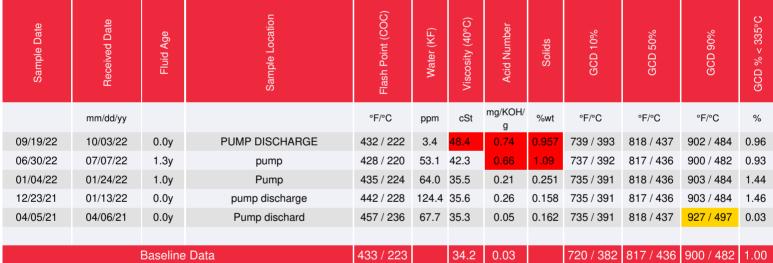







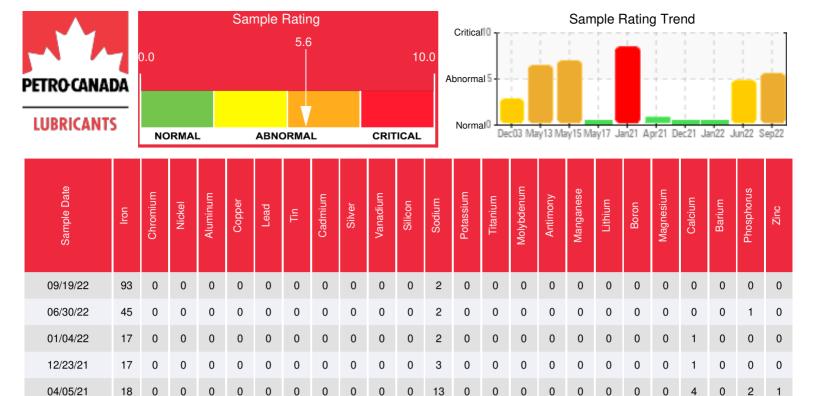

Elemental analysis results (above) in parts per million (ppm). [10,000 ppm = 1.0%]

n

0

0

n

n

n

0

n

n

0

n

0

0

n

0


0

Baseline Data

0

0

n

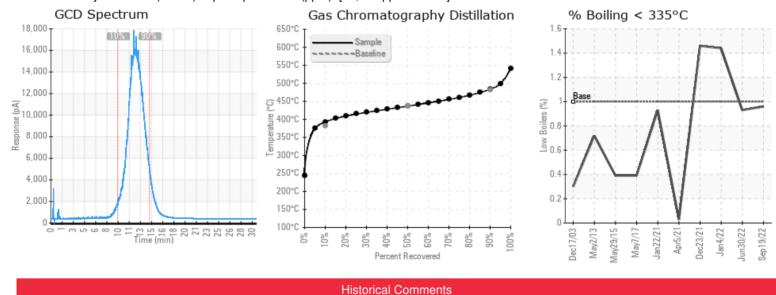

Sample results indicate ongoing fluid oxidation as evidenced by increased fluid viscosity and Acid Number. The increased acidity may also be contributing to corrosion (see increased Iron content). Solids content has also increased significantly which is related to the iron but also other insoluble matter likely related to the 06/30/22 fluid oxidation. Please ensure blanket gas is operational and re-sample in 3 months. Please ensure sample point is thoroughly purged prior to filling sample container. Sample results indicate the fluid is in suitable condition for continued service. Please ensure that blanket gas is operational in the expansion tank. Please resample after 12 months. 01/04/22 Sample results indicate the fluid is in suitable condition for continued service. Acid number has increased since previous sample and can indicate acids formed from oxidation. Please ensure that blanket gas is operational in the expansion tank. Please re-sample in 12 months 12/23/21 Sample results indicate that the fluid is in suitable condition for continued service. Please re-sample in 6 months. 04/05/21

Petro-Canada makes no representation or warranty of any kind, either express or implied, as to the accuracy or completeness of the analysis and assumes no responsibility and shall have no liability whatsoever with respect to such analysis, or a party's use of it. Petro-Canada is a division of HollyFrontier Corporation.