


## [11-21-55-20W5M] H-802

Customer: PTRHTF20228	System Information	Sample Information
PEYTO EXPLORATION	System Volume: 27000 ltr	Lab No: 02516974
Box 7198	Bulk Operating Temp: 370F / 188C	Analyst: Clinton Buhler
EDSON, AB T7E 1V4 Canada	Heating Source:	Sample Date: 10/13/22
Attn: Logan Pillage	Blanket:	Received Date: 10/18/22
Tel: (780)712-9444	Fluid: PETRO CANADA PETRO-THERM	Completed: 10/20/22
E-Mail: Lpillage@Peyto.com	Make: ALCO	Clinton Buhler
		Clinton.Buhler@HFSinclair.com

Recommendation: Sample results show that the fluid remains fairly similar to the last couple analysis'. Long term, system will require cleaning and fluid replacement. Please ensure blanket gas stays active in expansion tank. Please consider sweetening of system to negate elevated Acid Number.Please re-sample in 6 months.


Comments:

Sample Date	Received Date	Fluid Age	Sample Location	Flash Point (COC)	Water (KF)	Viscosity (40°C)	Acid Number	Solids	GCD 10%	GCD 50%	GCD 90%	GCD % < 335°C
	mm/dd/yy			°F/°C	ppm	cSt	mg/KOH/ g	%wt	°F/°C	°F/°C	°F/°C	%
10/13/22	10/18/22	0.0y	DISCHARGE PUMP SIDE	451 / 233	39.6	56.9	0.81	1.29	745 / 396	838 / 448	899 / 482	0.46
05/18/22	05/24/22	0.0y		450 / 232	15.7	55.5	0.80	1.24	742 / 395	836 / 447	899 / 482	0.75
11/09/21	11/12/21	0.0y	Discharge of pump	457 / 236	21.0	57.9	0.39	1.04	742 / 394	838 / 448	900 / 482	1.35
07/28/21	08/04/21	0.0y	DISCHARGE OF PUMP	478 / 248	31.9	56.7	0.84	2.08	744 / 396	838 / 448	898 / 481	0.91
12/08/20	12/11/20	0.0y	discharge of pump	453 / 234	18.9	60.0	0.64	1.33	744 / 396	839 / 448	899 / 482	0.69

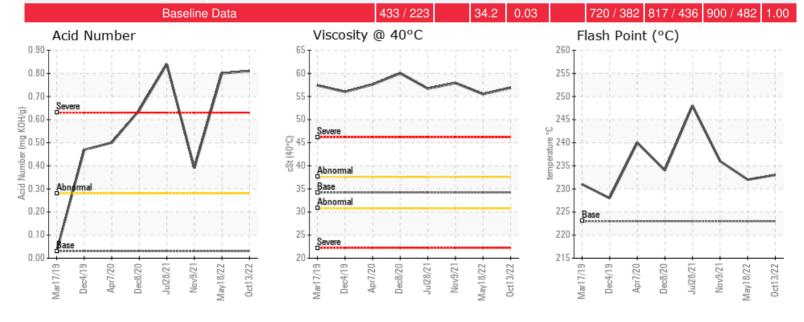



Elemental anaysis results (above) in parts per million (ppm). [10,000 ppm = 1.0%]

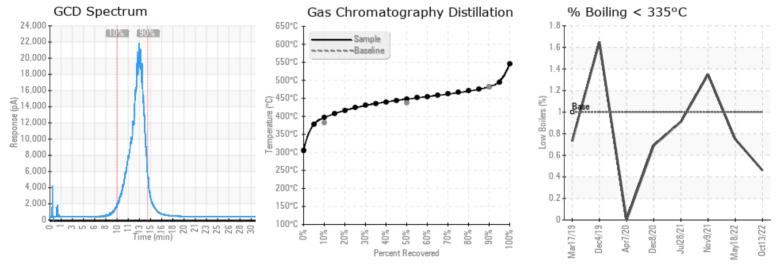

Historical Comments

05/18/22	Although not in ideal condition, the fluid parameters are similar to the sample taken 6 months prior. Of concern is the elevated fluid viscosity, acid number and solids content. Long term, the system will require cleaning and fluid replacement during a planned outage. With Acid Number at 0.8, it is advised to sweeten the system to mitigate corrosion. Please re-sample in 6 months
11/09/21	Fluid condition, although not ideal, appears to be somewhat stable with regards to fluid oxidation; Acid Number is slightly less than last sample and Solids content has reduced. Please continue filtering of solids and ensure that blanket gas is functional in the expansion tank. Eventually the fluid may require replacement, depending on the future rate of degradation and solids formation.Please re-sample in 6 months
07/28/21	TAN, Viscosity and Pentane insolubles are severely high indicating oxidation of the fluid . Ensure gas blanket is functioning. Considering filtering out solids. Pentane Insolubles levels are severely high. Acid Number (AN) is severely high. Visc @ 40°C is severely high.
12/08/20	TAN, Viscosity and Pentane insolubles are severely high indicating oxidation of the fluid . Ensure gas blanket is functioning. Considering filtering out solids. Pentane Insolubles levels are severely high. Acid Number (AN) is severely high. Visc @ 40°C is severely high.

Petro-Canada makes no representation or warranty of any kind, either express or implied, as to the accuracy or completeness of the analysis and assumes no responsibility and shall have no liability whatsoever with respect to such analysis, or a party's use of it. Petro-Canada is a division of HollyFrontier Corporation.