




## [PLATEAU] ENERGY PLANT FURNACE



Customer: PTRHTF20249	System Information	Sample Information
Canfor - Plateau 1399 Bearhead Rd. Vanderhoof, BC V0J 3A2 CA Attn: Jason Fitzpatrick Tel: (250)567-8332 E-Mail: Jason.Fitzpatrick@canfor.com	System Volume: 190000 ltr Bulk Operating Temp: 455F / 235C Heating Source: Blanket: Fluid: PETRO CANADA PETRO-THERM Make: DELTECH	Lab No: 02535802 Analyst: Ray Rolston Sample Date: 01/17/23 Received Date: 01/26/23 Completed: 01/27/23 Ray Rolston Ray.Rolston@HFSinclair.com

Recommendation: Thank you for re-sampling. Iron wear is elevated at 76 ppm, though other metals are low. Water content is significantly lower at 114 ppm vs. 6112 ppm on the Jan 1/23 sample. The Acid Number (AN) at 0.29 mg KOH/g is also more in line with previous samples. COC Flash Point and Gas Chromatography Distillation (GCD) results are good. Pentane Insolubles (solids) content is flagged with a caution warning at 0.397 wt%. Recommend submitting another sample in 6 months to monitor the heat transfer fluid's condition.

Comments: Pentane Insolubles levels are abnormally high. Acid Number (AN) is abnormally high. (GCD) 90% Distillation Point is marginally high.




Sample Date	Received Date	Fluid Age	Sample Location	Flash Point (COC)	Water (KF)	Viscosity (40°C)	Acid Number	Solids	GCD 10%	GCD 50%	GCD 90%	GCD % < 335°C
	mm/dd/yy			°F/°C	ppm	cSt	mg/KOH/g	%wt	°F/°C	°F/°C	°F/°C	%
01/17/23	01/26/23	13.0y	PRIMARY PIPE	439 / 226	114.0	35.7	0.29	0.397	727 / 386	820 / 438	919 / 493	1.31
01/01/23	01/09/23	13.0y		450 / 232	6112.2	36.0	0.42	0.211				
11/18/21	12/03/21	11.0y	pipe before stack	435 / 224	32.0	35.3	0.24	0.092	711 / 377	811 / 433	911 / 489	2.80
05/12/21	05/21/21	11.0y	Primary Pipe	442 / 228	20.7	35.3	0.18	0.564	710 / 377	797 / 425	915 / 491	1.11
Baseline Data				433 / 223		34.2	0.03		720 / 382	817 / 436	900 / 482	1.00

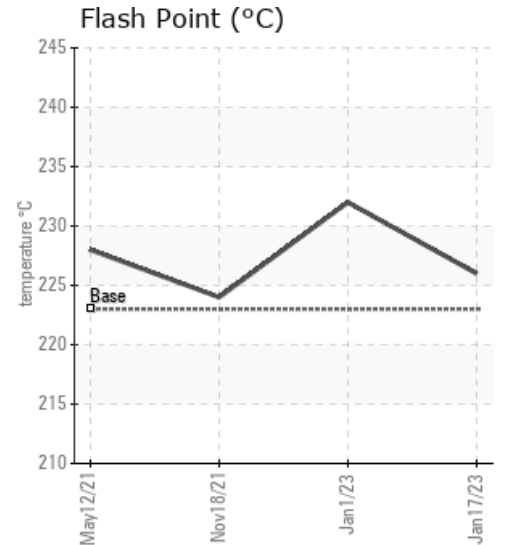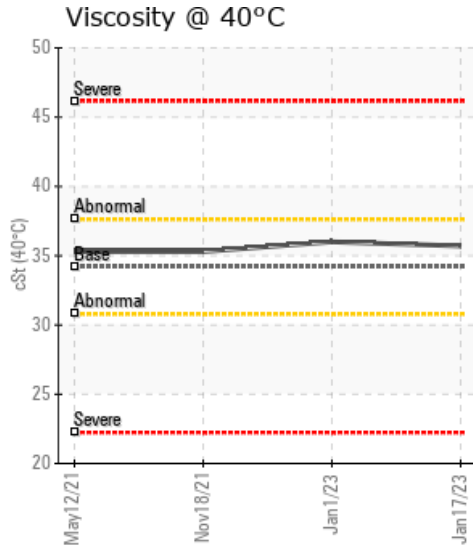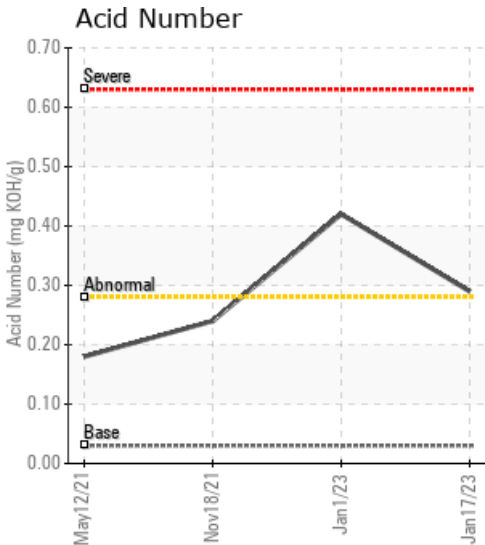

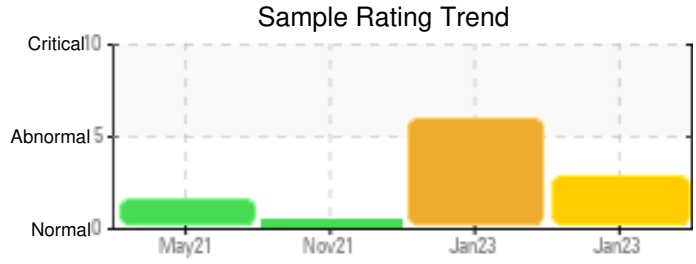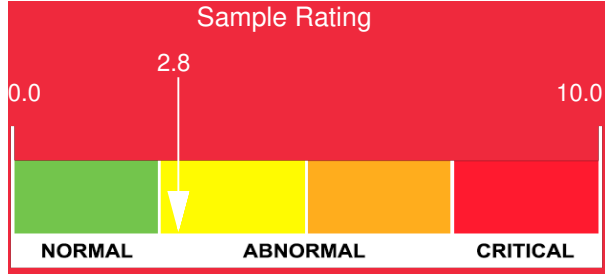

Sample Date	Iron	Chromium	Nickel	Aluminum	Copper	Lead	Tin	Cadmium	Silver	Vanadium	Silicon	Sodium	Potassium	Titanium	Molybdenum	Antimony	Manganese	Lithium	Boron	Magnesium	Calcium	Barium	Phosphorus	Zinc
01/17/23	76	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0	2	0	0	0	0	0	0	0
01/01/23	79	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0	2	0	0	0	2	0	0	3
11/18/21	25	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
05/12/21	8	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	2	0	0	0	0	0
<b>Baseline Data</b>			0	0						0		0	0					0				0		

Elemental analysis results (above) in parts per million (ppm). [10,000 ppm = 1.0%]

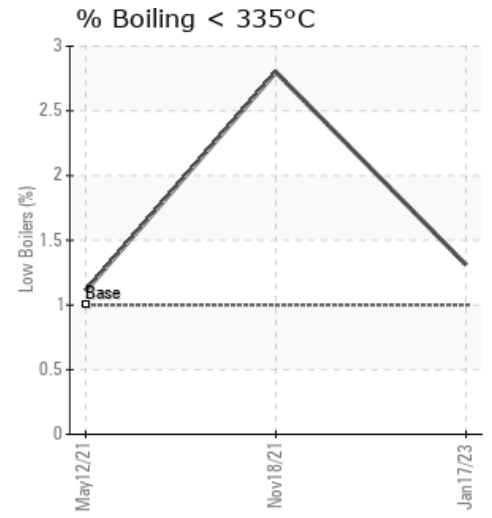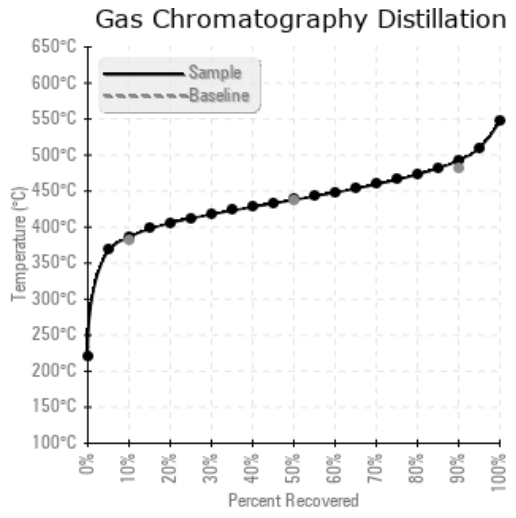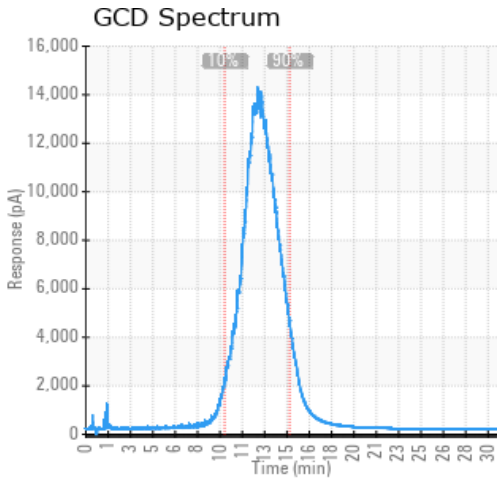

Historical Comments	
01/01/23	The sample was not taken correctly; please submit another heat transfer fluid sample. Iron wear has increased from 25 ppm to 79 ppm likely due to a sampling anomaly. Water content was measured at 0.611% or 6,112 ppm compared with the previous samples of 32 ppm and 20.7 ppm with free water >10%. The Acid Number (AN) has almost doubled from 0.24 to 0.42 mg KOH/g which triggered a warning. Pentane Insolubles (solids) content has also increased from 0.092% on the previous sample to 0.211%. A simulated distillation (GCD) could not be run due to the high water content. Water contamination levels are severely high. Water contamination levels are severely high. *** SimDis (GCD) not run due to high water content present in the sample *** Acid Number (AN) is abnormally high.
11/18/21	The iron content on this sample is 25 ppm compared with 8 ppm on the May 2021 sample. This may be due to differences in the way that the sample was obtained, or perhaps the sample was taken from a different location. Water content at 32 ppm and Acid Number (AN) at 0.24 mg KOH/g are low which is good. Cleveland Open Cup (COC) Flash Point and Gas Chromatograph Distillation (GCD) are good, although the Initial Boiling Point (IBP) is very low at 183 C (fresh = 316 C), and 2.8% GCD % < 335 C is elevated (fresh = 1%) indicating that some low boiler light fractions are present. Pentane Insolubles (solids content) has decreased from 0.564 wt% on the previous sample to 0.092 wt% suggesting that the oil has either been filtered, or a more representative sample was drawn. All other inspections are normal. Re-sample in 12 months to monitor.
05/12/21	Water content of sample was low at 20.7 ppm. Acid Number (AN) at 0.18 mg KOH/g is low which is good. COC Flash Point and GCD Distillation is good, although Initial Boiling Point (IBP) is a little low at 285 C indicating that some light fractions are present. Pentane Insolubles (solids) content is elevated at 0.564; the warning limit is 0.50%. Recommend investigating whether the heat transfer fluid can be filtered to remove this sediment. Re-sample in 6 months to monitor the fluid's condition. Pentane Insolubles levels are severely high.

Petro-Canada makes no representation or warranty of any kind, either express or implied, as to the accuracy or completeness of the analysis and assumes no responsibility and shall have no liability whatsoever with respect to such analysis, or a party's use of it. Petro-Canada is a division of HollyFrontier Corporation.