




[TOURMALINE / 01-35-060-5W6] H-730



Customer: PTRHTF20175	System Information	Sample Information
QUADRA CHEMICALS 7802 98 STREET CLAIRMONT, AB T0H 0W0 Canada Attn: Quadra Samples Tel: E-Mail: quadra_samples@quadra.ca	System Volume: 6000 ltr Bulk Operating Temp: Not Specified Heating Source: Blanket: Fluid: PETRO CANADA PETRO-THERM Make: HEATECH	Lab No: 02536111 Analyst: Clinton Buhler Sample Date: 01/09/23 Received Date: 01/27/23 Completed: 02/02/23 Clinton Buhler Clinton.Buhler@HFSinclair.com

Recommendation: This is the first sample taken after the previous fill was drained, flushed with diesel and then re-filled with fresh Petro-Therm. Sample results indicate that the fluid is in suitable condition for continued service. However, fluid viscosity is still well below fresh Petro-Therm and low boiling vapor content is quite high at 13%, possibly related to residual flushing medium. System needs to be vented to reduce the amount of low boiling vapors. Please re-sample in 3 months but only after a thorough venting regime.

Comments:




Sample Date	Received Date	Fluid Age	Sample Location	Flash Point (COC)	Water (KF)	Viscosity (40°C)	Acid Number	Solids	GCD 10%	GCD 50%	GCD 90%	GCD % < 335°C
	mm/dd/yy			°F/°C	ppm	cSt	mg/KOH/g	%wt	°F/°C	°F/°C	°F/°C	%
01/09/23	01/27/23	1.0m		435 / 224	13.3	19.8	0.07	0.050	532 / 278	805 / 429	904 / 484	13.15
11/09/22	11/15/22	15.0m	ACCUMULATOR BOTTOM	72 / 22	40.3	1.5	0.00	0.164	90 / 32	218 / 103	860 / 460	60.46
11/09/22	11/15/22	15.0m	TOP OF ACCUMULATOR	72 / 22	7.3	7.6	0.00	0.170	200 / 93	784 / 418	897 / 480	23.08
09/21/22	09/26/22	12.0m	FILTER POT	372 / 189	20.7	24.0	0.01	0.046	702 / 372	810 / 432	910 / 488	4.45
08/10/22	08/23/22	8.0m	SAMPLE QUILL	410 / 210	40.3	30.6	0.16	0.058	715 / 379	812 / 433	912 / 489	2.15
Baseline Data				433 / 223		34.2	0.03		720 / 382	817 / 436	900 / 482	1.00

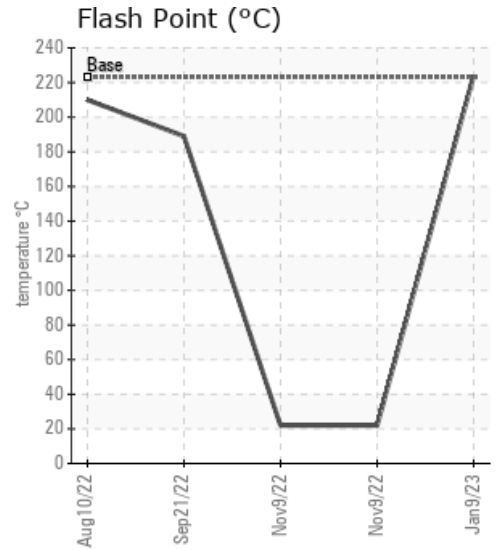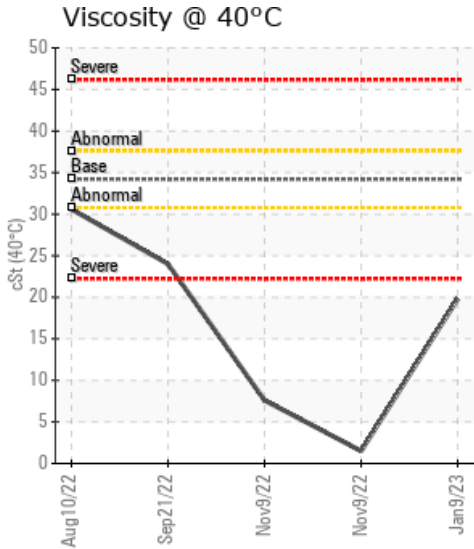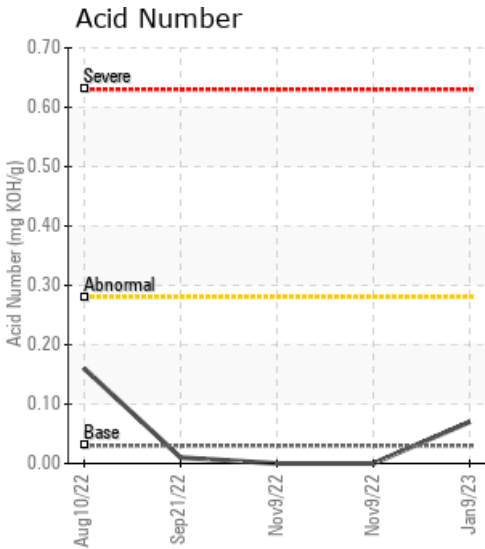

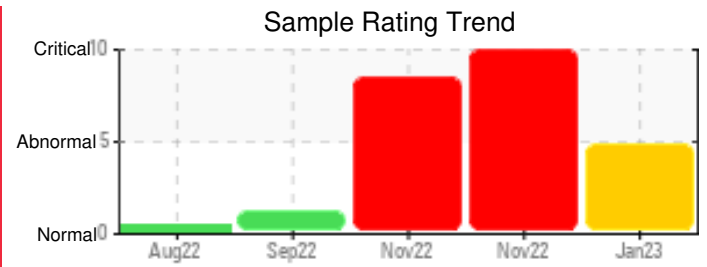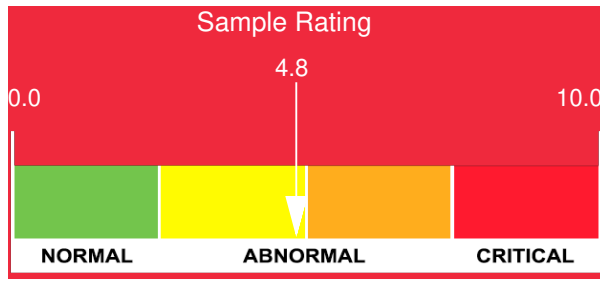

Sample Date	Iron	Chromium	Nickel	Aluminum	Copper	Lead	Tin	Cadmium	Silver	Vanadium	Silicon	Sodium	Potassium	Titanium	Molybdenum	Antimony	Manganese	Lithium	Boron	Magnesium	Calcium	Barium	Phosphorus	Zinc
01/09/23	8	0	0	0	0	0	0	0	0	0	0	2	0	0	0	0	0	0	1	0	0	0	0	0
11/09/22	8	0	0	0	0	0	0	0	0	0	7	0	0	0	0	0	0	0	0	0	0	0	0	0
11/09/22	8	0	0	0	0	0	0	0	0	0	4	0	0	0	0	0	0	0	0	0	0	0	0	2
09/21/22	8	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
08/10/22	10	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Baseline Data			0	0						0			0	0					0				0	

Elemental analysis results (above) in parts per million (ppm). [10,000 ppm = 1.0%]

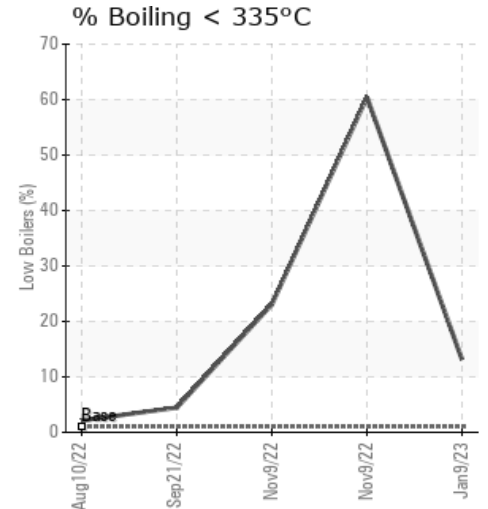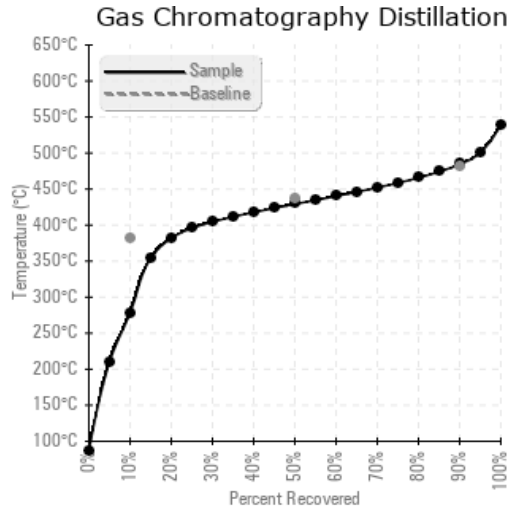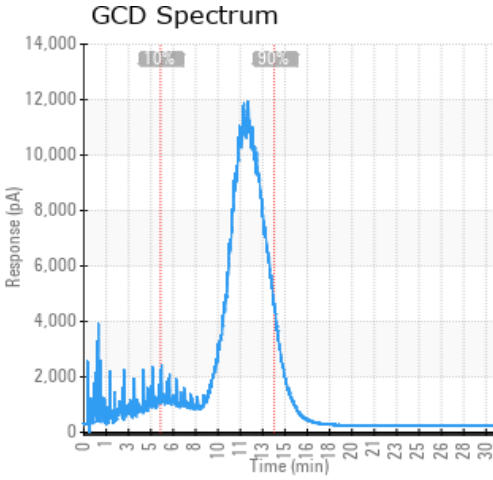

Historical Comments

11/09/22	Sample results indicate extreme contamination with process fluid. Fluid needs to be replaced immediately. Do not run the system as flash point is dangerously low. (GCD) % < 335°C is severely high. (GCD) 10% Distillation Point is severely low. (GCD) 50% Distillation Point is severely low. (GCD) 90% Distillation Point is severely low. COC Flash Point is severely low. Visc @ 40°C is severely low.
11/09/22	Sample results indicate extreme contamination with process fluid. Fluid needs to be replaced immediately. Do not run the system as flash point is dangerously low. We understand there is also evidence of solids in the accumulator and pump inlet screens, indicative of fluid degradation. Please contact Petro-Canada Lubricants tech services to discuss cleaning and flushing (GCD) % < 335°C is severely high. (GCD) 10% Distillation Point is severely low. COC Flash Point is severely low. Visc @ 40°C is severely low.
09/21/22	Sample results indicate symptoms related to either thermal degradation, mixing with process fluids and/or high blanket gas pressure: see reduced fluid viscosity and flash point and increased low boiler vapor content (4.45%). It is advised to perform regular venting of the expansion tank to remove the low boiler vapors which will help improve these parameters. Please contact Petro-Canada Technical Services to discuss further
08/10/22	Sample results indicate the fluid is in suitable condition for continued service. Note fluid viscosity is slightly reduced from new. Please re-sample in 6 months to build a trend. Visc @ 40°C is abnormally low.

Petro-Canada makes no representation or warranty of any kind, either express or implied, as to the accuracy or completeness of the analysis and assumes no responsibility and shall have no liability whatsoever with respect to such analysis, or a party's use of it. Petro-Canada is a division of HollyFrontier Corporation.