




[12-31-53-19W5] H-431


Customer: PTRHTF20229	System Information	Sample Information
PEYTO EXPLORATION Box 7198 EDSON, AB T7E 1V4 CA Attn: Steve Warren Tel: (780)712-5616 E-Mail: swarren@peyto.com	System Volume: 0 ltr Bulk Operating Temp: Not Specified Heating Source: Blanket: Fluid: PETRO CANADA PETRO-THERM Make:	Lab No: 02561078 Analyst: Clinton Buhler Sample Date: 05/25/23 Received Date: 05/31/23 Completed: 06/22/23 Clinton Buhler Clinton.Buhler@HFSinclair.com

Recommendation: Sample results indicate the fluid is in suitable condition for continued service. Please re-sample in 12 months. Please try to sample at or near pump discharge (after a thorough purge) rather than from the bottom drain line. This may influence the solids content measured.

Comments:




Sample Date	Received Date	Fluid Age	Sample Location	Flash Point (COC)	Water (KF)	Viscosity (40°C)	Acid Number	Solids	GCD 10%	GCD 50%	GCD 90%	GCD % < 335°C
	mm/dd/yy			°F/°C	ppm	cSt	mg/KOH/g	%wt	°F/°C	°F/°C	°F/°C	%
05/25/23	05/31/23	571.5y	DRAIN LINE BOTTOM	442 / 228	31.9	37.4	0.05	0.114	728 / 387	813 / 434	910 / 488	0.46
09/16/20	09/21/20	0.0y	Bottom/non ciruc	446 / 230	9.9	37.0	0.19	0.147	728 / 387	812 / 434	909 / 487	0.12
10/01/19	10/07/19	6.0y		437 / 225	5.3	36.7	0.375	0.421	737 / 392	812 / 433	898 / 481	0.00
Baseline Data				433 / 223		34.2	0.03		720 / 382	817 / 436	900 / 482	1.00

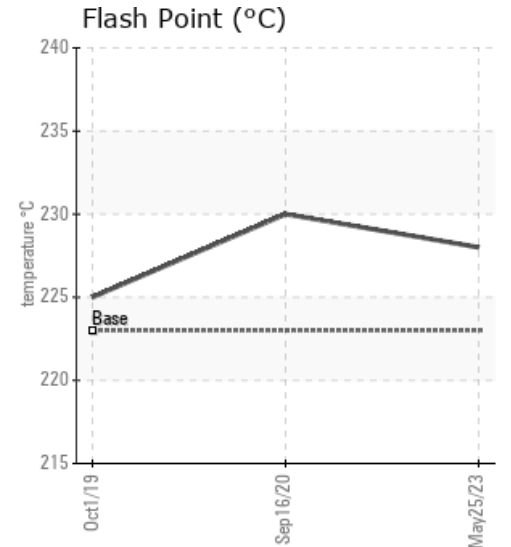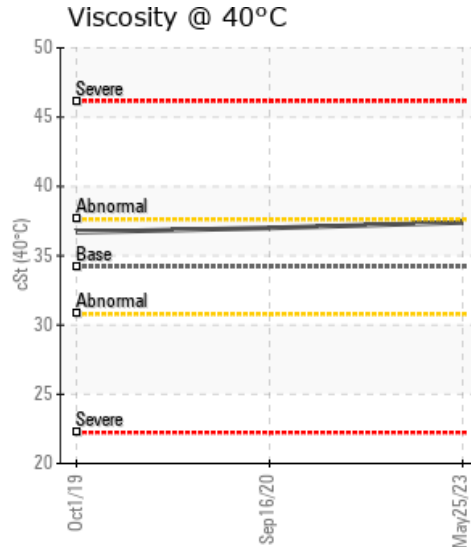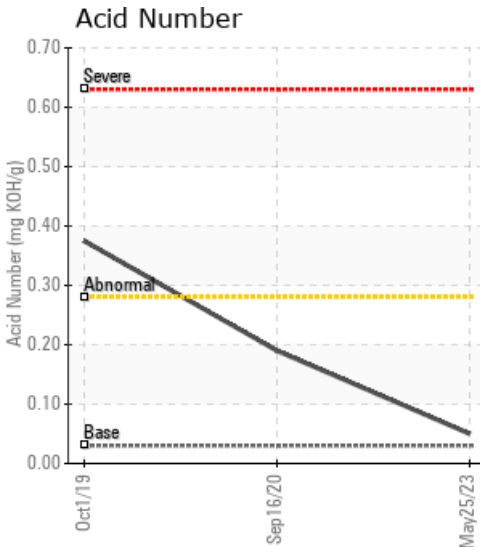

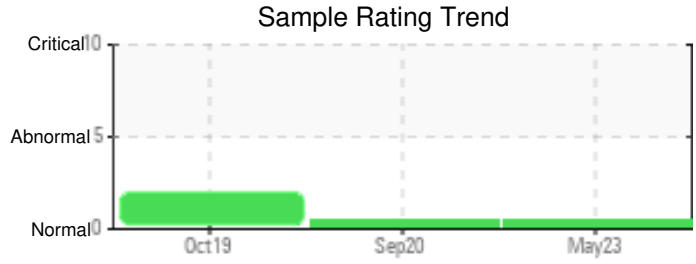

Sample Date	Iron	Chromium	Nickel	Aluminum	Copper	Lead	Tin	Cadmium	Silver	Vanadium	Silicon	Sodium	Potassium	Titanium	Molybdenum	Antimony	Manganese	Lithium	Boron	Magnesium	Calcium	Barium	Phosphorus	Zinc
05/25/23	5	0	0	0	0	0	0	0	0	0	10	0	0	0	0	0	0	0	0	0	0	0	0	0
09/16/20	2	0	0	0	0	0	0	0	0	0	11	0	0	0	0	0	0	0	0	0	0	0	0	0
10/01/19	2	0	0	0	0	0	0	0	0	0	10	0	0	0	0	0	0	0	0	0	0	0	0	0
Baseline Data			0	0						0			0	0					0				0	

Elemental analysis results (above) in parts per million (ppm). [10,000 ppm = 1.0%]

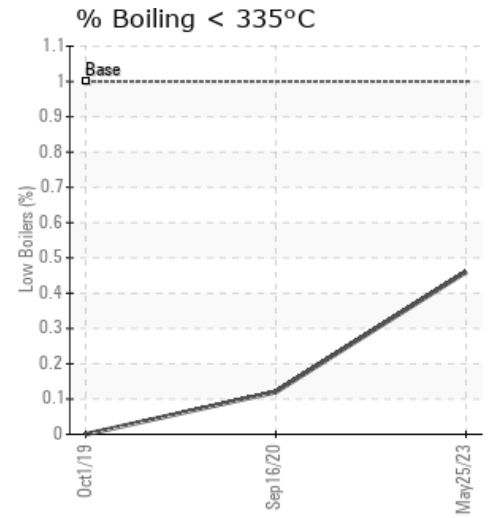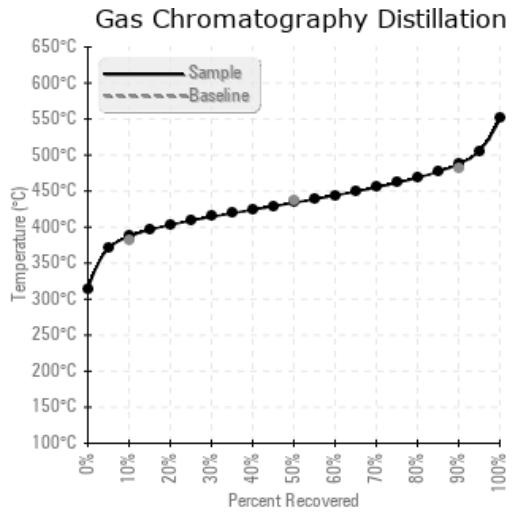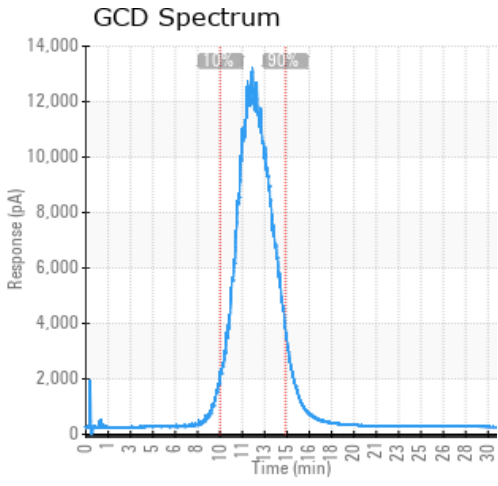

Historical Comments	
09/16/20	Fluid appears to be in good condition. Continue to operate and resample in 6 months.
10/01/19	The fluid is in a fair condition and suitable for further use. AN is slightly elevated. This indicates some light fluid degradation. Pentane Insoluble (solids) content (0.42%) is getting close to the reportable limit of 0.5%. Filtration of the fluid is recommended. Please re-sample in 6 months. Pentane Insolubles levels are abnormally high. Acid Number (AN) is abnormally high.

Petro-Canada makes no representation or warranty of any kind, either express or implied, as to the accuracy or completeness of the analysis and assumes no responsibility and shall have no liability whatsoever with respect to such analysis, or a party's use of it. Petro-Canada is a division of HollyFrontier Corporation.