




TECNO COMPONENTS


Customer: PTRHTF40088	System Information	Sample Information
EMANUELE MASCHERPA SPA VIA NATALE BATTAGLIA 39 MILAN, Italy Attn: MARCO MUNAFO Tel: (390)228-0031 E-Mail: m.munafo@mascherpa.it	System Volume: 2000 ltr Bulk Operating Temp: 536F / 280C Heating Source: Blanket: Fluid: MOBIL MOBILTHERM 605 Make: DIATERM	Lab No: 02565178 Analyst: Bill Quesnel CLS,OMA II,MLA-III,LLA-I Sample Date: 04/14/23 Received Date: 06/20/23 Completed: 07/07/23 Bill Quesnel CLS,OMA II,MLA-III,LLA-I

Recommendation: Resample at the next service interval to monitor.

Comments: The condition of the fluid is suitable for further service.




Sample Date	Received Date	Fluid Age	Sample Location	Flash Point (COC)	Water (KF)	Viscosity (40°C)	Acid Number	Solids	GCD 10%	GCD 50%	GCD 90%	GCD % < 335°C
	mm/dd/yy			°F/°C	ppm	cSt	mg/KOH/g	%wt	°F/°C	°F/°C	°F/°C	%
04/14/23	06/20/23	10.0y		439 / 226	14.7	30.4	0.02	0.020	705 / 374	790 / 421	893 / 478	1.49
Baseline Data				446 / 230		30.4	0.05		707 / 375	806 / 430	896 / 480	1.5

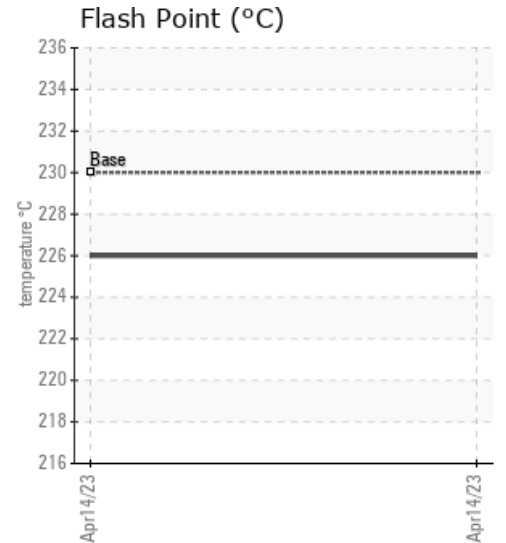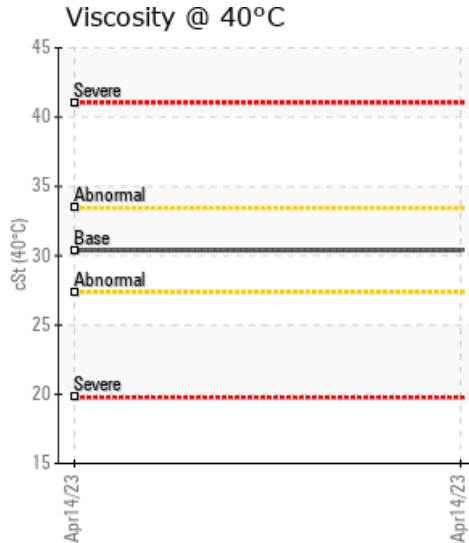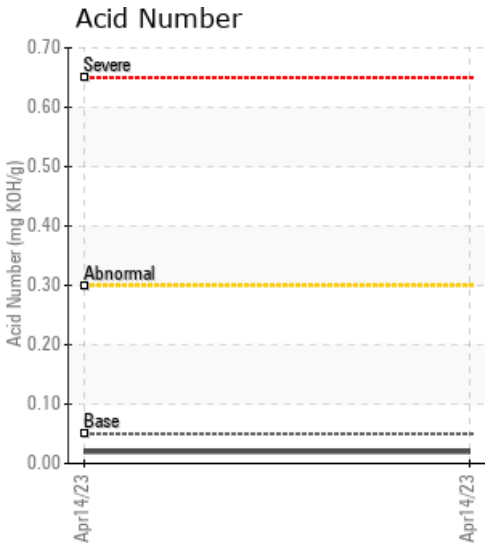

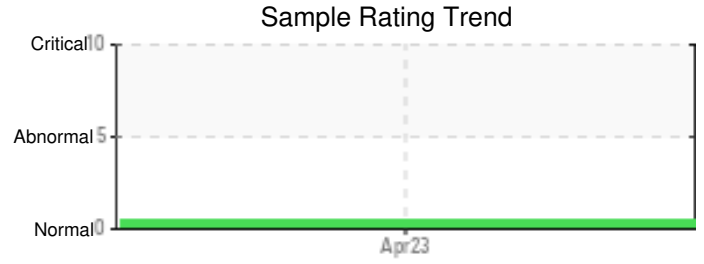

Sample Date	Iron	Chromium	Nickel	Aluminum	Copper	Lead	Tin	Cadmium	Silver	Vanadium	Silicon	Sodium	Potassium	Titanium	Molybdenum	Antimony	Manganese	Lithium	Boron	Magnesium	Calcium	Barium	Phosphorus	Zinc
04/14/23	2	0	0	0	0	0	0	0	0	0	5	14	1	0	0	0	0	0	0	0	12	0	0	0
Baseline Data			0	0						0			0	0					0				0	

Elemental analysis results (above) in parts per million (ppm). [10,000 ppm = 1.0%]

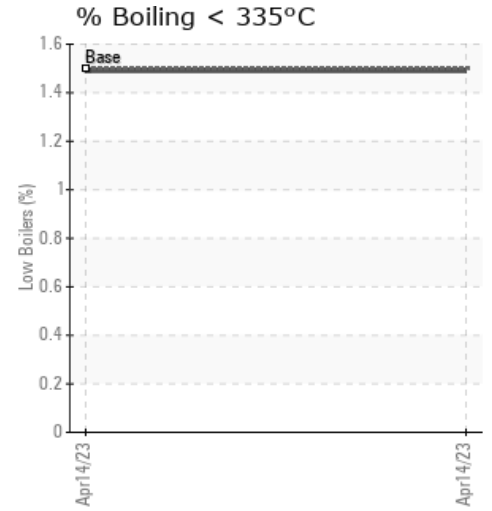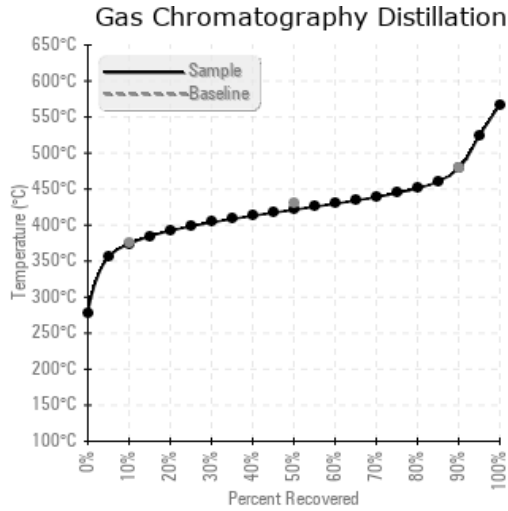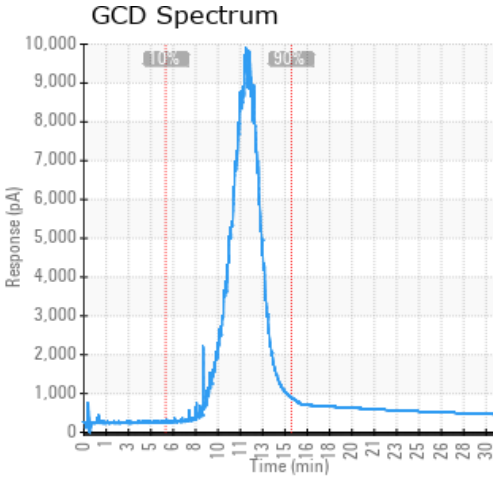

Historical Comments

Petro-Canada makes no representation or warranty of any kind, either express or implied, as to the accuracy or completeness of the analysis and assumes no responsibility and shall have no liability whatsoever with respect to such analysis, or a party's use of it. Petro-Canada is a division of HollyFrontier Corporation.