




MAIN LINE ASSEMBLY



Customer: PTRHTF60040	System Information	Sample Information
DALTON FOAM 4959 SOUTH DIXIE HWY DALTON, GA 30735 US Attn: Jerry Moreno Tel: E-Mail: JERRY.MORENO@DALTONFOAM.NET	System Volume: 80 gal Bulk Operating Temp: 450F / 232C Heating Source: Blanket: Fluid: PETRO CANADA PETRO-THERM Make: CHORMALAX	Lab No: 02573553 Analyst: Jake Finn Sample Date: 07/20/23 Received Date: 08/01/23 Completed: 08/04/23 Jake Finn jake.finn@HFSinclair.com

Recommendation: Sample appears to be clean and free of contamination. No signs of fluid degradation or component wear. Recommended to resample in 12 months for regular monitoring.

Comments: N/A




Sample Date	Received Date	Fluid Age	Sample Location	Flash Point (COC)	Water (KF)	Viscosity (40°C)	Acid Number	Solids	GCD 10%	GCD 50%	GCD 90%	GCD % < 335°C
	mm/dd/yy			°F/°C	ppm	cSt	mg/KOH/g	%wt	°F/°C	°F/°C	°F/°C	%
07/20/23	08/01/23	0.0h	return line	468 / 242	18.3	33.5	0.01	0.044	720 / 382	812 / 434	906 / 486	1.71
Baseline Data				433 / 223		34.2	0.03		720 / 382	817 / 436	900 / 482	1.00

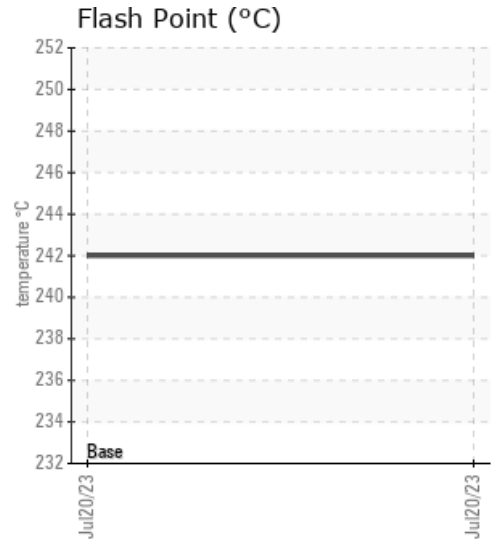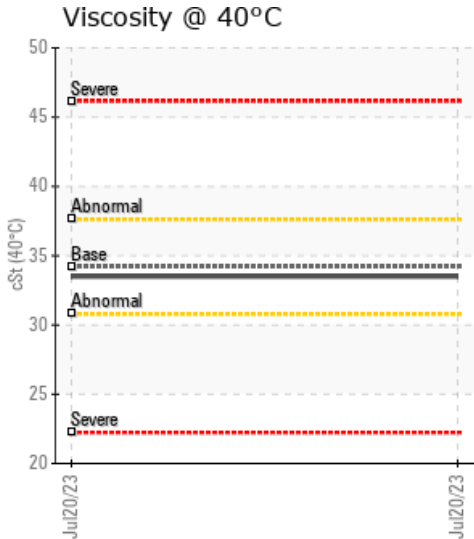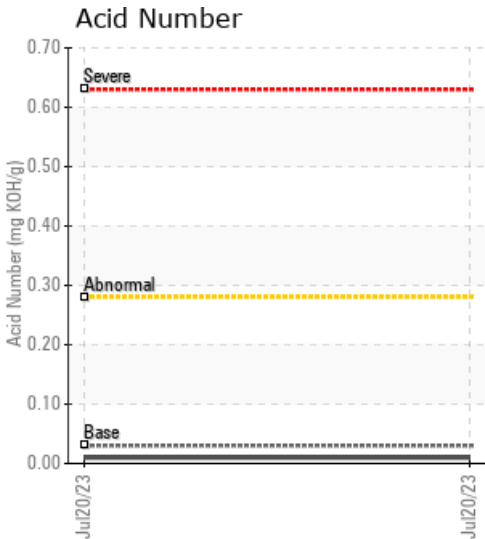

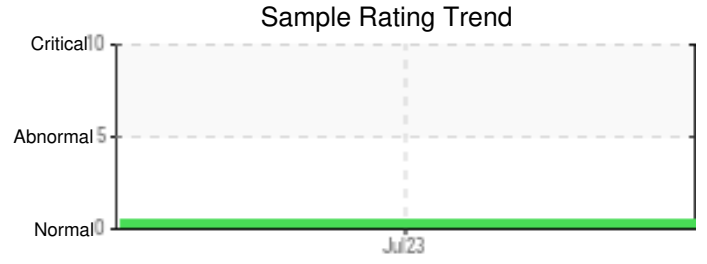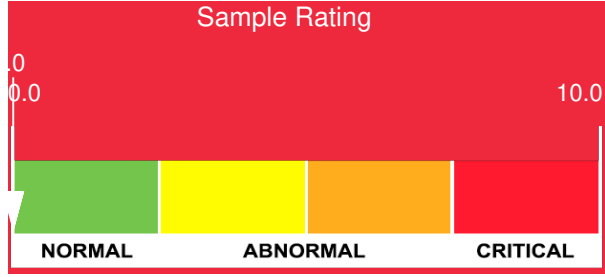

Sample Date	Iron	Chromium	Nickel	Aluminum	Copper	Lead	Tin	Cadmium	Silver	Vanadium	Silicon	Sodium	Potassium	Titanium	Molybdenum	Antimony	Manganese	Lithium	Boron	Magnesium	Calcium	Barium	Phosphorus	Zinc
07/20/23	2	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	1	11	0	2	3
Baseline Data			0	0						0			0	0					0				0	

Elemental analysis results (above) in parts per million (ppm). [10,000 ppm = 1.0%]

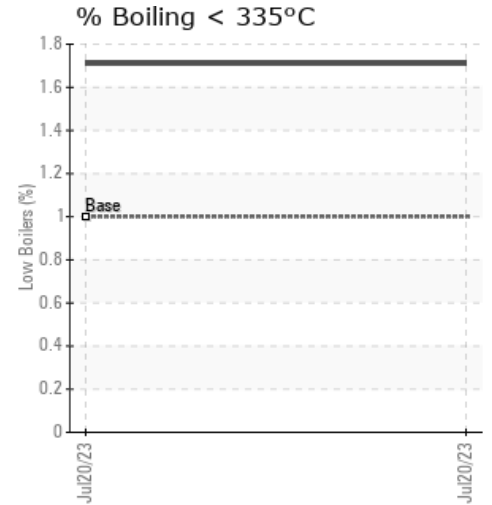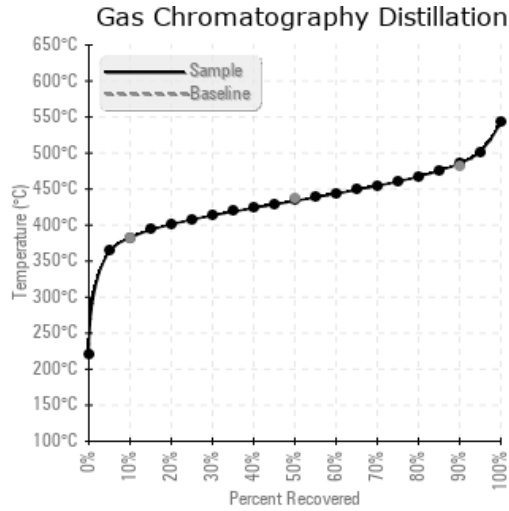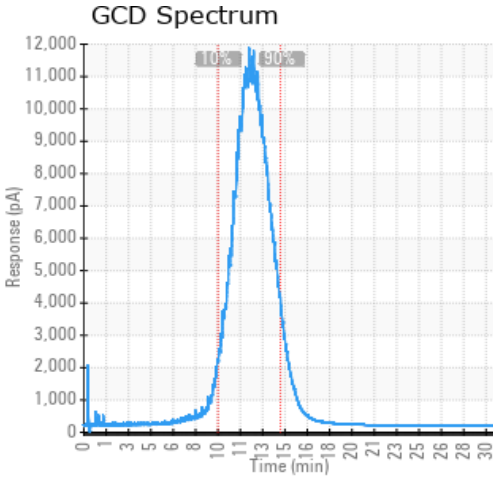

Historical Comments

Petro-Canada makes no representation or warranty of any kind, either express or implied, as to the accuracy or completeness of the analysis and assumes no responsibility and shall have no liability whatsoever with respect to such analysis, or a party's use of it. Petro-Canada is a division of HollyFrontier Corporation.