




THERMISCHE OLIE SITE B



Customer: PTRHTF40045	System Information	Sample Information
OVI NV SA HOOGBUUL 1 OLEN 2250 OLEN, 2250 BE Attn: Philippe Vanreusel Tel: 3(201)421-3051 E-Mail: Philippev@ovi.be	System Volume: 6200 ltr Bulk Operating Temp: 536F / 280C Heating Source: Blanket: Fluid: PETRO CANADA PURITY FG HEAT TRANSFER FLUID Make: WANSON	Lab No: 02594404 Analyst: Bill Quesnel CLS,OMA II,MLA-III,LLA-I Sample Date: 09/28/23 Received Date: 11/06/23 Completed: 11/10/23 Bill Quesnel CLS,OMA II,MLA-III,LLA-I

Recommendation: Fluid fit for further use. Please send in next sample at next service interval.

Comments: (GCD) 90% Distillation Point is abnormally high.




Sample Date	Received Date	Fluid Age	Sample Location	Flash Point (COC)	Water (KF)	Viscosity (40°C)	Acid Number	Solids	GCD 10%	GCD 50%	GCD 90%	GCD % < 335°C
	mm/dd/yy			°F/°C	ppm	cSt	mg/KOH/g	%wt	°F/°C	°F/°C	°F/°C	%
09/28/23	11/06/23	24.0m		453 / 234	26.6	32.2	0.81	0.074	710 / 377	821 / 438	922 / 494	3.93
01/06/21	01/18/21	1.0m	REAR FLOW COLLECTOR	446 / 230	62.3	32.8	0.95	0.113	725 / 385	825 / 441	924 / 496	2.21
12/29/20	01/18/21	0.0m	FROM TRUCK	482 / 250	4.9	36.3	0.98	0.046	742 / 395	832 / 444	928 / 498	0.00
Baseline Data				459 / 237		37.12	0.90		721 / 383	807 / 431	892 / 478	1.5

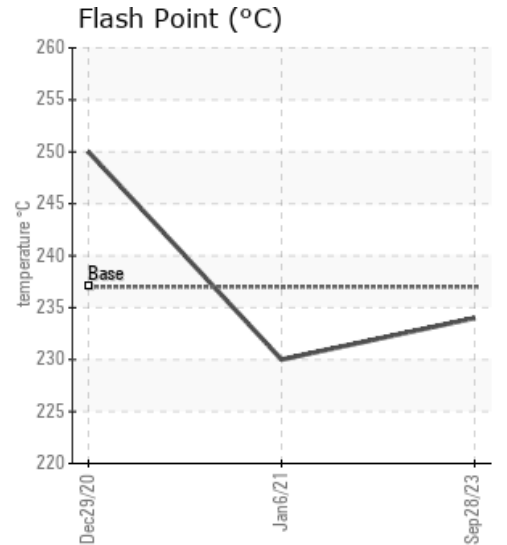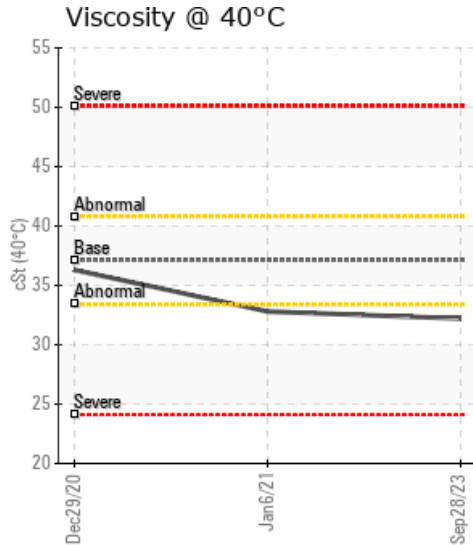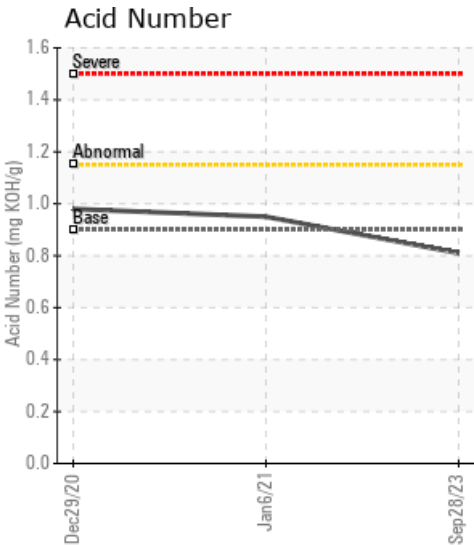

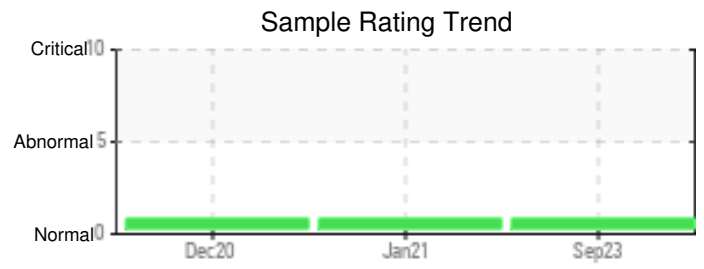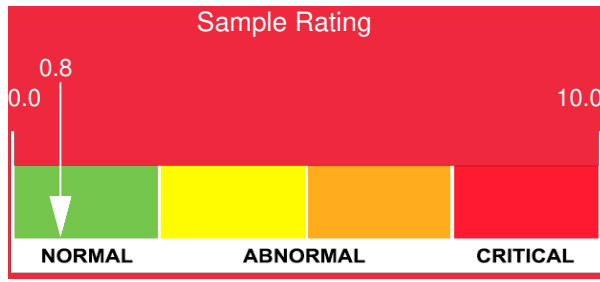

Sample Date	Iron	Chromium	Nickel	Aluminum	Copper	Lead	Tin	Cadmium	Silver	Vanadium	Silicon	Sodium	Potassium	Titanium	Molybdenum	Antimony	Manganese	Lithium	Boron	Magnesium	Calcium	Barium	Phosphorus	Zinc
09/28/23	94	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	26	0
01/06/21	8	0	0	0	0	0	0	0	0	0	4	0	0	0	0	0	0	0	0	0	0	0	90	0
12/29/20	0	0	0	0	0	0	0	0	0	0	4	0	0	0	0	0	0	0	0	0	0	0	224	0
Baseline Data			0	0						0		0	0				0	0					230	

Elemental analysis results (above) in parts per million (ppm). [10,000 ppm = 1.0%]

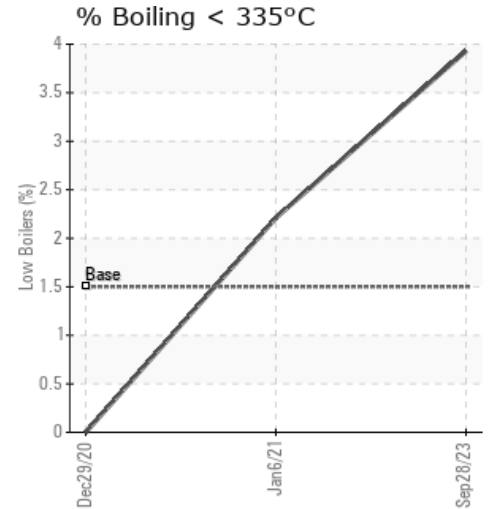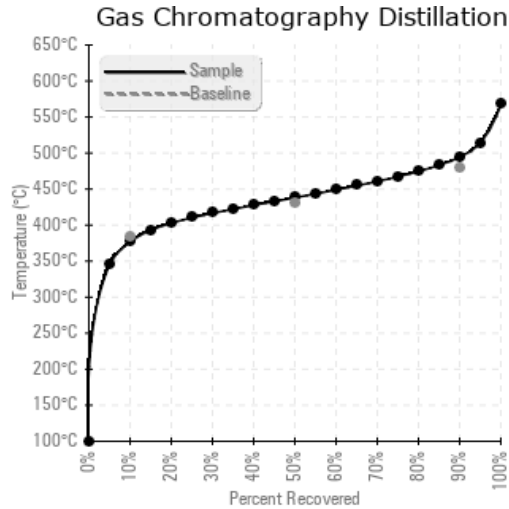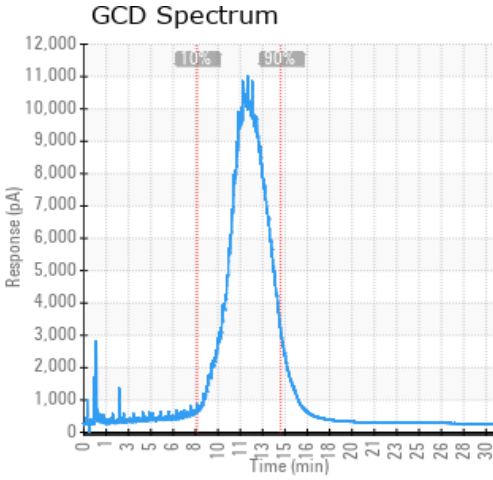

Historical Comments	
01/06/21	Fluid fit for further use. Please send in next sample at next service interval. (GCD) 90% Distillation Point is abnormally high.
12/29/20	Fluid fit for further use. Please send in new sample at next service interval. (GCD) 90% Distillation Point is abnormally high.

Petro-Canada makes no representation or warranty of any kind, either express or implied, as to the accuracy or completeness of the analysis and assumes no responsibility and shall have no liability whatsoever with respect to such analysis, or a party's use of it. Petro-Canada is a division of HollyFrontier Corporation.