




TFS H/O SYSTEM #1



Customer: PTRHTF10176	System Information	Sample Information
CERTAINEED ROOFING 100 CERTAINEED DR JONESBURG, MO 63351 US Attn: Jeff Montgomery Tel: (952)261-9532 E-Mail: jeffrey.d.montgomery@saint-gobain.com	System Volume: 4462 gal Bulk Operating Temp: 553F / 289C Heating Source: Blanket: Fluid: PETRO CANADA CALFLO AF Make: FSE	Lab No: 02596967 Analyst: Neil Buchanan Sample Date: 11/14/23 Received Date: 11/16/23 Completed: 11/22/23 Neil Buchanan neil.buchanan@HFSinclair.com

Recommendation: Flash point is marginally low and this correlates to the higher GCD % below 335C. Consider venting low boilers through the expansion tank. Resample next interval to monitor.

Comments: COC Flash Point is abnormally low. Visc @ 40°C is abnormally low. (GCD) % < 335°C is marginally high. (GCD) 10% Distillation Point is marginally low.




Sample Date	Received Date	Fluid Age	Sample Location	Flash Point (COC)	Water (KF)	Viscosity (40°C)	Acid Number	Solids	GCD 10%	GCD 50%	GCD 90%	GCD % < 335°C
	mm/dd/yy			°F/°C	ppm	cSt	mg/KOH/g	%wt	°F/°C	°F/°C	°F/°C	%
11/14/23	11/16/23	7.0y	SIDE STREAM FILTER	331 / 166	9.9	22.4	0.12	0.077	625 / 329	785 / 419	892 / 478	10.14
11/14/22	11/22/22	0.0y		432 / 222	9.0	26.6	0.06	0.075	691 / 366	805 / 430	922 / 495	4.29
08/15/22	08/29/22	0.0y		324 / 162	92.8	22.3	0.12	0.064	634 / 334	786 / 419	898 / 481	9.62
07/15/22	07/26/22	0.0y		291 / 144	24.0	22.3	0.11	0.072	638 / 337	786 / 419	896 / 480	9.30
05/26/22	06/09/22	0.0y	sidestream filter	309 / 154	0.00	22.0	0.08	0.080	626 / 330	786 / 419	900 / 482	10.16
Baseline Data				435 / 224		32.7	0.03		693 / 367	790 / 421	887 / 475	2.5

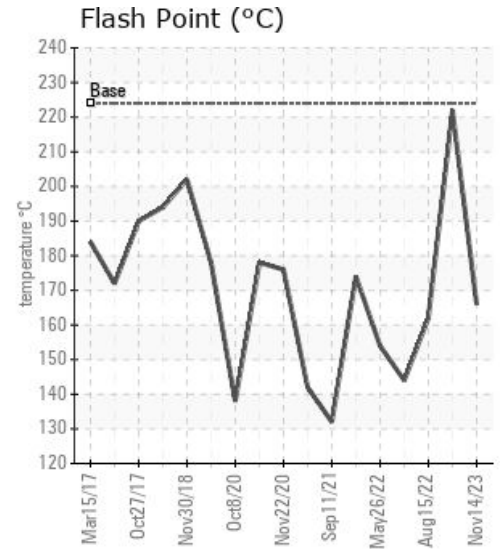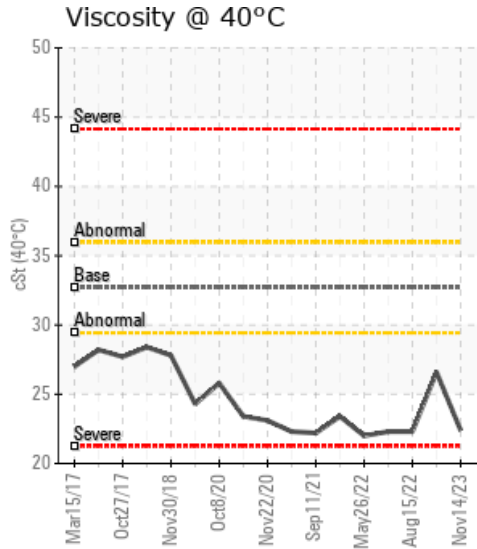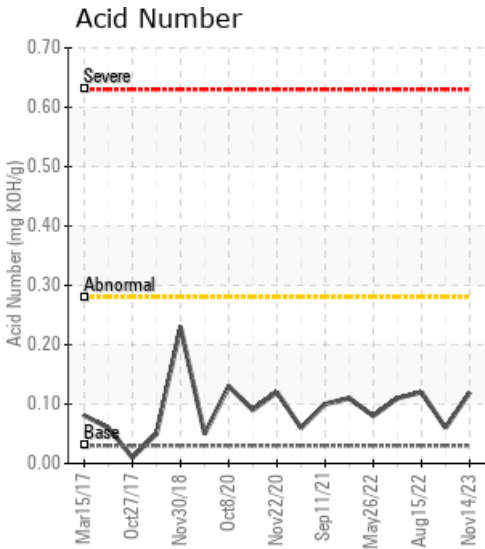

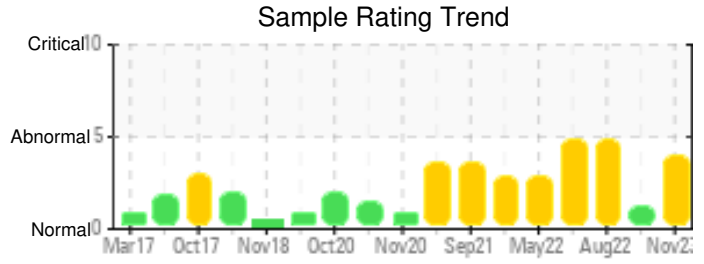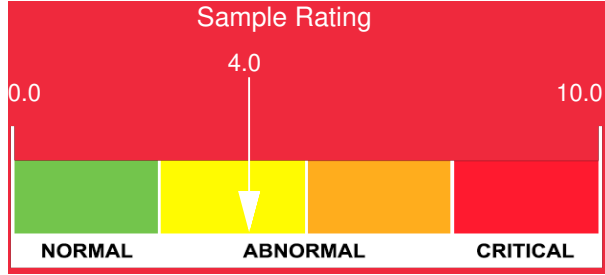

Sample Date	Iron	Chromium	Nickel	Aluminum	Copper	Lead	Tin	Cadmium	Silver	Vanadium	Silicon	Sodium	Potassium	Titanium	Molybdenum	Antimony	Manganese	Lithium	Boron	Magnesium	Calcium	Barium	Phosphorus	Zinc
11/14/23	14	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	65	0
11/14/22	2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	71	0
08/15/22	1	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	47	0
07/15/22	4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	50	0
05/26/22	1	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	52	0
Baseline Data			0	0						0			0	0					0				270	

Elemental analysis results (above) in parts per million (ppm). [10,000 ppm = 1.0%]

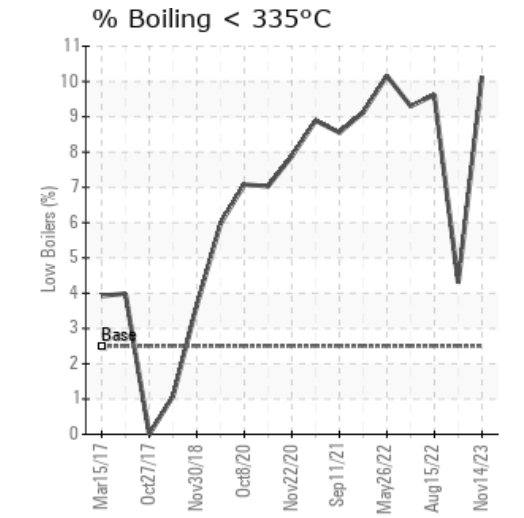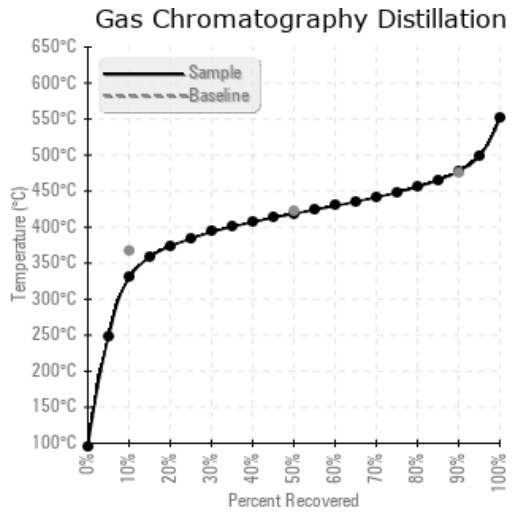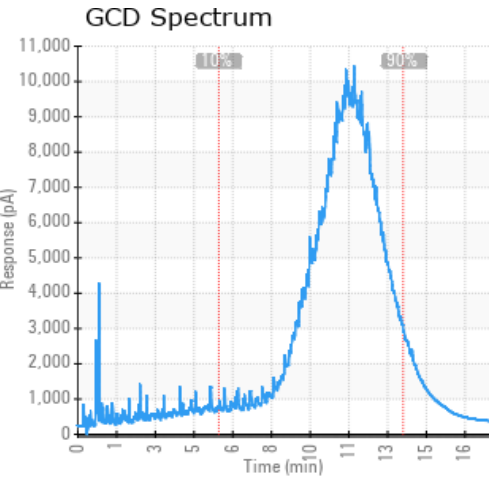

Historical Comments	
11/14/22	No indication of asphalt contamination. GCD at 90% is slightly higher than normal. Resample at the next interval to monitor. (GCD) 90% Distillation Point is abnormally high. Visc @ 40°C is abnormally low.
08/15/22	Flash point and viscosity remain abnormally low. GCD % <335C is elevated and the GCD graph shows the presence of low boilers from thermal degradation. Fluid should be safely vented through the expansion tank or a partial or full fluid change should be made. COC Flash Point is severely low. Visc @ 40°C is abnormally low. (GCD) % < 335°C is marginally high. (GCD) 10% Distillation Point is marginally low.
07/15/22	Flash Point is severely low and GCD% below 335C is high showing the formation of low boilers. COC Flash Point is severely low. Visc @ 40°C is abnormally low. (GCD) % < 335°C is marginally high. (GCD) 10% Distillation Point is marginally low.
05/26/22	Flash point is severely low and GCD shows the formation of low boilers. Other properties are acceptable. COC Flash Point is severely low. (GCD) % < 335°C is marginally high. (GCD) 10% Distillation Point is marginally low.

Petro-Canada makes no representation or warranty of any kind, either express or implied, as to the accuracy or completeness of the analysis and assumes no responsibility and shall have no liability whatsoever with respect to such analysis, or a party's use of it. Petro-Canada is a division of HollyFrontier Corporation.