

# PULASKI PLANT

**Customer: PTRHTF10238**  
 Reliable Asphalt Corp  
 3741 S Pulaski Rd  
 Chicago, IL 60623 US  
 Attn: Bob Madden  
 Tel:  
 E-Mail: rmadden@biganepaving.com




**System Information**  
 System Volume: 550 gal  
 Bulk Operating Temp: 330F / 166C  
 Heating Source:  
 Blanket:  
 Fluid: PETRO CANADA PETRO-THERM  
 Make: GENTECK


**Sample Information**  
 Lab No: 02603355  
 Analyst: Yvette Trzcinski  
 Sample Date: 12/06/23  
 Received Date: 12/14/23  
 Completed: 12/18/23  
 Yvette Trzcinski  
 yvette.trzcinski@HFSinclair.com

Recommendation: Acid number, viscosity and low boilers have all improved from last year. The distillation point at 90% has increased which means there is some oxidation occurring in the system and the solids have increased. The oil is acceptable for continued service I would recommend filtering the oil and resampling in 6 - 9 months

Comments: Acid Number (AN) is abnormally high. (GCD) 90% Distillation Point is marginally high.




Sample Date	Received Date	Fluid Age	Sample Location	Flash Point (COC)	Water (KF)	Viscosity (40°C)	Acid Number	Solids	GCD 10%	GCD 50%	GCD 90%	GCD % < 335°C
	mm/dd/yy			°F/°C	ppm	cSt	mg/KOH/g	%wt	°F/°C	°F/°C	°F/°C	%
12/06/23	12/14/23	2.0y		428 / 220	30	34.8	0.28	0.219	715 / 379	819 / 437	919 / 493	3.06
12/05/22	12/22/22	0.0y		349 / 176	9.6	24.3	0.36	0.184	665 / 352	805 / 429	914 / 490	7.72
12/10/21	12/21/21	5.0y		442 / 228	31.2	38.0	0.42	0.221	727 / 386	819 / 437	922 / 495	1.26
11/13/20	11/24/20	2.0y	BOILER	435 / 224	52.4	37.8	0.45	0.403	731 / 388	820 / 438	923 / 495	0.31
Baseline Data				433 / 223		34.2	0.03		720 / 382	817 / 436	900 / 482	1.00

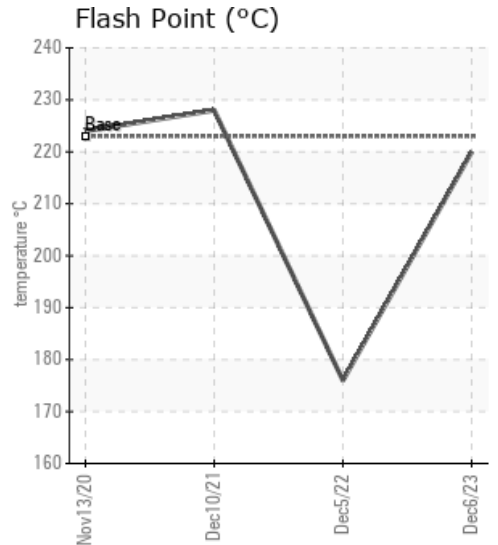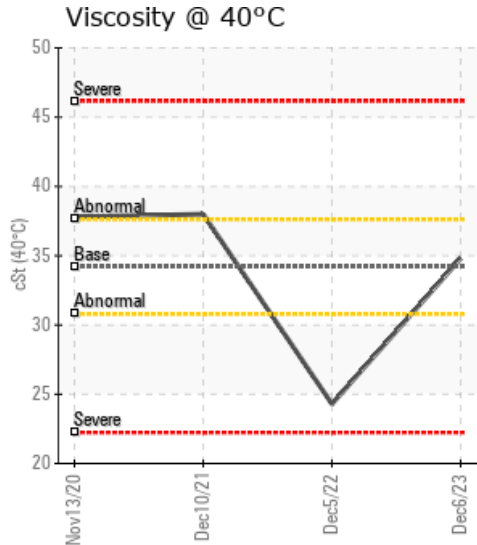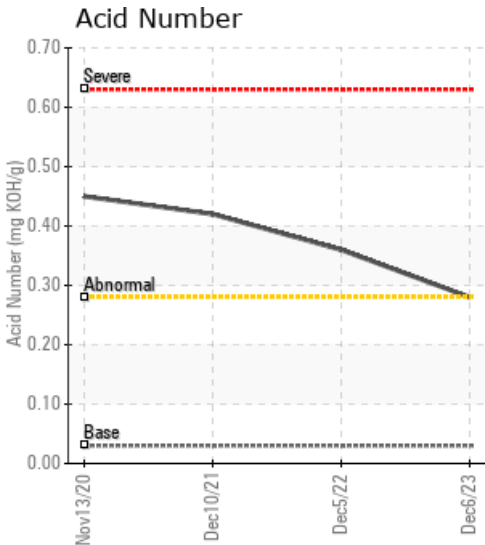

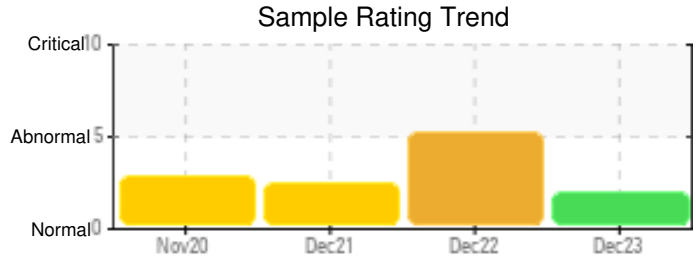

Sample Date	Iron	Chromium	Nickel	Aluminum	Copper	Lead	Tin	Cadmium	Silver	Vanadium	Silicon	Sodium	Potassium	Titanium	Molybdenum	Antimony	Manganese	Lithium	Boron	Magnesium	Calcium	Barium	Phosphorus	Zinc	
12/06/23	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	
12/05/22	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
12/10/21	2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	2	4	0	2	3	
11/13/20	2	0	0	0	1	0	0	0	0	0	2	0	0	0	0	0	0	0	0	2	4	0	0	2	
Baseline Data			0	0						0			0	0					0				0		

Elemental analysis results (above) in parts per million (ppm). [10,000 ppm = 1.0%]

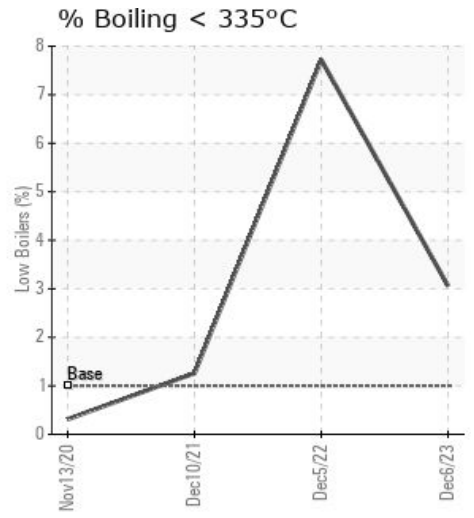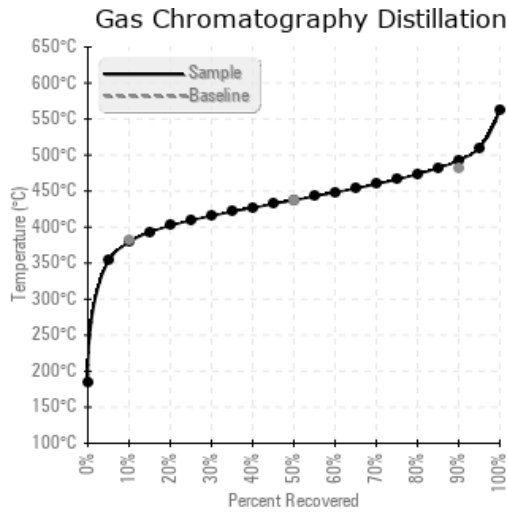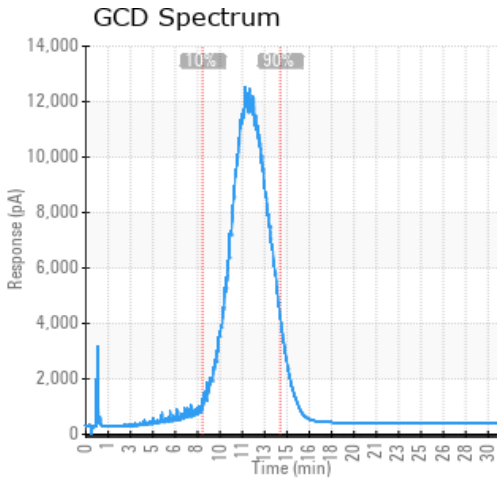

Historical Comments	
12/05/22	System has signs of thermal degradation the GCD % < 335 C of 7.72 which is a sign of low boilers. Which has lowered the flash point 84 degrees from 433 F down to 349 F. Lowered the viscosity of the fluid, decrease of 28%. Option of venting the system to remove low boilers or sweetening of the product. Sample in 6 months Acid Number (AN) is abnormally high. COC Flash Point is abnormally low. Visc @ 40°C is abnormally low. (GCD) % < 335°C is marginally high. (GCD) 10% Distillation Point is marginally low.
12/10/21	There is some oxidation happening that has caused an increase in acid number, viscosity and GCD 90% over new oil but the sample is consistent and similar to the last sample taken in 2020. System is acceptable for continued use resample at the next interval Acid Number (AN) is abnormally high. (GCD) 90% Distillation Point is marginally high.
11/13/20	The fluid is showing signs of degradation the acid number is increasing as well as the pentane insoluble both signs the fluid is oxidizing forming acidic compounds and deposits that will continue to degrade the fluid and cause fouling build up in the system which affects the efficiency of the system. Recommend drain and flush to remove solids and recharge of the system with new fluid within the next 12 -18 months Pentane Insolubles levels are abnormally high. Acid Number (AN) is abnormally high. (GCD) 90% Distillation Point is marginally high.

Petro-Canada makes no representation or warranty of any kind, either express or implied, as to the accuracy or completeness of the analysis and assumes no responsibility and shall have no liability whatsoever with respect to such analysis, or a party's use of it. Petro-Canada is a division of HollyFrontier Corporation.