



Recommendation: Sample results indicate that the fluid is in good condition and is suitable for continued service. Resample in 12 months.

lyle.dach@HFSinclair.com

Comments:

Sample Date	Received Date	Fluid Age	Sample Location	Flash Point (COC)	Water (KF)	Viscosity (40°C)	Acid Number	Solids	GCD 10%	GCD 50%	GCD 90%	GCD % < 335°C
n	mm/dd/yy			°F/°C	ppm	cSt	mg/KOH/ g	%wt	°F/°C	°F/°C	°F/°C	%
06/01/24 0	06/06/24	26.0m	INLET LINE	462 / 239	6	34.8	0.02	0.067	724 / 384	814 / 435	912 / 489	1.09
11/05/23 1	11/07/23	18.0m		482 / 250	1.9	34.7	0.00	0.030	719/382	813 / 434	911 / 488	2.14
04/28/23 0	05/05/23	2.0m		442 / 228	77.2	34.9	0.05	0.081	722 / 383	814 / 434	910 / 488	1.50
11/21/22 1	11/25/22	7.0m		439 / 226	19.5	34.9	0.01	0.024	723 / 384	814 / 435	911 / 488	1.77

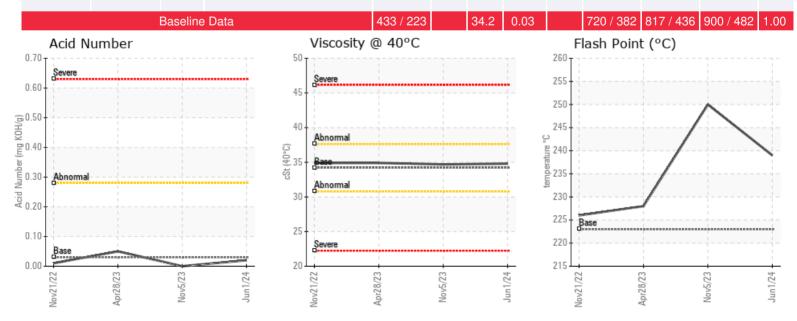

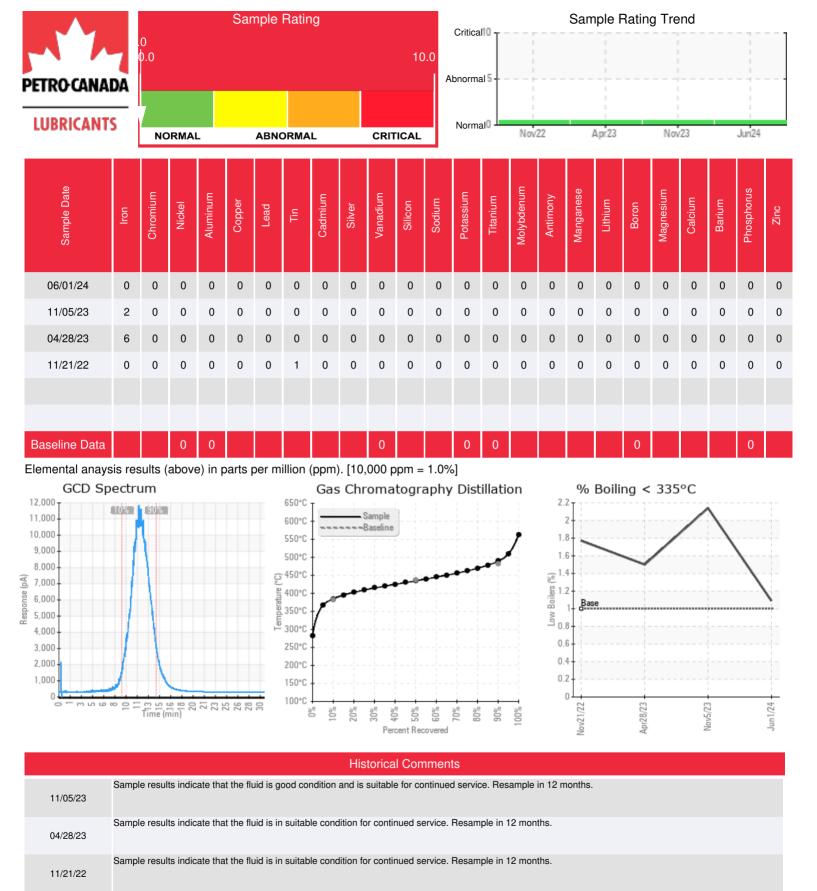

Petro-Canada makes no representation or warranty of any kind, either express or implied, as to the accuracy or completeness of the analysis and assumes no responsibility and shall have no liability whatsoever with respect to such analysis, or a party's use of it. Petro-Canada is a division of HollyFrontier Corporation.