




HOH1


Customer:	System Information	Sample Information
ASSOCIATED ASPHALT 1825 JAKE ALEXANDER BLVD WEST SALISBURY, NC 28147 USA Attn: LAURA BENFIELD Tel: (704)231-6160 E-Mail: lbenfield@associatedasphalt.com	System Volume: 0 gal Bulk Operating Temp: Not Specified Heating Source: Blanket: Fluid: MULTITHERM PG-1 Make:	Lab No: 05457733 Analyst: Doug Bogart Sample Date: 01/28/22 Received Date: 02/02/22 Completed: 02/11/22 Doug Bogart doug@wearcheckusa.com

Recommendation: Resample at the next service interval to monitor.

Comments: All component wear rates are normal. The water content is negligible. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sample Date	Received Date	Fluid Age	Sample Location	Flash Point (COC)	Water (KF)	Viscosity (40°C)	Acid Number	Solids	GCD 10%	GCD 50%	GCD 90%	GCD % < 335°C
	mm/dd/yy			°F/°C	ppm	cSt	mg/KOH/g	%wt	°F/°C	°F/°C	°F/°C	%
01/28/22	02/02/22	0.0h		351 / 177	7.0	45.59	1.35					
02/24/21	02/25/21	0.0h		361 / 183	178.6	28.39	1.251					
02/05/21	02/10/21	0.0h		370 / 188	59330.8	37.38	3.281					
12/06/19	12/12/19	0.0h			84500	39.4	0.782					
12/17/18	12/28/18	0.0h		369 / 187		26.2	3.377					
Baseline Data				340 / 171								

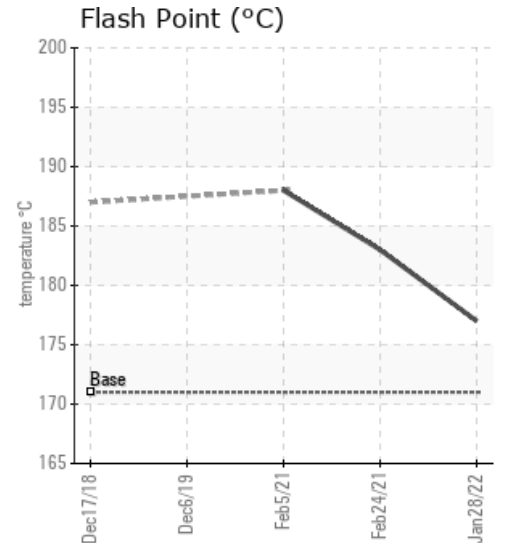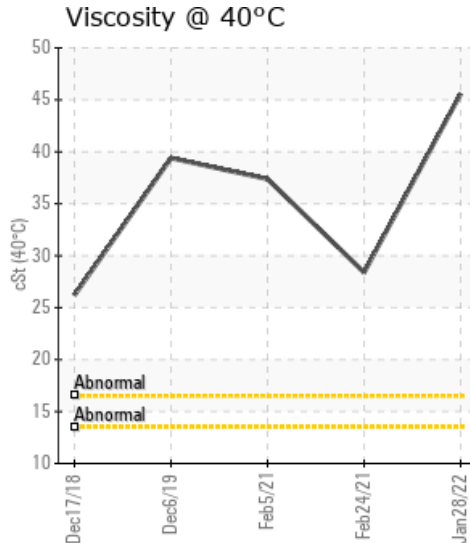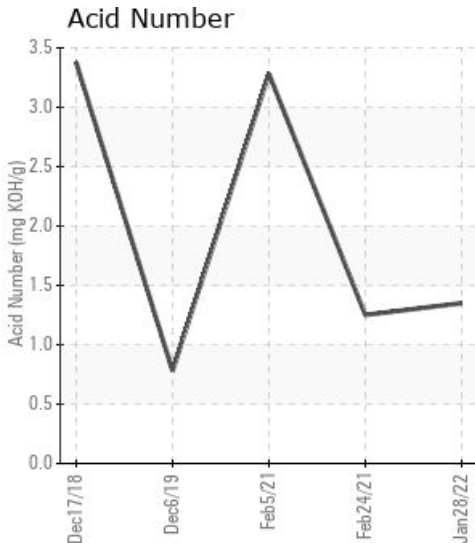

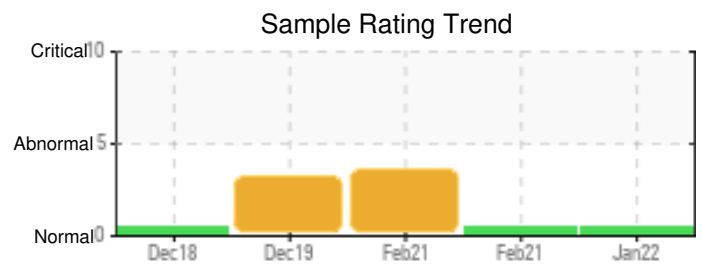

Sample Date	Iron	Chromium	Nickel	Aluminum	Copper	Lead	Tin	Cadmium	Silver	Vanadium	Silicon	Sodium	Potassium	Titanium	Molybdenum	Antimony	Manganese	Lithium	Boron	Magnesium	Calcium	Barium	Phosphorus	Zinc
01/28/22	136	0	0	4	0	0	0	0	0	0	4	0	6	0	0	0	2		0	0	2122	0	7	0
02/24/21	70	0	0	0	0	1	0	0	0	0	2	5	21	0	0	0	1		0	0	2389	0	0	1
02/05/21	197	0	0	0	0	0	0	0	0	0	3	4	0	0	0	3	2		17	0	1237	0	11	3
12/06/19	259	0	0	0	0	0	0	0	0	0	4	5	0	0	0	2	2		15	0	1462	0	5	2
12/17/18	18	0	0	0	0	0	0	0	0	0	2	6	11	0	0	5	0		0	0	2905	0	2	3
Baseline Data			0	0						0			0	0					0				0	

Elemental analysis results (above) in parts per million (ppm). [10,000 ppm = 1.0%]

GCD Spectrum

Historical Comments	
02/24/21	No corrective action is recommended at this time. All metal levels are normal indicating no corrosion in the system. There is no indication of any contamination in the oil. The flash point is normal (183C). The condition of the oil appears acceptable for service.
02/05/21	We advise that you follow the water drain-off procedure for this component, and use off-line filtration to improve the cleanliness of the system fluid. There is a high concentration of water present in the oil. High concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid.
12/06/19	We advise that you follow the water drain-off procedure for this component, and use off-line filtration to improve the cleanliness of the system fluid. There is a high concentration of water present in the oil. The AN level is acceptable for this fluid.
12/17/18	No corrective action is recommended at this time. All metal levels are normal indicating no corrosion in the system. There is no indication of any contamination in the oil. The flash point is normal (187C). The condition of the oil appears acceptable for service.

WearCheck Canada makes no representation or warranty of any kind, either express or implied, as to the accuracy or completeness of the analysis and assumes no responsibility and shall have no liability whatsoever with respect to such analysis, or a party's use of it.