




HOH 1


Customer:	System Information	Sample Information
ASSOCIATED ASPHALT 195 LAWSON FORK ROAD INMAN, SC 29349 USA Attn: MARSHALL HOWINGTON Tel: (864)472-2816 E-Mail: mhowington@associatedasphalt.com	System Volume: 1500 gal Bulk Operating Temp: Not Specified Heating Source: Blanket: Fluid: ESSO TERESSO ISO 68 Make: CEJ	Lab No: 05744354 Analyst: Doug Bogart Sample Date: 01/18/23 Received Date: 01/19/23 Completed: 01/25/23 Doug Bogart doug@wearcheckusa.com

Recommendation: This is a baseline read-out on the submitted sample.

Comments: All metal levels are normal indicating no corrosion in the system. There is no indication of any contamination in the sample. The condition of the sample is suitable for further service.

Sample Date	Received Date	Fluid Age	Sample Location	Flash Point (COC)	Water (KF)	Viscosity (40°C)	Acid Number	Solids	GCD 10%	GCD 50%	GCD 90%	GCD % < 335°C
	mm/dd/yy			°F/°C	ppm	cSt	mg/KOH/g	%wt	°F/°C	°F/°C	°F/°C	%
01/18/23	01/19/23	0.0h		464 / 240	71.2	86.7	0.54					
12/06/19	12/12/19	0.0h		460 / 238	43.6	89.14	0.575					
01/31/19	02/05/19	0.0h		439 / 226		78.95	0.519					
Baseline Data				439 / 226		68	0.02					

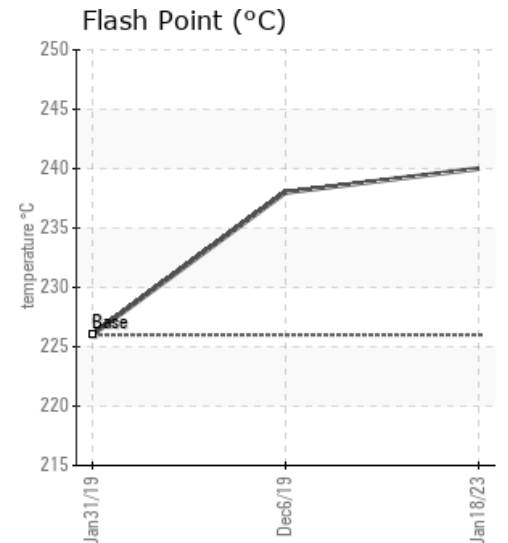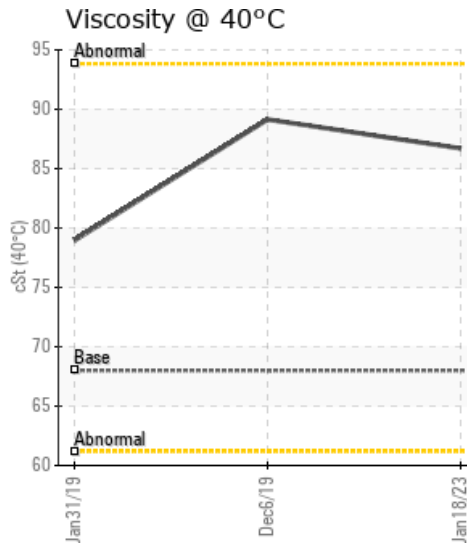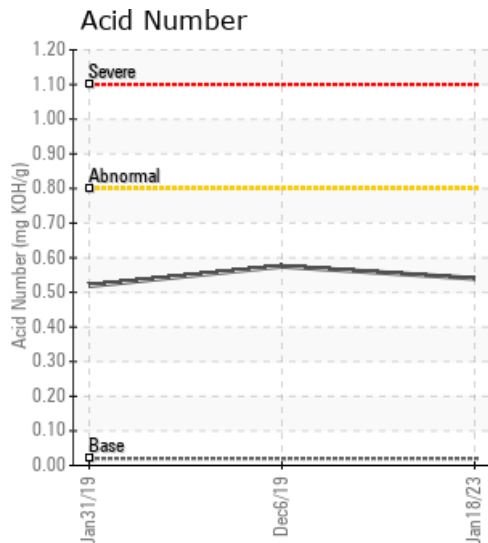

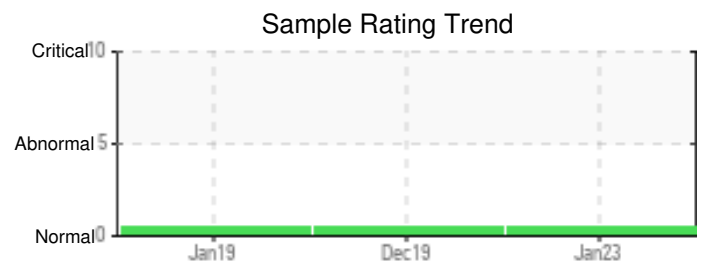

Sample Date	Iron	Chromium	Nickel	Aluminum	Copper	Lead	Tin	Cadmium	Silver	Vanadium	Silicon	Sodium	Potassium	Titanium	Molybdenum	Antimony	Manganese	Lithium	Boron	Magnesium	Calcium	Barium	Phosphorus	Zinc
01/18/23	31	0	0	0	0	2	1	0	0	0	1	2	0	0	0	0	0	0	0	3	7	0	32	5
12/06/19	26	0	0	0	0	2	0	0	0	0	0	0	4	0	0	0	0	0	0	0	0	0	0	0
01/31/19	20	0	0	0	0	0	0	0	0	0	0	0	6	0	0	0	0	0	0	0	0	0	0	0
Baseline Data			0	0					0			0	0					5				1		

Elemental analysis results (above) in parts per million (ppm). [10,000 ppm = 1.0%]

GCD Spectrum

Historical Comments

12/06/19	This is a baseline read-out on the submitted sample. There is no indication of any contamination in the sample. The condition of the sample is suitable for further service.
01/31/19	This is a baseline read-out on the submitted sample. There is no indication of any contamination in the sample. The condition of the sample is suitable for further service.